

SHEET NOTES

- 01 PROVIDE CAPPED 14"x18" SUPPLY TAKEOFF FOR FUTURE INSTALLATION OF VAV BOX.
- 02 PROVIDE 6"x6" OUTSIDE AIR INTAKE DUCT UP. TRANSITION TO 12"x12" ROOF PENETRATION. CONNECT TO ROOF MOUNTED INTAKE HOOD HS.
- 03 PROVIDE CAPPED 12" SUPPLY DUCT FOR FUTURE INSTALLATION OF VAV BOX.

Portland International Jetport
 1001 Westbrook Street
 Portland, Maine 04102

Gensler
 2020 K Street, NW
 Suite 200
 Washington, DC 20006
 Telephone 202.721.5200
 Facsimile 202.872.8587

oest ASSOCIATES, INC.
 360 Governors Road, South Portland, ME 04106 P: (207) 741-1770 F: (207) 774-2461 www.oest.com
 engineers • architects • surveyors • construction managers

GENERAL NOTES

- A SEE SHEET M00.00 FOR LEGEND AND GENERAL NOTES.
- B SUPPLY DUCTWORK SHALL BE SMACNA 10 INCH PRESSURE CLASS FROM AIR HANDLER OUTLET CONNECTIONS TO THE FAN POWERED VAV BOXES IN ALL AREAS AND TO THE SUPPLY REGISTERS AND GRILLES IN THE BAGGAGE HANDLING SPACE. RETURN DUCTWORK SHALL BE SMACNA 10 INCH PRESSURE CLASS FROM THE INLET OPENINGS TO THE AIR HANDLER CONNECTIONS.

Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	PWZ	RHB
03	12/03/08	PWZ	RHB
04	01/23/09	PWZ	RHB
05	10/26/09	PWZ	RHB

Project Name
 PWM Terminal Enhancement

Project Number
 09-6395-000


CAD File Name
 T:\6330\101\Sheets\M04.02.05.dwg

Description
 MECHANICAL DUCTWORK PLAN - LEVEL 2 - ZONE 5

Scale
 1/8" = 1'-0"

Ref. North

KEY PLAN

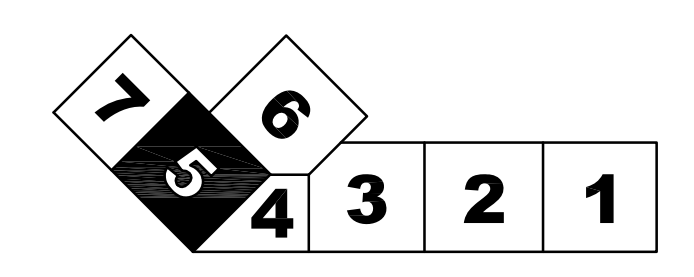

MECHANICAL DUCTWORK PLAN - LEVEL 2 - ZONE 5
 SCALE: 1/8" = 1'-0"