


SHEET NOTES

- EOD INDICATES EDGE OF DECK.
- INDICATES DIRECTION OF SPAN OF DECKING. DECK TO BE 6" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK REINFORCED WITH 6X6-W2.1XW2.1 W/ _____ DIAMETER WELD PATTERN AND _____ SCREWS SIDE LAP CONNECTION PER SPAN. SEE GENERAL NOTES.
- INDICATES DIRECTION OF SPAN OF DECKING. DECK TO BE 5 1/2" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK REINFORCED WITH 6X6-W2.1XW2.1 W/ _____ DIAMETER WELD PATTERN AND _____ SCREWS SIDE LAP CONNECTION PER SPAN. SEE GENERAL NOTES.
- INDICATES LOCATION OF MOMENT CONNECTION CAPABLE OF DEVELOPING THE FULL MOMENT CAPACITY OF THE FLEXURAL ELEMENT.
- INDICATES LOCATION OF VERTICAL CROSS BRACING, SEE FRAMING ELEVATIONS.
- XBRACE INDICATES LOCATION OF VERTICAL BRACING, SEE FRAMING ELEVATIONS.
- INDICATES LOCATION OF VERTICAL BRACING, SEE FRAMING ELEVATIONS.
- 12K (EXAMPLE) INDICATES BEAM END REACTION IN KIPS.
- (SL) INDICATES SLOPED BEAM.
- (E) INDICATES EXISTING.

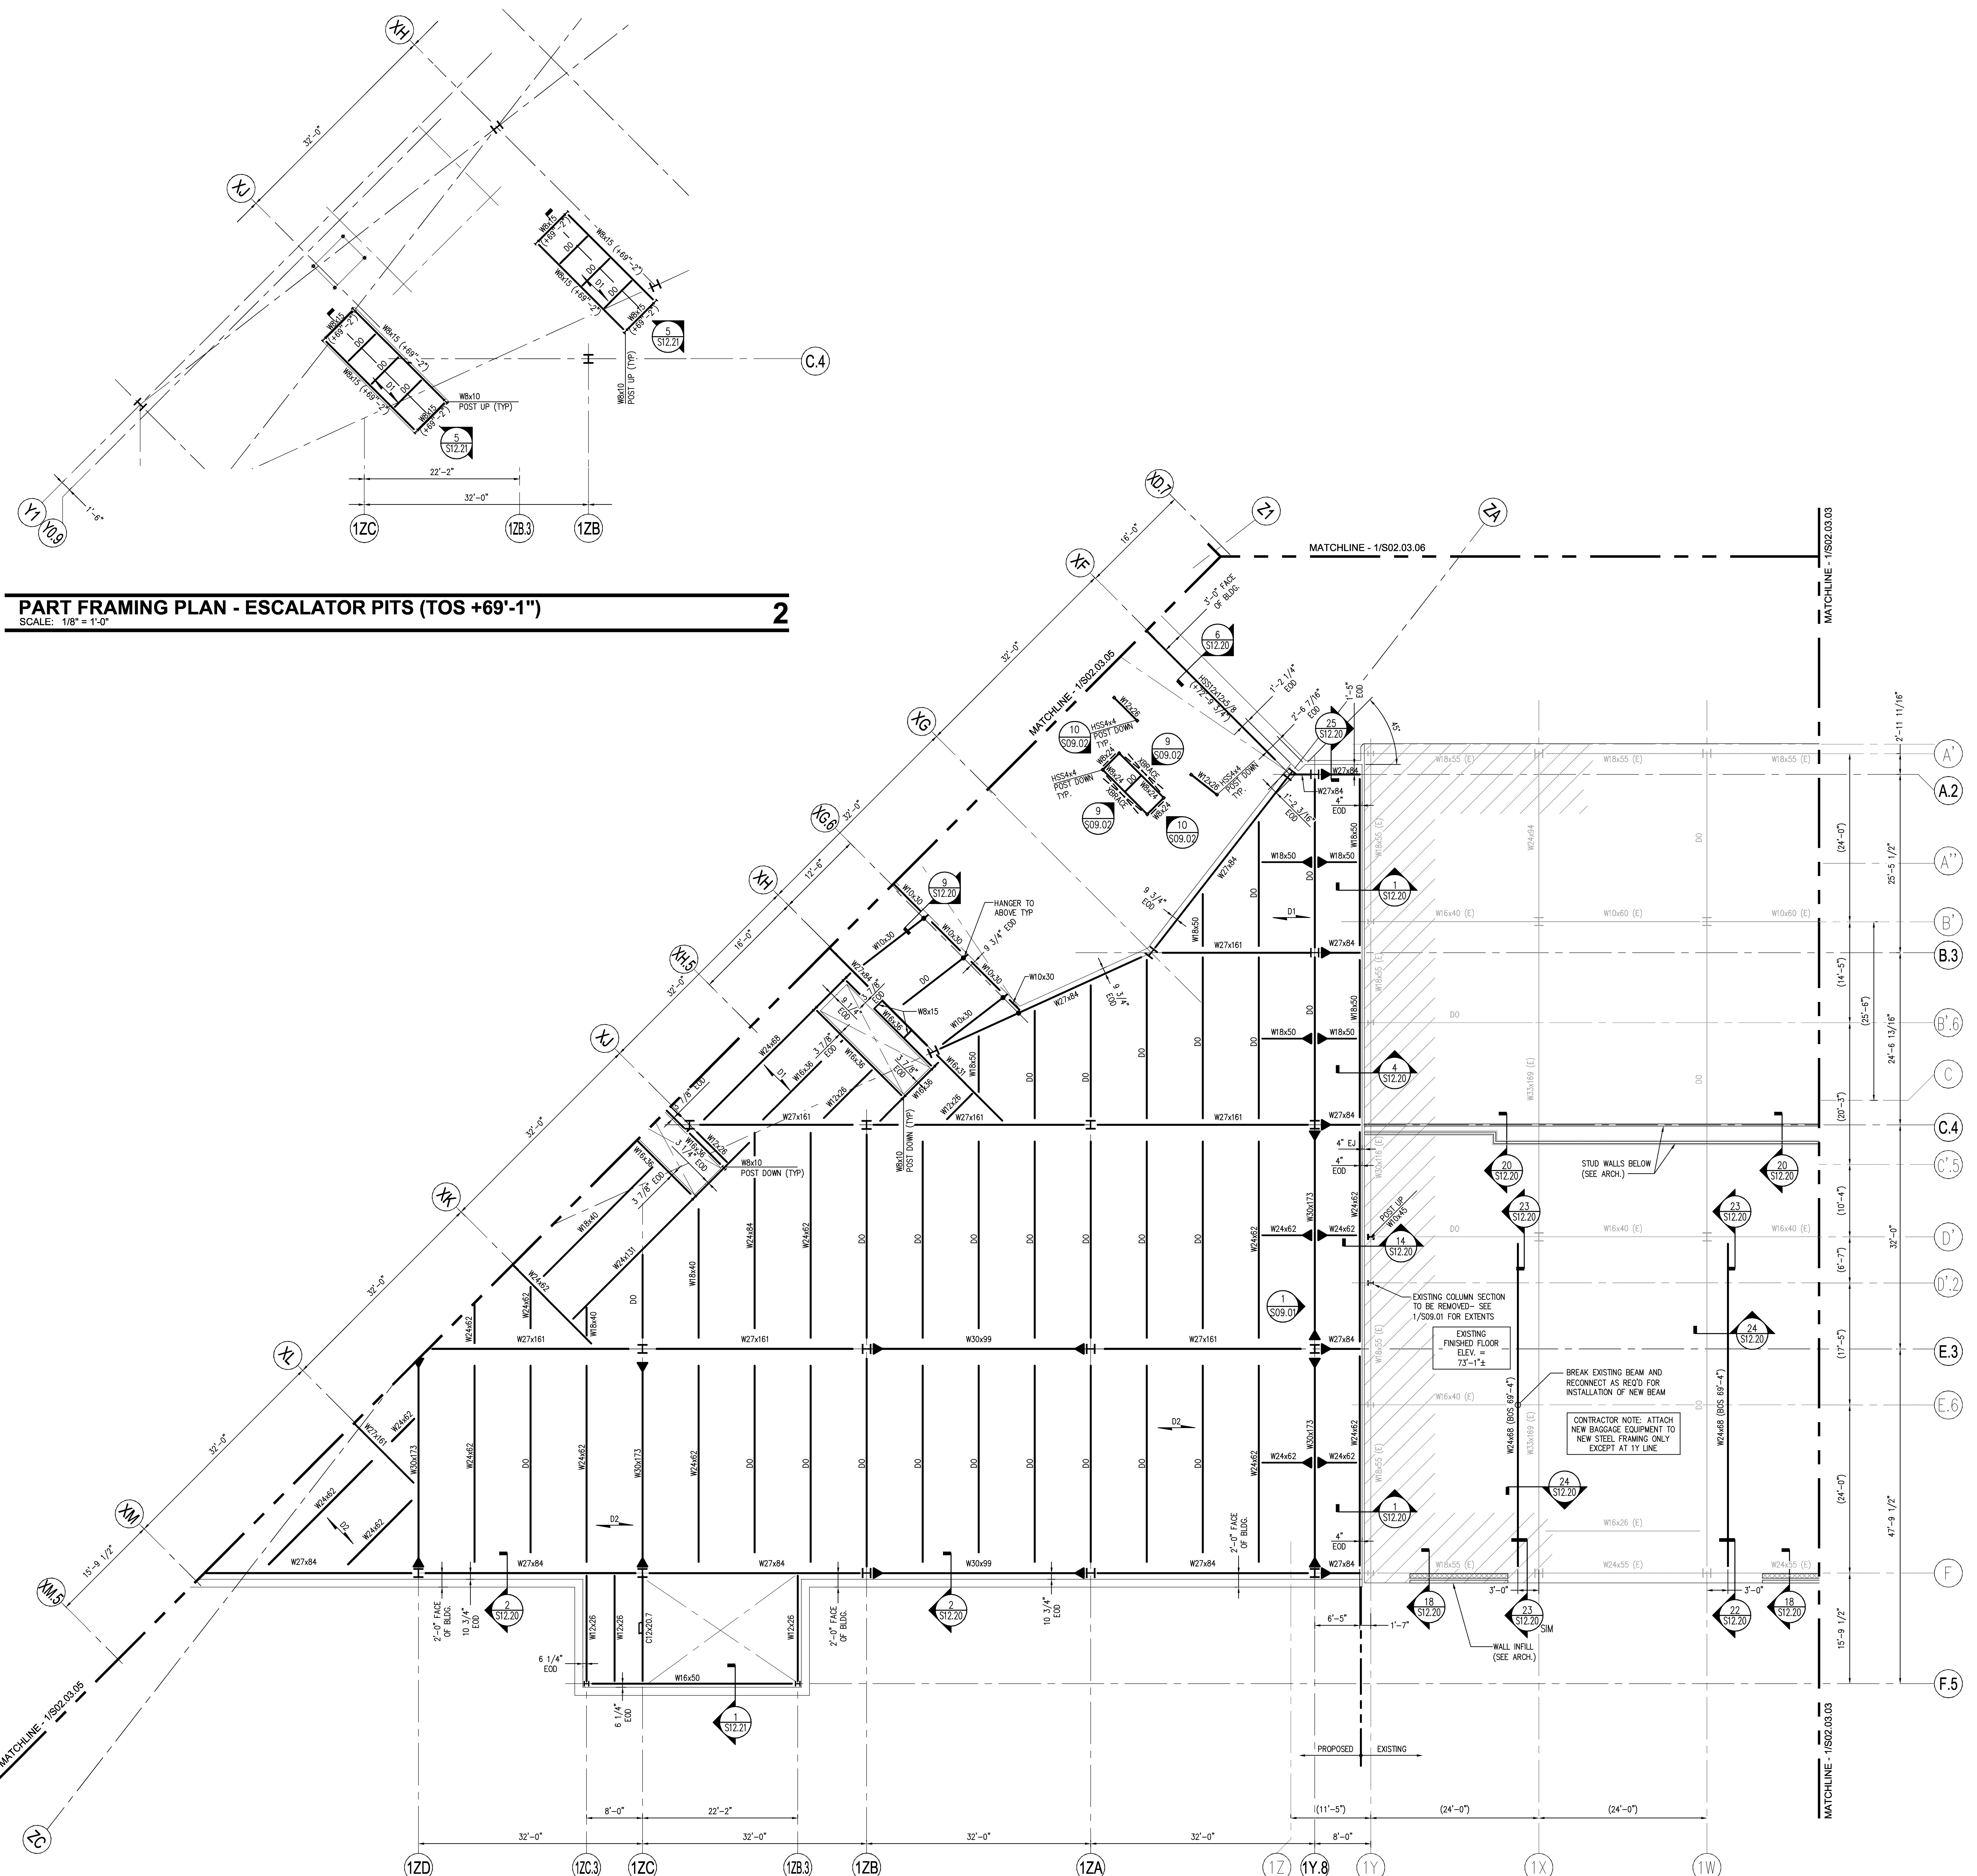


PART FRAMING PLAN - ESCALATOR PITS (TOS +69'-1") **2**

SCALE: 1/8" = 1'-0"

GENERAL NOTES

1. ALL EXISTING CONDITIONS SHALL BE VERIFIED IN THE FIELD PRIOR TO BEGINNING OF ANY WORK. IF EXISTING FIELD CONDITIONS DO NOT PERMIT THE INSTALLATION OF THE WORK IN ACCORDANCE WITH THE DETAILS AS SHOWN, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY AND PROVIDE A SKETCH OF THE CONDITION WITH PROPOSED MODIFICATION FOR REVIEW BY ARCHITECT.
2. CONTRACTOR TO CONFIRM ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO START OF WORK.
3. FINISHED FLOOR ELEVATION = (+) VARIES, RE: ARCH TOP OF STEEL ELEVATION = (+) 72'-7 1/4" UNLESS NOTED OTHERWISE.
4. FRAMING NOT SPECIFICALLY DIMENSIONED SHALL BE ASSUMED EQUALLY SPACED.
5. SEE SHEET S00.00 FOR GENERAL STRUCTURAL NOTES AND DESIGN LOADS.
6. DIMENSIONS IN PARENTHESIS ARE FOR REFERENCE ONLY.
7. ALL FLOOR FRAMING MEMBERS SHALL BE PROPERLY BRACED BY THE CONTRACTOR UNTIL THE STRUCTURAL FLOOR DIAPHRAGM HAS BEEN COMPLETELY CONSTRUCTED.
8. CONTRACTOR SHALL COORDINATE ALL FLOOR OPENINGS WITH MECHANICAL DRAWINGS. ALL FLOOR OPENINGS LARGER THAN 10" DIAMETER OR SQUARE SHALL BE SUPPORTED ON FRAME (SEE SHEET S12.04). ANY OPENING NOT SHOWN ON THIS DRAWING SHALL NOT BE CONSTRUCTED WITHOUT THE ARCHITECT'S APPROVAL.
9. EXISTING BUILDING INFORMATION USED TO PREPARE PLANS OF THIS AREA WERE TAKEN FROM AS-BUILT DRAWINGS FURNISHED BY PUDA DATED SEPTEMBER 2006
10. METAL STUD GAGES SHALL BE SELECTED BASED ON THE STUD DEPTHS SHOWN ON THE ARCHITECTURAL PLANS, WIND LOAD = 35 PSF AND MAXIMUM DEFLECTION OF 1/360 OR 0.3". BRICK VENER, 1/360 FOR PANEL WALL. - VERTICAL DEFLECTION CLIPS FOR ALL STUDS ATTACHING TO BEAMS.
11. FLOOR SLABS AT THIS LEVEL SHALL BE INSTALLED WITH RADIANT HEAT. COORDINATE W/ ARCH & MECH DWGS.

Issue	Date & Issue Description	By	Check
01	07/11/08	JDE	---
02	09/22/08	JDE	---
03	12/03/08	JDE	---
04	01/23/09	JDE	---
05	10/26/09	JDE	---

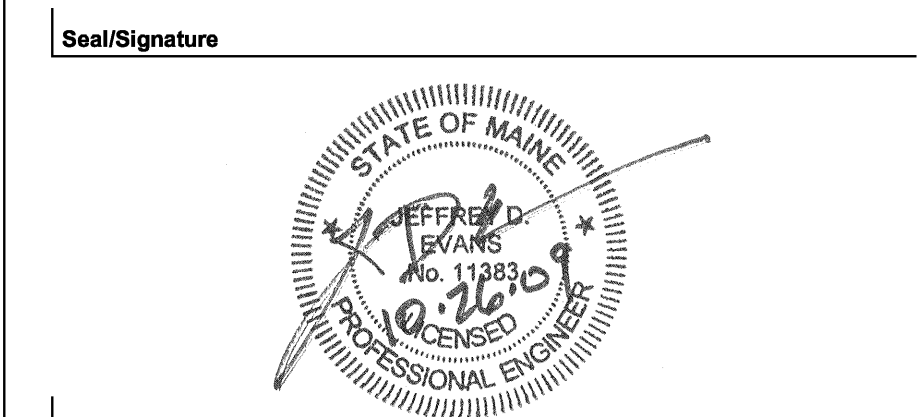


Project Name: PVM Terminal Enhancement
Project Number: 08.0395.000
CAD File Name: T:\5330101\SHEETS\S02.03.04.DWG
Description: FRAMING PLAN - LEVEL 3 - ZONE 4

Scale: 1/8" = 1'-0"

S02.03.04

KEY PLAN

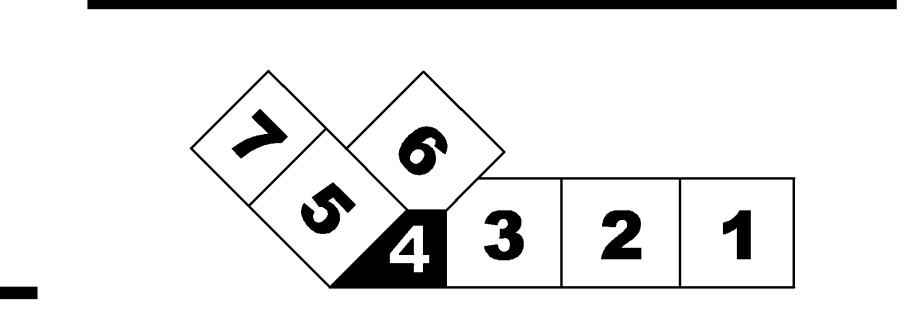

FRAMING PLAN - LEVEL 3 - ZONE 4

SCALE: 1/8" = 1'-0"