

Portland International Jetport

1001 Westbrook Street
Portland, Maine 04102

Gensler
2020 K Street, NW
Suite 200
Washington, DC 20006
Telephone 202.771.5200
Facsimile 202.872.8587

oest ASSOCIATES, INC.
361 Gopham Road, South Portland, ME 04106 P: (207) 764-1770 F: (207) 774-1246 www.oest.com
engineers - architects - surveyors - construction managers

amec
343 Gorham Road, South Portland ME 04106
P: (207) 761-1770 F: (207) 774-1246 www.amec.com

THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check
01	07/11/08	LAM	BHG
02	09/22/08	LAM	BHG
03	12/03/08	LAM	BHG
04	01/23/09	LAM	BHG
05	10/28/09	LAM	BHG
06	11/02/09	LAM	BHG
07	11/12/09	LAM	BHG
08	01/25/10	LAM	BHG
09	09/01/11	LAM	BHG


SHEET NOTES

- PROVIDE GFCI TYPE RECEPTACLES IN THE ESCALATOR LOWER LEVEL MACHINE SPACE. COORDINATE LOCATION AND INSTALLATION WITH THE ESCALATOR CONTRACTOR.
- PROVIDE QUAD RECEPTACLE FOR TRANSCIEVER CABINET. PROVIDE (2) 3" CONDUITS (ONE FROM EACH TRANSCIEVER CABINET) UP TO ROOF IN LOCATION IDENTIFIED. PROVIDE CONDUIT WITH PULL STRINGS AND KEEP SWEEPS AS LARGE AS POSSIBLE TO MINIMIZE QUANTITY OF PULL BOXES.
- PROVIDE 8"x8"x4" JUNCTION BOX AND MOUNT TO WALL BETWEEN TRANSCIEVER CABINETS. RUN 2" CONDUIT WITH PULL STRING FROM THIS JUNCTION BOX TO IDF #2, ROOM 1512.


GENERAL NOTES

- A SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.
- B CONTRACTOR SHALL REFER TO FIRE ALARM, SECURITY, IT, AND PUBLIC ADDRESS SYSTEMS DRAWINGS FOR CONDUITS & WIRING REQUIREMENTS.

KEY PLAN

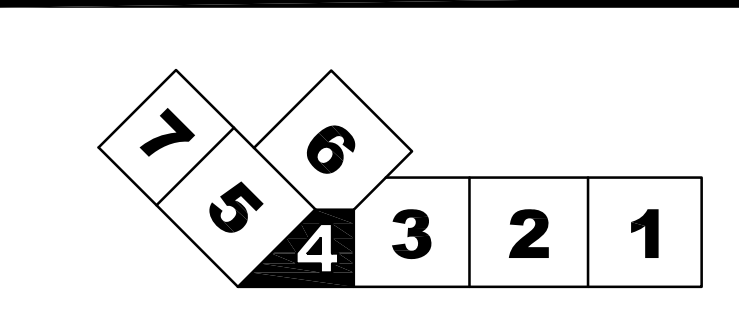

Scale: 1/8" = 1'-0"
Ref. North
E02.01.04
©2009 Gensler

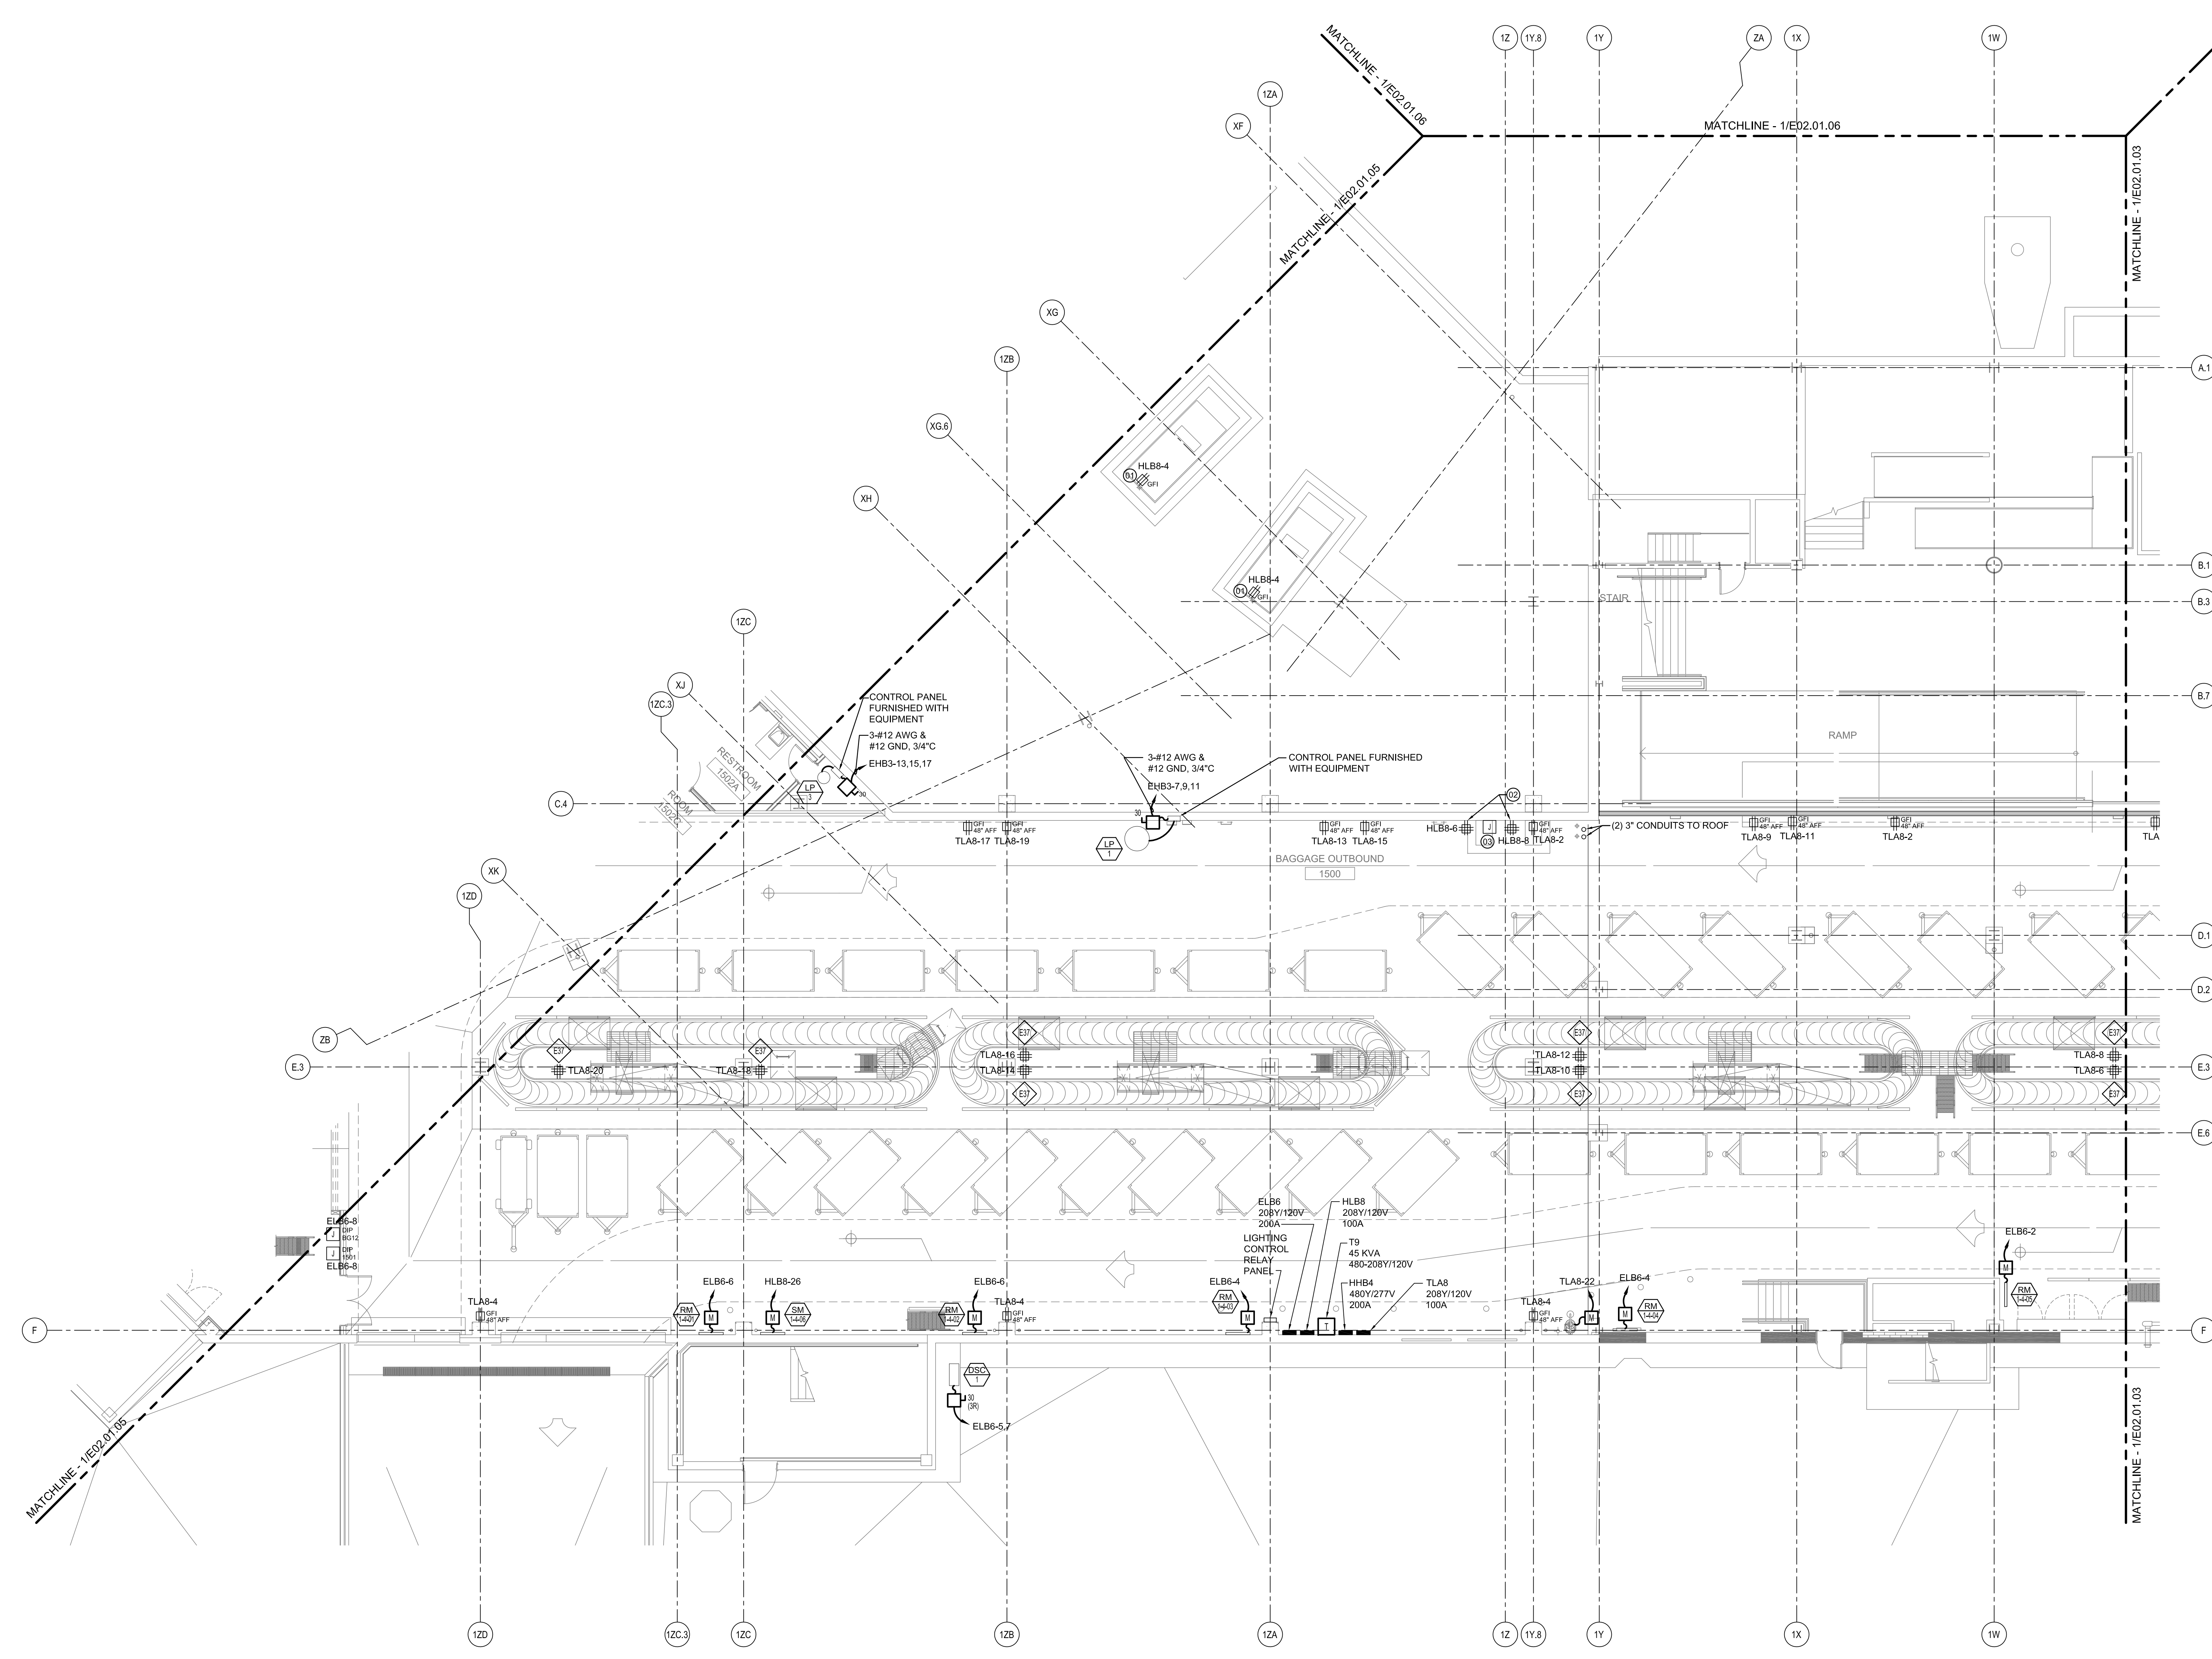

ELECTRICAL POWER PLAN - LEVEL 1 - ZONE 4

SCALE: 1/8" = 1'-0"