

SHEET NOTES

- 01 FURNISH AND INSTALL 1" DUCT LINER ON 42"x28" DUCT ALONG FULL LENGTH OF DUCT. PROVIDE 42"x28" CLEAR INSIDE DIMENSION. DUCT LINER EQUAL TO INDUSTRIAL NOISE CONTROL ACOUSTIC DUCTLINER.
- 02 FURNISH AND INSTALL 1" DUCT LINER ON 44"x26" DUCT FROM CONNECTION TO 48"x34" DUCT TO 14"x8" DUCT CONNECTION. PROVIDE 44"x26" CLEAR INSIDE DIMENSION. DUCT LINER EQUAL TO INDUSTRIAL NOISE CONTROL ACOUSTIC DUCTLINER.
- 03 RELOCATE VAV BOX TO CORRIDOR CEILING SPACE. HOLD SOUTH EDGE OF BOX TIGHT TO CORRIDOR WALL TO PROVIDE MAXIMUM MAINTENANCE ACCESS TO VAV BOX CONTROLLER.

Portland International Jetport
1001 Westbrook Street
Portland, Maine 04102

Gensler

nest ASSOCIATES, INC.
engineers • architects • surveyors • construction managers

amec

343 Gorham Road, South Portland ME 04106
P: (207) 761-1770 F: (207) 774-1246 www.amec.com

2020 K Street, NW
Suite 200
Washington, DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	PWZ	RHB
03	12/03/08	PWZ	RHB
04	01/23/09	PWZ	RHB
05	10/26/09	PWZ	RHB
2	06 11/12/09	PWZ	RHB
07	09/01/11	PWZ	RHB

GENERAL NOTES

- A SEE SHEET M00.00 FOR LEGEND AND GENERAL NOTES.
- B SUPPLY DUCTWORK SHALL BE SMACNA 10 INCH PRESSURE CLASS FROM AIR HANDLER OUTLET CONNECTIONS TO THE FAN POWERED VAV BOXES IN ALL AREAS AND TO THE SUPPLY REGISTERS AND GRILLES IN THE BAGGAGE HANDLING SPACE. RETURN DUCTWORK SHALL BE SMACNA 10 INCH PRESSURE CLASS FROM THE INLET OPENINGS TO THE AIR HANDLER CONNECTIONS.
- C ALL NON-LINED DUCTWORK ON THIS SHEET SHALL BE INSULATED PER SPECIFICATIONS.


Project Name
PJM Terminal Enhancement

Project Number
08.6395.000
CAD File Name
T:\6330101\Sheets\M04.04.05.dwg


Description
MECHANICAL DUCTWORK PLAN - LEVEL 4 - ZONE 5

Scale
1/8" = 1'-0"

Ref. North

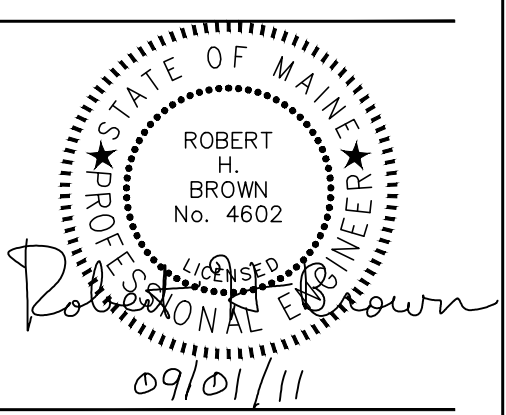

KEY PLAN

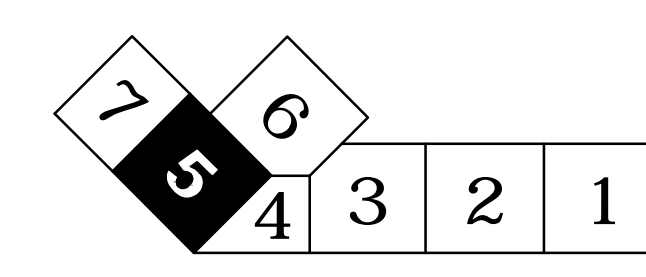

MECHANICAL DUCTWORK PLAN - LEVEL 4 - ZONE 5
SCALE: 1/8" = 1'-0"