


SHEET NOTES

- EOD INDICATES EDGE OF DECK.
- D1 INDICATES DIRECTION OF SPAN OF ROOF DECKING. FLOOR DECK TO BE 6" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK REINFORCED WITH 6X6-W2.1WZ.1 W/ 3/4 5/8" DIAMETER WELD PATTERN AND (2) WELDED SIDE LAP CONNECTIONS PER SPAN. SEE GENERAL NOTES.
- INDICATES LOCATION OF MOMENT CONNECTION CAPABLE OF DEVELOPING THE FULL MOMENT CAPACITY OF THE FLEXURAL ELEMENT.
- KB INDICATES LOCATION OF KNEE BRACING BELOW. SEE FRAMING ELEVATIONS.
- INDICATES LOCATION OF DIAGONAL BRACING BELOW. SEE FRAMING ELEVATIONS.
- 12K (EXAMPLE) INDICATES TOTAL VERTICAL END REACTION IN KIPS (LRF/FACTORED) FOR STEEL TO STEEL CONNECTION DESIGN.
- 20K(H) (EXAMPLE) INDICATES TOTAL HORIZONTAL END REACTION IN KIPS (LRF/FACTORED) FOR STEEL TO STEEL CONNECTION DESIGN.
- MA (EXAMPLE) INDICATES MOMENT CONNECTION- SEE MOMENT SCHEDULE ON SHEET S02.03.04.
- (SL) INDICATES SLOPED BEAM.
- WXXXXX INDICATES BEAM WITH TOP OF STEEL ELEVATION = 86'-1 1/4"
- (E) INDICATES EXISTING.
- WB INDICATES WBx31

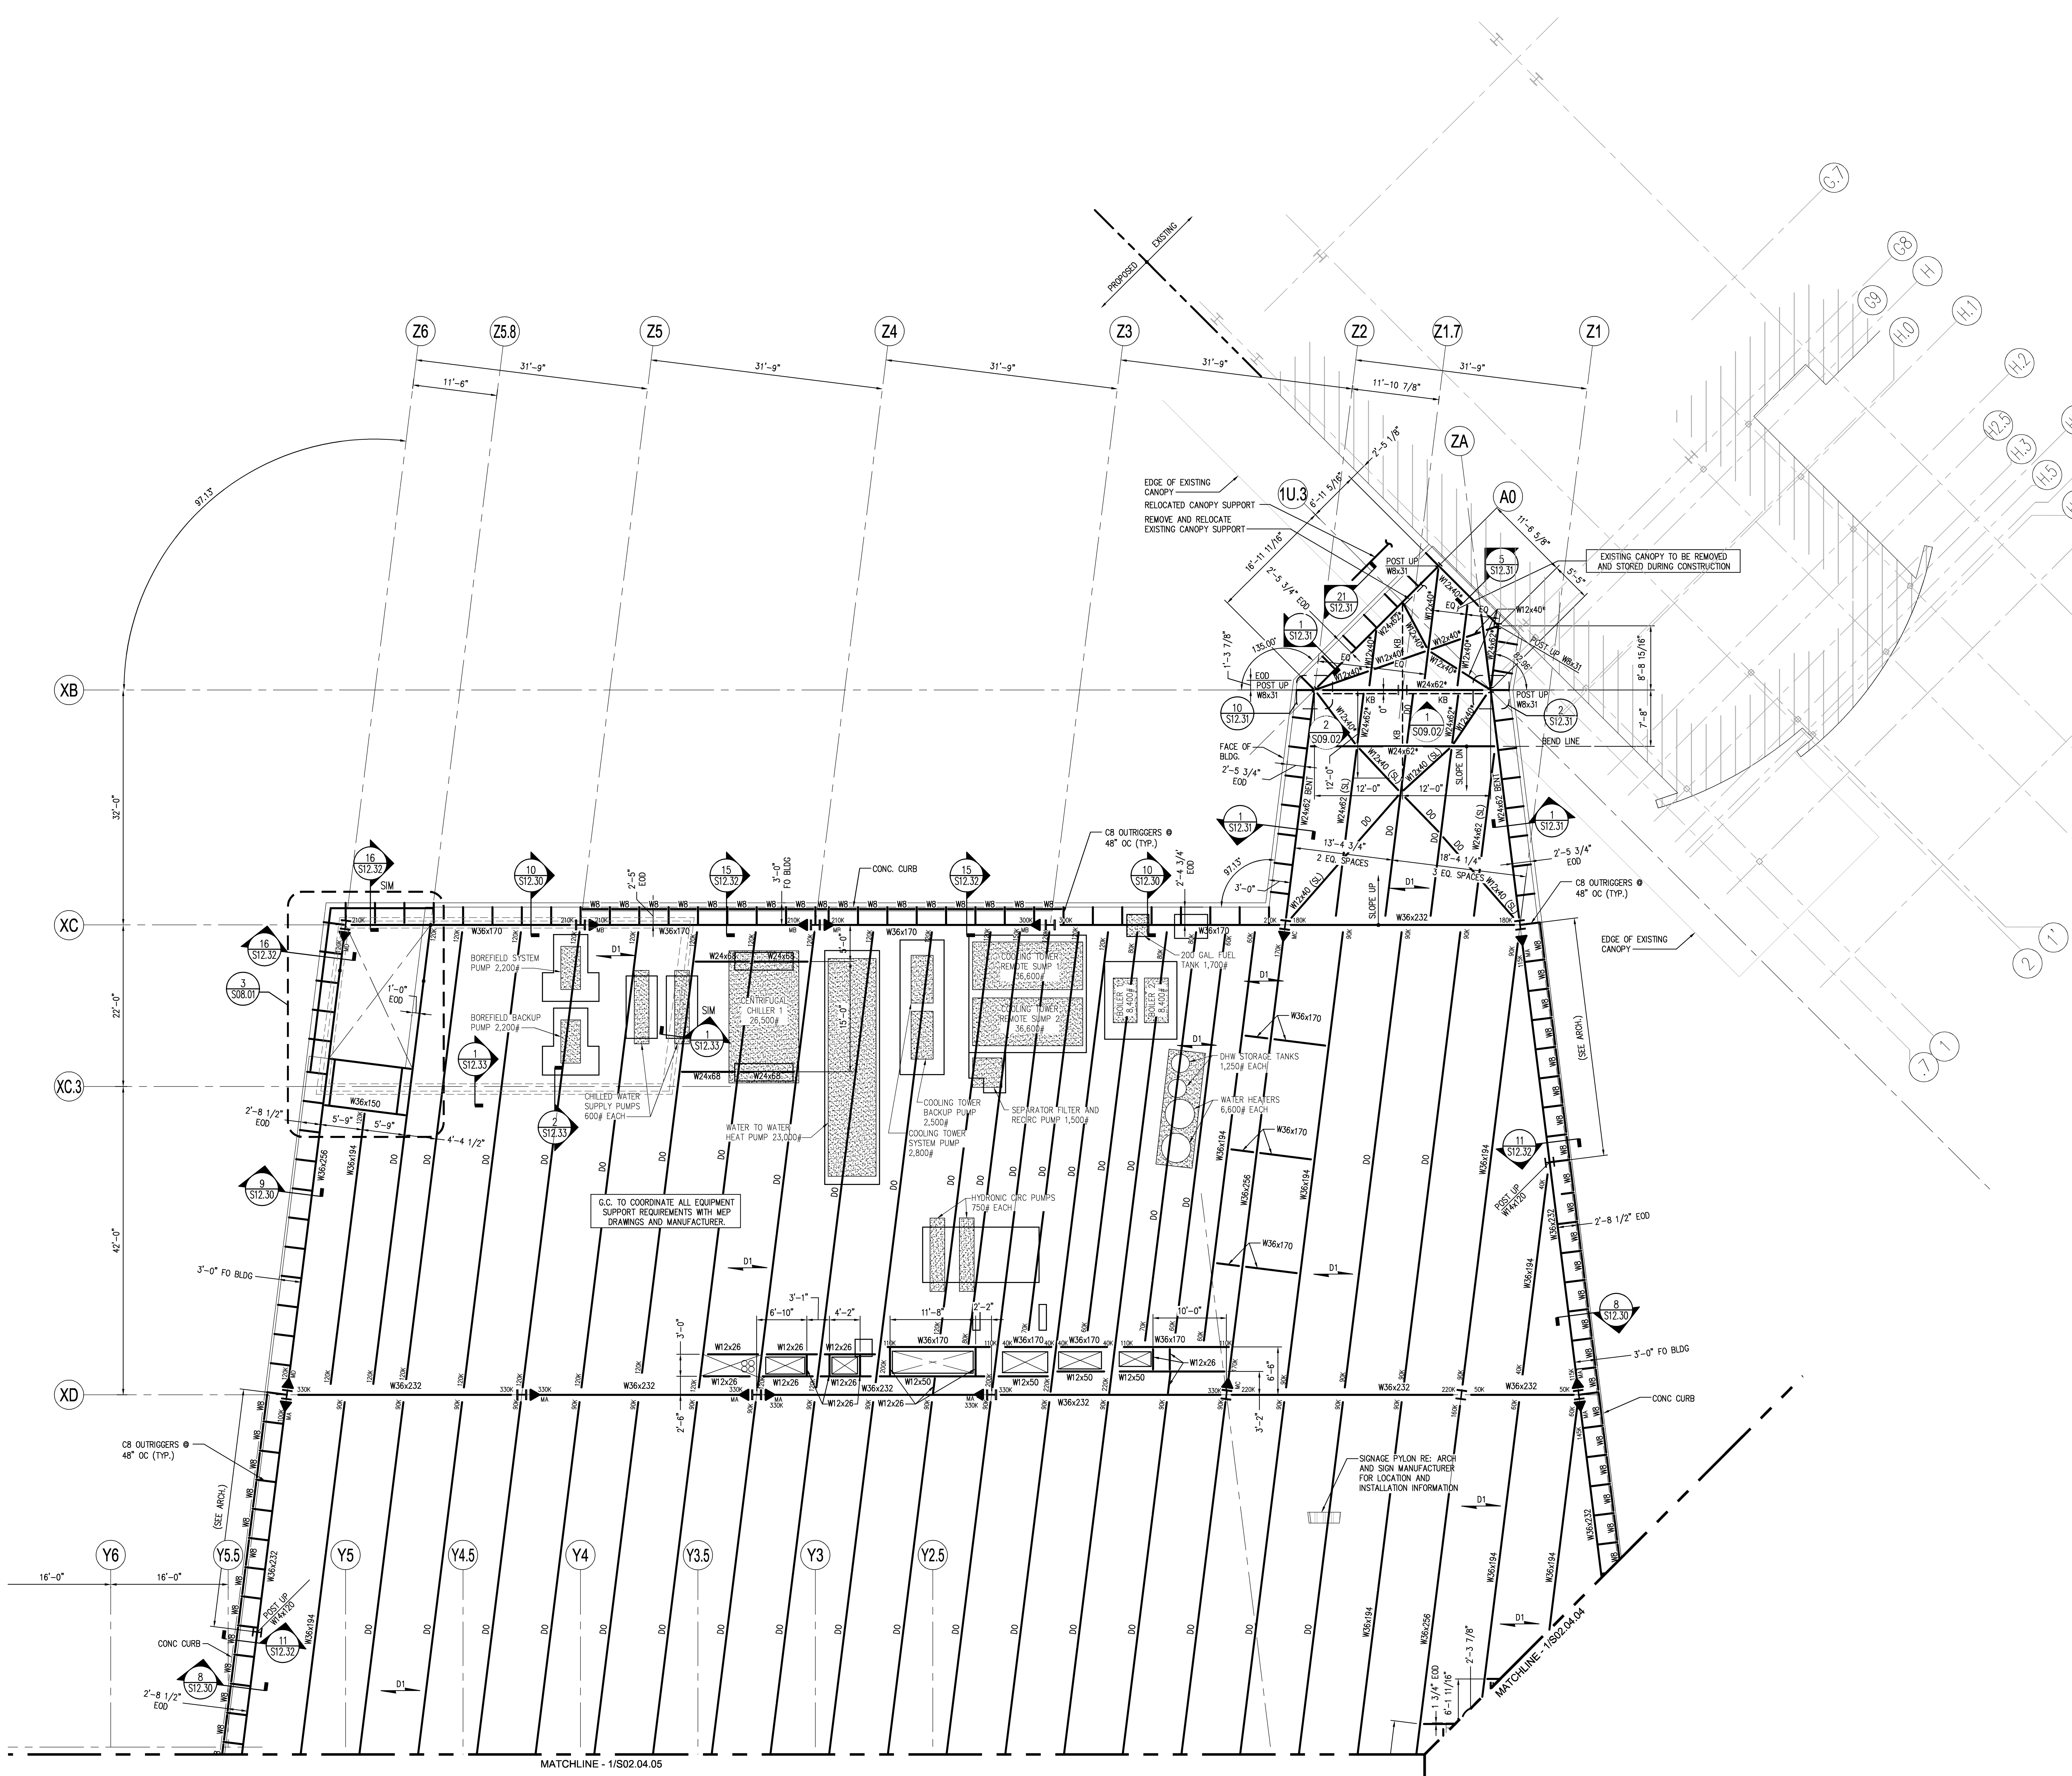


THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check
01	07/11/08	JDE	
02	09/22/08	JDE	
03	12/03/08	JDE	
04	01/23/09	JDE	
05	10/26/09	JDE	
06	11/12/09	JDE	
07	01/12/10	JDE	
08	02/03/10	JDE	
09	02/06/10	JDE	
10	05/03/10	JDE	
11	05/21/10	JDE	
12	08/26/10	JDE	
145	09/01/11	JDE	

GENERAL NOTES

1. ALL EXISTING CONDITIONS SHALL BE VERIFIED IN THE FIELD PRIOR TO BEGINNING OF ANY WORK. IF EXISTING FIELD CONDITIONS DO NOT PERMIT THE INSTALLATION OF THE WORK IN ACCORDANCE WITH THE DETAILS AS SHOWN, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY AND PROVIDE A SKETCH OF THE CONDITION WITH PROPOSED MODIFICATION FOR REVIEW BY ARCHITECT.
2. GENERAL CONTRACTOR TO CONFIRM ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO START OF WORK.
3. FINISHED FLOOR ELEVATION = VARIES: SEE ARCH TOP OF STEEL ELEVATION = (+) 85'-8 3/4" UNLESS NOTED OTHERWISE.
4. FRAMING NOT SPECIFICALLY DIMENSIONED SHALL BE ASSUMED EQUALLY SPACED.
5. SEE SHEET S00.00 FOR GENERAL STRUCTURAL NOTES AND DESIGN LOADS.
6. DIMENSIONS IN PARENTHESIS ARE FOR REFERENCE ONLY.
7. ALL FLOOR FRAMING MEMBERS SHALL BE PROPERLY BRACED BY THE CONTRACTOR UNTIL THE STRUCTURAL FLOOR DIAPHRAGM HAS BEEN COMPLETELY CONSTRUCTED.
8. CONTRACTOR SHALL COORDINATE ALL FLOOR OPENINGS WITH MECHANICAL DRAWINGS. ALL FLOOR OPENINGS LARGER THAN 10' DIAMETER OR SQUARE SHALL BE SUPPORTED ON FRAME (SEE SHEET S12.04). ANY OPENING NOT SHOWN ON THIS DRAWING SHALL NOT BE CONSTRUCTED WITHOUT THE ARCHITECT'S APPROVAL.
9. METAL STUD GAGES SHALL BE SELECTED BASED ON THE STUD DEPTHS SHOWN ON THE ARCHITECTURAL PLANS. WIND LOAD = 35 PSF, AND MAXIMUM DEFLECTION OF 1/360 OR 0.3" @ BRICK VENEER, 1/260 FOR PANEL WALL - VERTICAL DEFLECTION CLIPS FOR ALL STUDS ATTACHING TO BEAMS.
10. FLOOR SLABS AT THIS LEVEL SHALL BE INSTALLED WITH RADIANT HEAT. COORDINATE W/ ARCH & MECH DWGS.

KEY PLAN

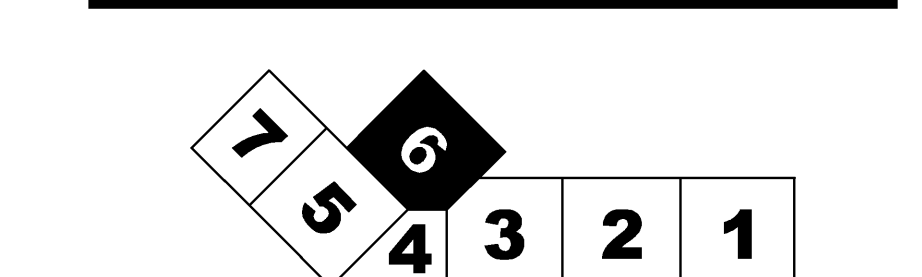

FRAMING PLAN - LEVEL 4 - ZONE 6
SCALE: 1/8" = 1'-0"

Signature: _____

Project Name: PWM Terminal Enhancement

Project Number: 08.6395.000
CAD File Name: T:\5330101\SHEETS\S02.04.06.DWG
Description: FRAMING PLAN - LEVEL 4 - ZONE 6

Scale: 1/8" = 1'-0"

S02.04.06

©2009 Gensler