

**SHEET NOTES**

- F.S. INDICATES FOOTING STEP, SEE DETAIL ON SHEET S12.01.
- TOP X'-X" (EXAMPLE) INDICATES TOP OF FOOTING ELEVATION, G.C. VERIFY COORDINATE WITH FINAL GRADES. ALL BOTTOM OF FOOTING ELEVATIONS ARE (-) 4'-0" (MIN.) BELOW FINISHED GRADE.
- TOW X'-X" (EXAMPLE) INDICATES TOP OF WALL. TOW VARIES SEE DETAILS & COORDINATE W/ ARCH DWGS.
- TOP X'-X" (EXAMPLE) INDICATES TOP OF PIER, TOP TO BE 0'-8" (U.N.O.)
- PXX INDICATES PIER TYPE, SEE SCHEDULE ON SHEET S02.01.04
- FXX INDICATES FOOTING TYPE, SEE SCHEDULE ON SHEET S02.01.04
- (E) INDICATES EXISTING.
- COORDINATE DIMENSION W/ REVOLVING DOOR MANUFACTURER, VERIFY W/ ARCHITECT.
- INDICATES SLAB PITCH
- INDICATES FLOOR DRAIN, SEE ARCH. & MECH DWGS.
- H.P. INDICATES HIGH POINT OF FLOOR SLAB, SEE ARCH. & MEP DRAWINGS FOR REQUIREMENTS.
- L.P. INDICATES LOW POINT OF FLOOR SLAB, SEE ARCH. & MEP DRAWINGS FOR REQUIREMENTS.

**Portland International Jetport**  
 1001 Westbrook Street  
 Portland, Maine 04102

**Gensler** 2020 K Street, NW  
 Suite 200  
 Washington, DC 20006  
 Telephone 202.721.5200  
 Facsimile 202.872.8587

**oest ASSOCIATES, INC.**  
 343 Gorham Road, South Portland, ME 04106 P: (207) 761-1770 F: (207) 774-1246 www.oest.com  
 engineers • architects • surveyors • construction managers

**amec**  
 343 Gorham Road, South Portland ME 04106  
 P: (207) 761-1770 F: (207) 774-1246 www.amec.com


SEE SHEET S02.01.04 FOR ADDITIONAL INFORMATION NOT SHOWN ON THIS SHEET.

**GENERAL NOTES**

1. ALL EXISTING CONDITIONS SHALL BE VERIFIED IN THE FIELD PRIOR TO BEGINNING OF ANY WORK. IF EXISTING FIELD CONDITIONS DO NOT PERMIT THE INSTALLATION OF THE WORK IN ACCORDANCE WITH THE DETAILS AS SHOWN, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY AND PROVIDE A SKETCH OF THE CONDITION WITH PROPOSED MODIFICATION FOR REVIEW BY ARCHITECT.
2. CONTRACTOR TO CONFIRM ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO START OF WORK.
3. SEE SHEET S00.00 FOR GENERAL STRUCTURAL NOTES AND DESIGN LOADS.
4. SEE SHEET S12.01 FOR TYPICAL FOUNDATION DETAILS.
5. CONTRACTOR SHALL COORDINATE ALL FLOOR OPENINGS WITH MECHANICAL DRAWINGS.
6. AT ALL LOCATIONS WHERE PIPING RUNS BENEATH CMU OR CONCRETE WALLS, DEEPEN FOOTINGS AS REQUIRED TO ALLOW 6" (MIN) CLEARANCE BETWEEN PIPE AND FOOTING.
7. CONTRACTOR SHALL SUBMIT LAY-OUT FOR SLAB ON GRADE CONSTRUCTION AND CONTRACTION JOINTS TO THE STRUCTURAL ENGINEER FOR APPROVAL PRIOR TO PLACING CONCRETE.
8. SEE ARCH DWGS FOR DEPRESSED SLAB LOCATIONS AND DEPTHS.
9. PROVIDE (2) #3 x 4'-0" LONG REINFORCING BARS AT ALL RE-ENTRANT SLAB CORNERS, SEE DETAILS ON SHEET S12.01.
10. ALL FOOTINGS TO BE CENTERED ON COL. ORD LINE (U.N.O.).
11. FLOOR SLABS AT THIS LEVEL SHALL BE INSTALLED WITH RADIANT HEAT. COORDINATE W/ ARCH & MECH DWGS.
12. SEE ARCH DWGS FOR WATERPROOFING AND INSULATING REQUIREMENTS AND LOCATIONS.
13. PER GEOTECHNICAL REPORT BY HALEY & ALDRICH (H&A FILE NO. 35024-001 DATED 11 NOVEMBER 2008) FOUNDATIONS HAVE BEEN DESIGNED FOR A MAXIMUM ALLOWABLE BEARING PRESSURE OF 3000 PSF. CONTRACTOR SHALL ALLOW OWNER'S GEOTECHNICAL ENGINEER TO OBSERVE SUBGRADE CONDITIONS TO CONFIRM BEARING CAPACITY PRIOR TO PLACEMENT OF FORMS OR REINFORCING STEEL.
14. DIMENSIONS IN PARENTHESIS FOR REFERENCE ONLY.
15. EXISTING BUILDING INFORMATION USED TO PREPARE PLANS OF THIS AREA WERE TAKEN FROM AS-BUILT DRAWINGS PREPARED BY PUDA DATED SEPTEMBER 2006.
16. REFERENCE S02.01.00, AND SPECIFICATION SECTION 334600 FOR UNDERSLAB DRAINAGE REQUIREMENTS.
17. OVER-EXCAVATION/REPLACEMENT OF UNSUITABLE SOILS MAY BE REQUIRED BELOW FOUNDATION BEARING LEVELS; SEE SHEET S00.00 AND SPECIFICATION SECTION 312000 FOR ADDITIONAL INFORMATION.

THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date	Issue Description	By	Check
01	05/03/10	BULLETIN #10	JDE	--
145	09/01/11	ISSUED FOR CONSTRUCTION	JDE	--

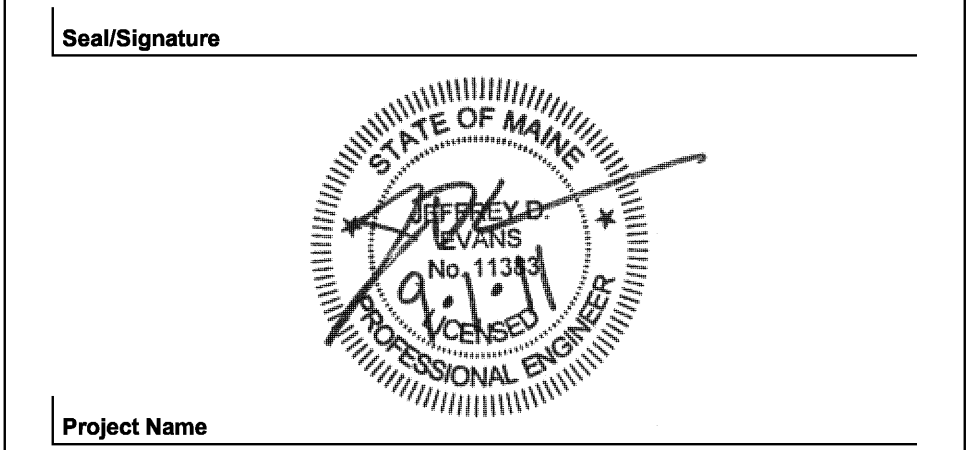

Project Name: PWM Terminal Enhancement  
 Project Number: 08.6395.000  
 CAD File Name: T:\5330101\5330101\SHEETS\S08.02.DWG  
 Description: ENLARGED FOUNDATION PLAN - LEVEL 1&2 - ZONE 4

**KEY PLAN**

