


KEYED NOTE:

73/4" NG DN FACE OF BUILDING. TIE INTO EXISTING NG SUPPLY

PRESSURE REDUCING STATION

DOWNSTREAM OF METER/

- (1) COORDINATE RTU LOCATION AND CURB OPENINGS WITH STRUCTURAL PLANS
- 2 RISE SA/RA UP THROUGH ROOF OPENING TO RTU-1 MOUNTED ON ROOF.

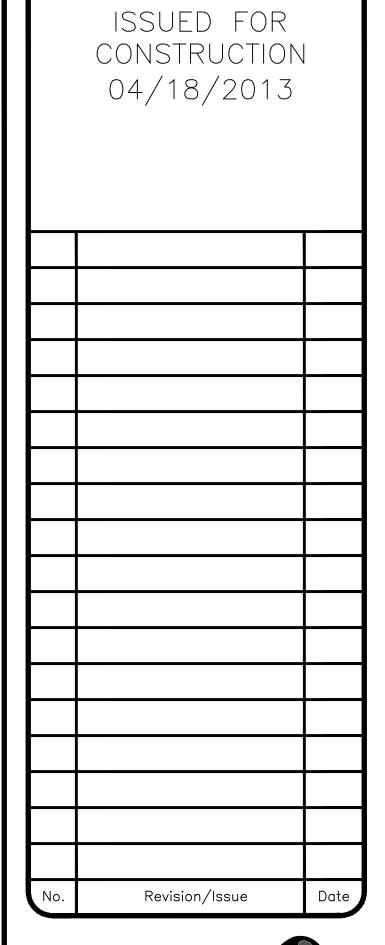

General Notes



511 Congress St., Suite 200, Portland ME 04101 P: (207) 775-5401 F: (207) 772-4762 www.amec.com




Facilities & Engineering 1001 Westbrook ST Portland, ME 04102 207-874-8877


Project Name and Address

TAXI CAB

STEVEN M.

HVAC PLANS

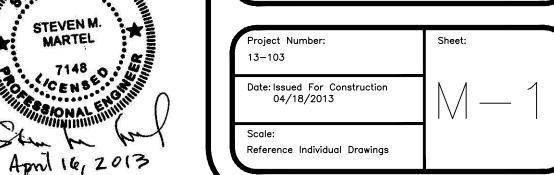


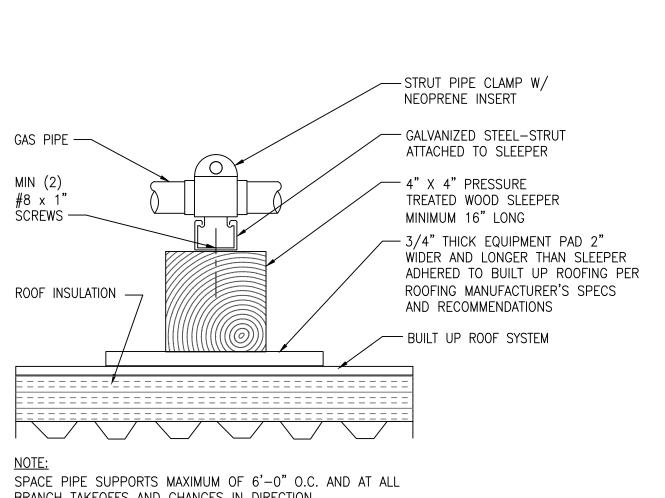


SPACE PIPE SUPPORTS MAXIMUM OF 6'-0" O.C. AND AT ALL BRANCH TAKEOFFS AND CHANGES IN DIRECTION.

ROOF MOUNTED (A7) GAS PIPE SUPPORT DETAIL

NOT TO SCALE

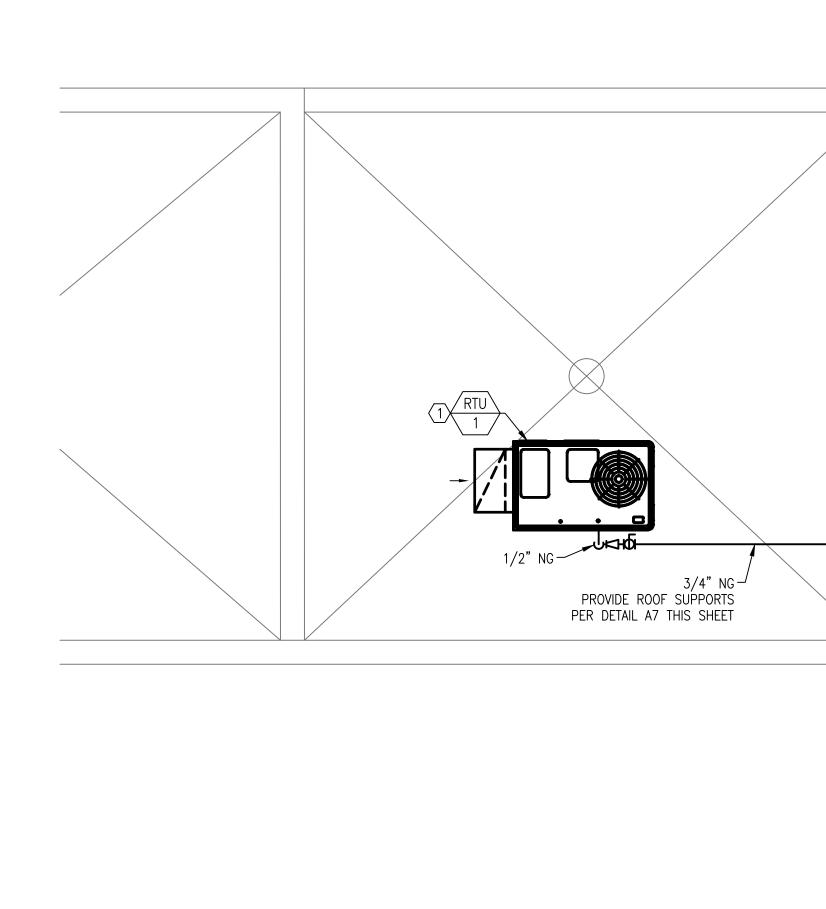

G8 TAXI SHELTER HVAC ROOF PLAN

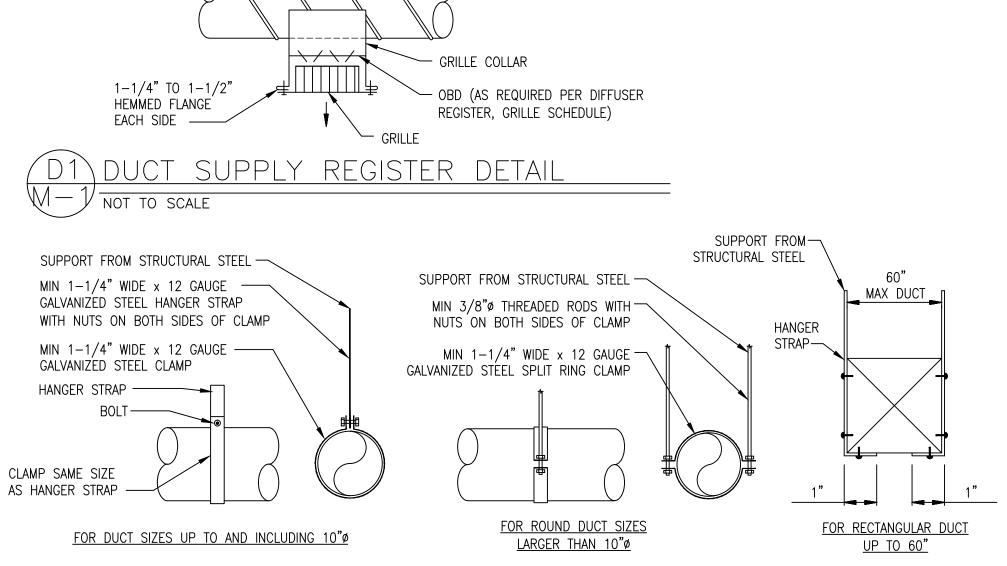

1. ALL HARDWARE SHALL BE NON-CORROSIVE STEEL 2. SIZE & RATING OF HANGERS & SUPPORTS SHALL BE PER LATEST "SMACNA" STANDARDS

(A1) DUCT HANGER ATTACHMENT DETAIL

NOT TO SCALE