


Portland Setport Tower

not to scale

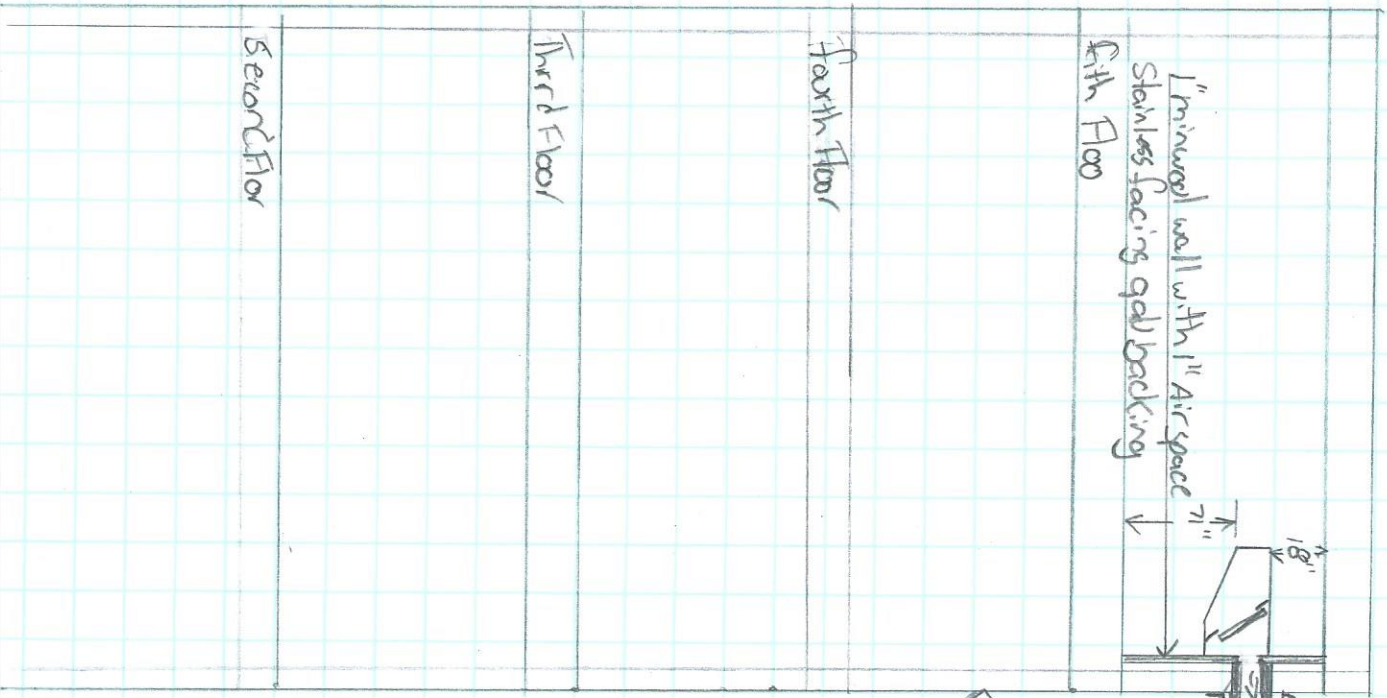

Fifth Floor
 1/2" stainless steel facing and backing
 1/8" Air space

Fourth Floor

Third Floor

Second Floor

Wall curbs bolted to metal building

Exhaust Fan

16ga steel grease duct work
(Duct wrap in 3m grease duct wrap)

Steel building

Bourgoin + Sons LLC
 Dan Bourgoin
 749-1878
 danbourgoin@gmail.com