

ARCHITECTURE 144 Fore Street P.O. Box 618
 Portland, Maine 04104
 Tel: (207) 772-3846
 Fax: (207) 772-1070
 www.smrinc.com

SMART
 ENGINEERING
 PLANNING
 INTERIORS
 ENERGY

SMRT PROJECT NO. 17033
 PROJECT MGR. JCDRAWN
 AE OF RECORD
 DRW. CDS
 DIT

ISSUED FOR CONSTRUCTION	12/21/17	DATE
STATUS	BY: 0	REV.
THIS PLAN SHALL NOT BE MODIFIED WITHOUT WRITTEN PERMISSION FROM SEBAGO TECHNICALS, INC. ALL BE AT THE USER'S RISK AND WITHOUT LIABILITY TO SEBAGO TECHNICALS, INC.		


SEBAGO TECHNICALS
 WWW.SEBAGOTECHNICALS.COM
 75 John Roberts Rd., Suite 1A
 South Portland, ME 04086
 Tel: 207-200-2100
 Tel: 207-783-6868

PROJECT NO. | FIELD BOOK | DESIGN | CHKD | DRAWN

2ND FLOOR - SYSTEMS PLAN
 OF:
**PORTLAND INTERNATIONAL JETPORT
 VERTICAL CIRCULATION IMPROVEMENTS**
 1001 WESTBROOK STREET
 PORTLAND, MAINE 04102

DATE	SCALE
10-27-17	1/8" = 1'-0"

2.EY102

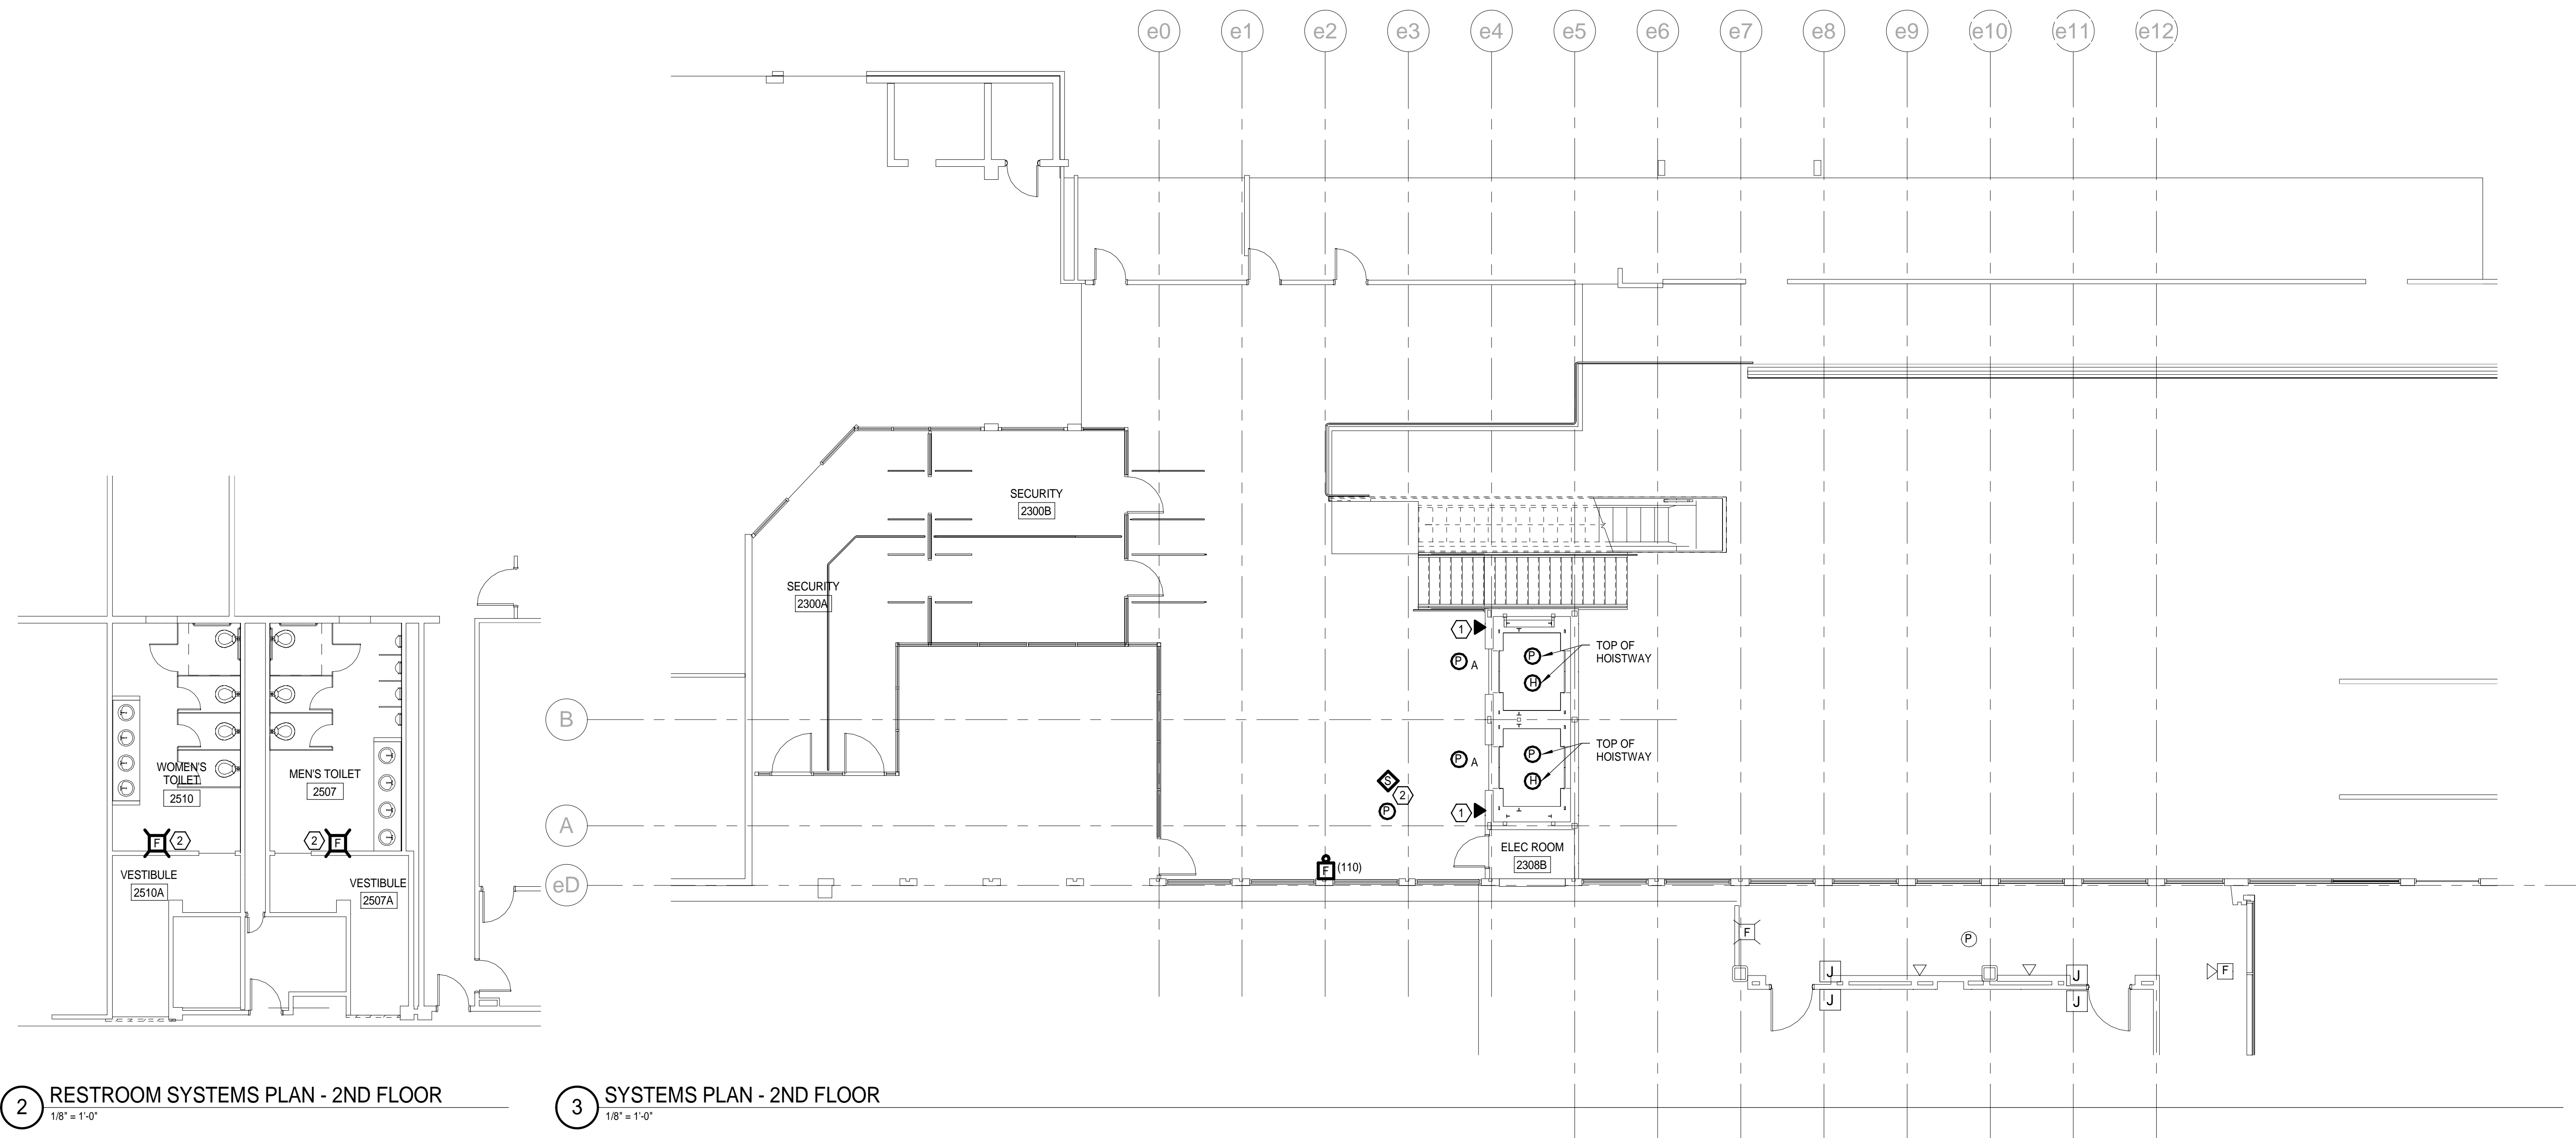

2 RESTROOM SYSTEMS PLAN - 2ND FLOOR
 1/8" = 1'-0"

3 SYSTEMS PLAN - 2ND FLOOR
 1/8" = 1'-0"

KEYED NOTES:

- 1 PROVIDE DEDICATED PHONE LINE FOR EACH ELEVATOR. COORDINATE WITH OWNER FOR LOCATION TO GET PHONE WIRING FROM.
- 2 RELOCATE FIRE ALARM STROBE AND SPEAKER FROM LOCATION SHOWN ON 2.ED101 TO NEW LOCATION SHOWN. EXTEND EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW DEVICE LOCATIONS.

NOTES:

- 1. SEE SHEET 2.E-001 FOR LEGEND AND GENERAL NOTES.
- 2. EXTEND EXISTING SIMPLEX FIRE ALARM SYSTEM TO NEW INITIATING AND NOTIFICATION DEVICES SHOWN. PROVIDE ALL DEVICES, BACK BOXES, COMPLETE AND OPERABLE SYSTEM. ACTIVATION OF HEAT DETECTORS IN ELEVATOR PIT OR HOISTWAY TO DE-ENERGIZE SHUNT TRIP COIL FOR ELEVATOR CIRCUIT BREAKERS.

