


GENERAL NOTES

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.

KEYNOTE	KEYNOTE DESCRIPTION
1	BALANCE RELOCATED DIFFUSERS TO PROVIDE EQUAL AIRFLOW AT PRE-CONSTRUCTION TAB OF DIFFUSORS RELOCATED.
2	12X10 OED WITH 1/2" WMS.
3	PROVIDE REMOTE SENSOR AT TOP OF ELEVATOR SHAFT.
4	LOCATE THERMOSTAT IN LOCK BOX. CONFIRM EXACT LOCATION WITH OWNER. THERMOSTAT TO CONTROL UNIT BASED ON TEMPERATURE DETECTED BY REMOTE SENSOR AT TOP OF SHAFT.
5	COORDINATE EXACT LOCATION OF ITEMS IN ELEVATOR SHAFT WITH ELEVATOR EQUIPMENT MANUFACTURER TO ENSURE UNOBSTRUCTED OPERATION OF ELEVATOR.
6	RELOCATED EXISTING RGD INTO NEW CEILING GRID.
7	CONNECT TO EXISTING DUCT CONNECTIONS AND TRANSITION AT GRILLE AS REQUIRED. BALANCE TO AIR FLOW DETERMINED DURING PRE-CONSTRUCTION TAB.
8	CONNECT NEW 3/4" HWS/R TO EXISTING PROVISIONS PROVIDED UNDER DEMO. PROVIDE WITH NEW CONTROL AND BALANCING VALVES. SEE DETAIL 4M-501.

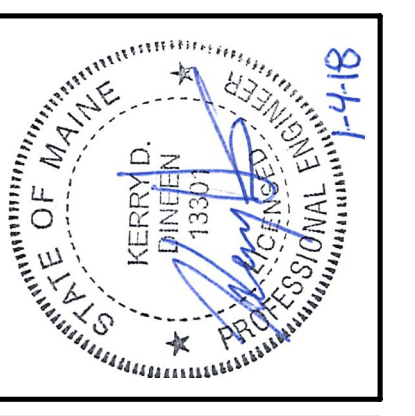

ARCHITECTURE 144 Fore Street P.O. Box 618
 Portland, Maine 04104
 Tel: (207) 775-3646
 Fax: (207) 775-1070
 www.smrtinc.com

ENGINEERING
 INTERIORS
 ENERGY

SMART PROJECT NO. | PROJECT MGR | JC/DRAWN | AE OF RECORD
 17033 | DFL | JC | KOD

ISSUED FOR CONSTRUCTION	DATE: 12/21/17
REV: 0	BY: [Signature]

THIS PLAN SHALL NOT BE MODIFIED WITHOUT WRITTEN PERMISSION FROM SEBAGO TECHNICS, INC. USER'S LIABILITY TO SEBAGO TECHNICS, INC.

SEBAGO TECHNICS


WWW.SEBAGOTECHNICS.COM
 75 John Roberts Rd., Suite 1A
 South Portland, ME 04086
 Tel: (207) 200-2100
 Fax: (207) 785-5660

PROJECT NO. | FIELD BOOK | DESIGN | CHKD | DRAWN


2ND FLOOR HVAC DUCTWORK PLAN
 OF:
 VERTICAL CIRCULATION IMPROVEMENTS
 1001 WESTBROOK STREET
 PORTLAND, MAINE 04102

DATE: 12/21/17
 SCALE: 1/8" = 1'-0"

2.MH102

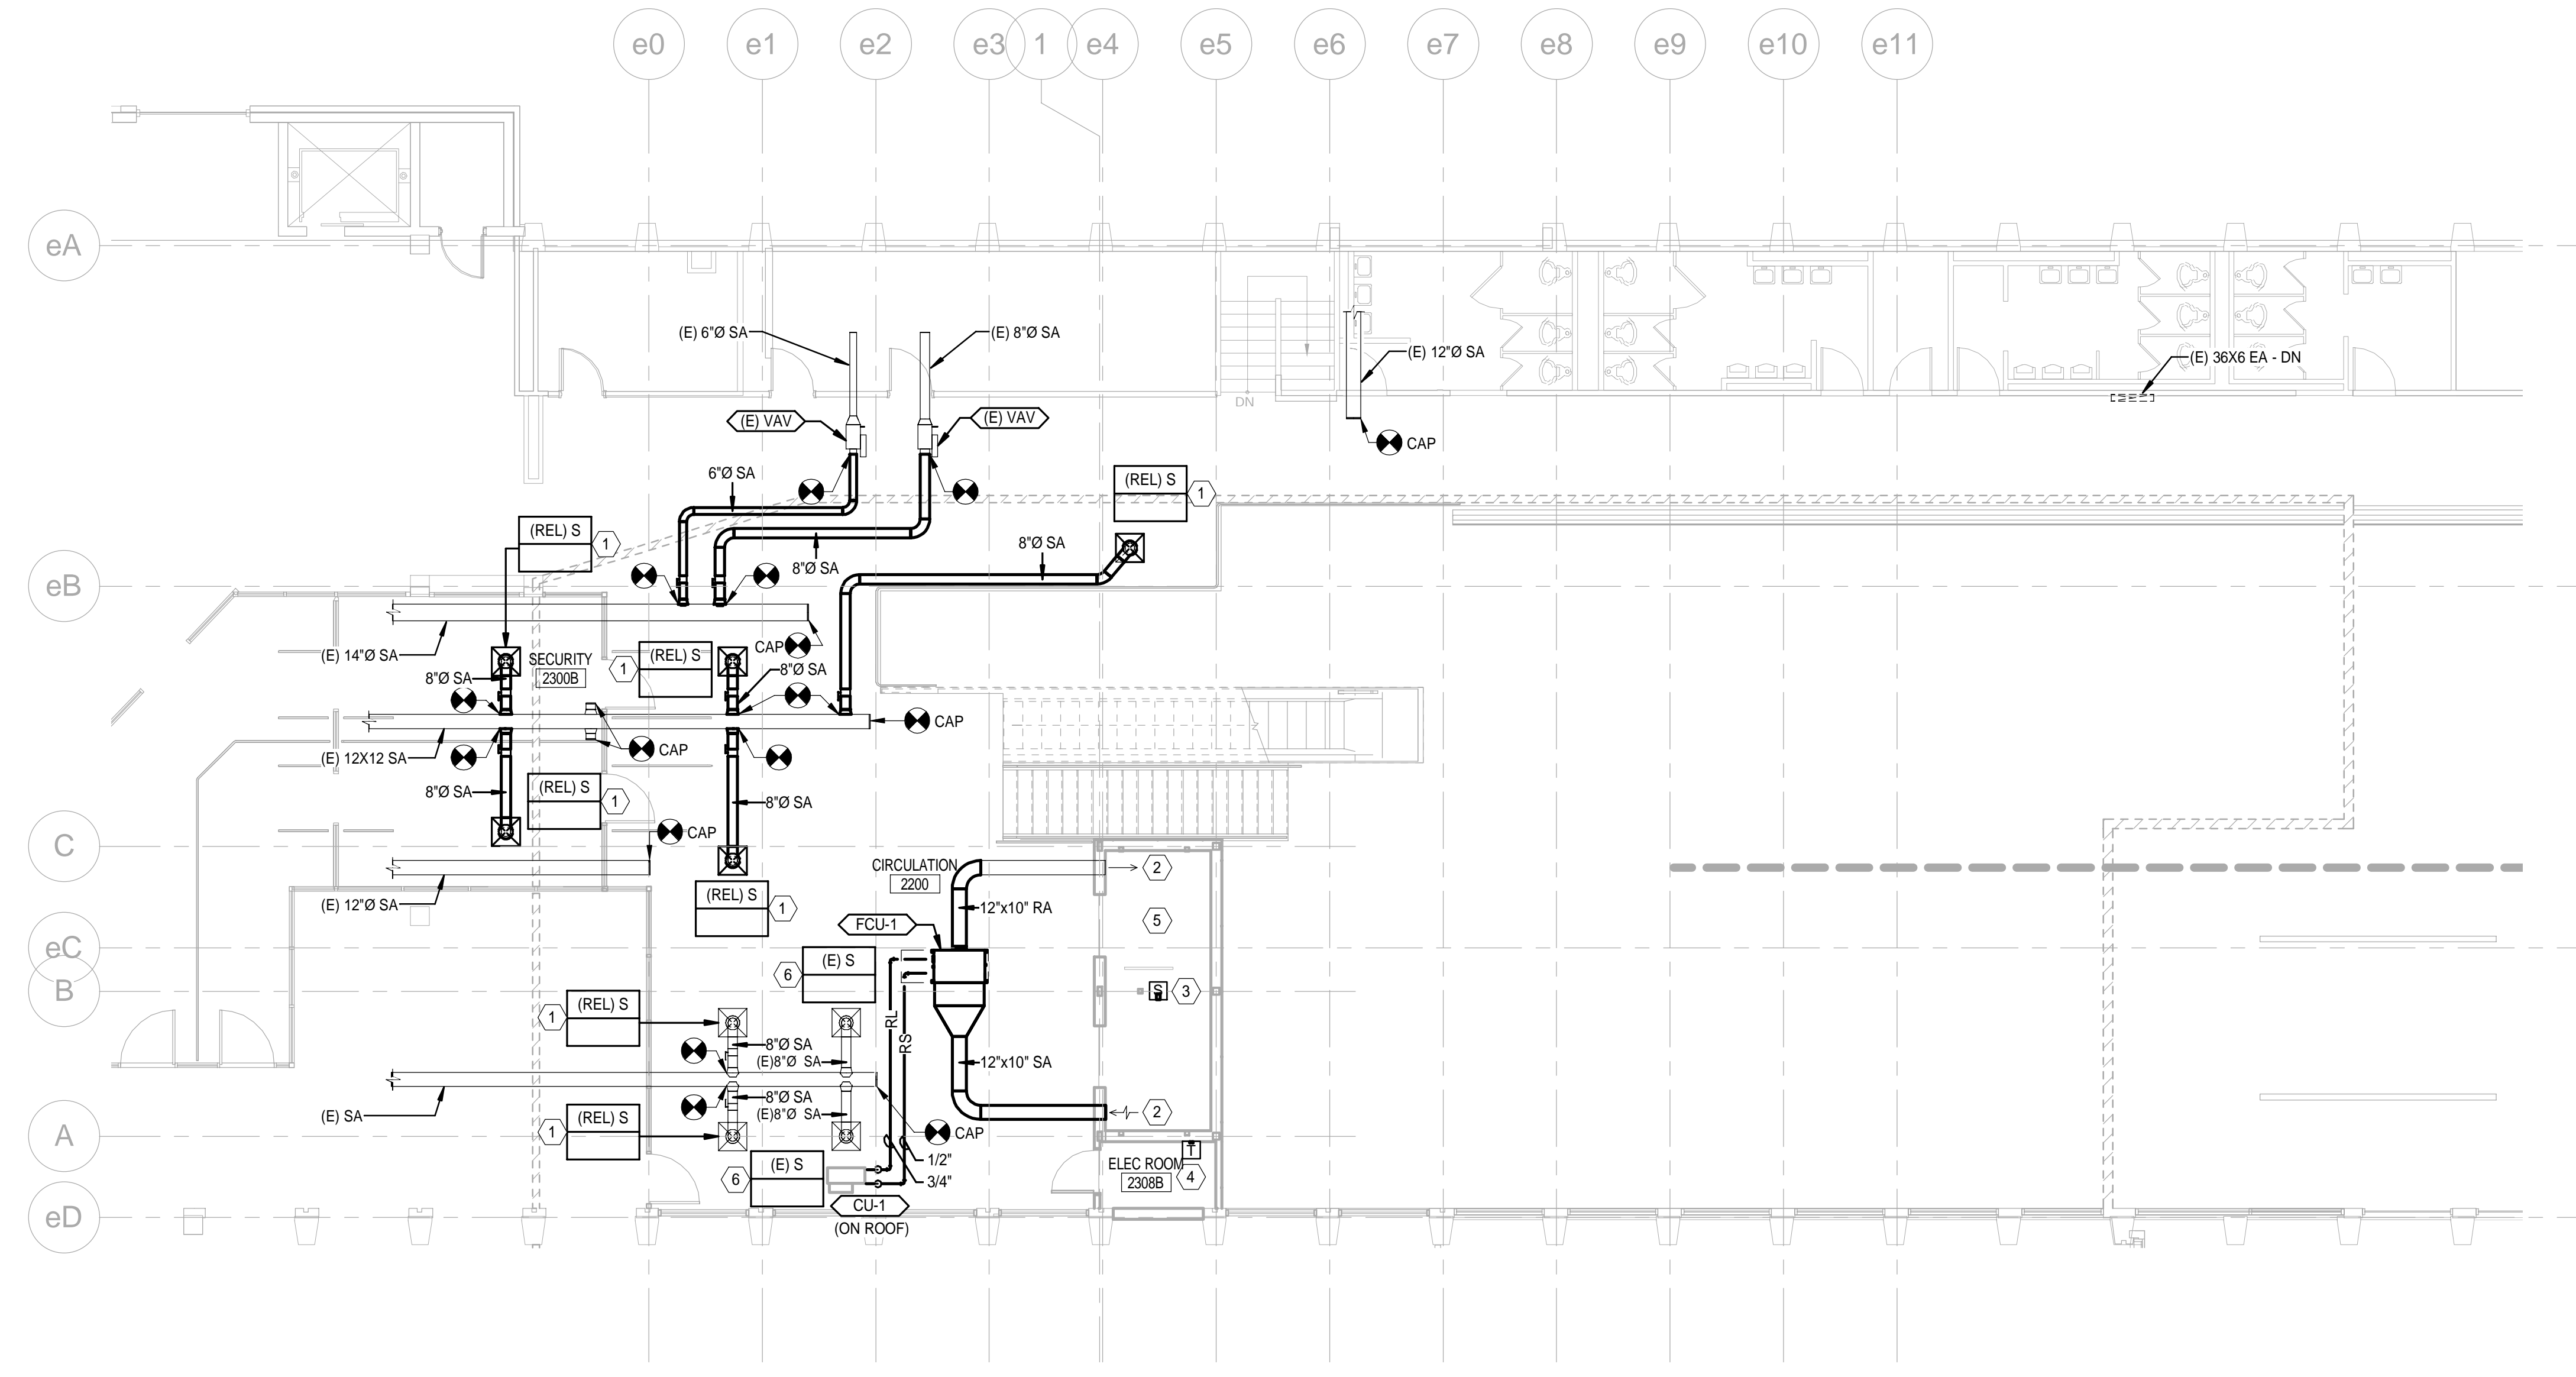

1 2ND FLOOR - HVAC DUCTWORK PLAN
 1/8" = 1'-0"

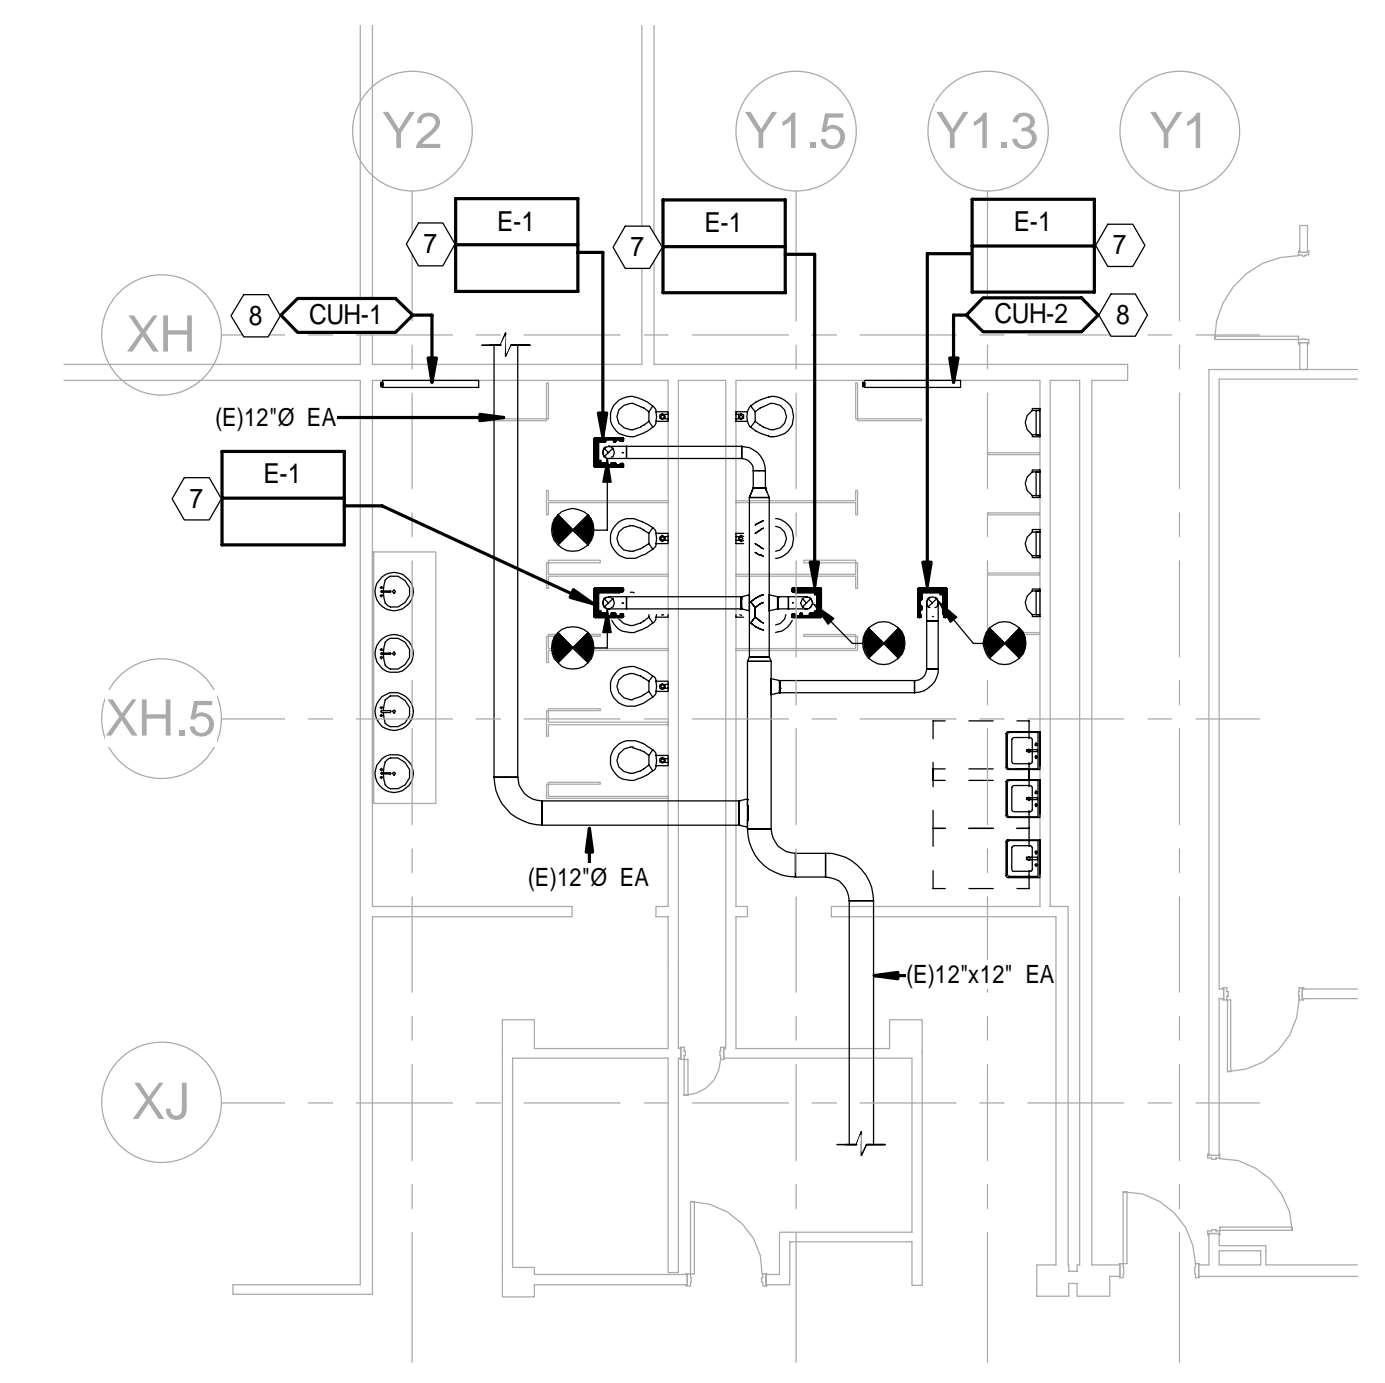

2 2ND FLOOR - HVAC DUCTWORK RESTROOM PLAN
 1/8" = 1'-0"

