

Portland International Jetport

1001 Westbrook Street
Portland, Maine 04102

Gensler

2020 K Street, Northwest
Suite 200
Washington, DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587



SHEET NOTES

- 01 REFER TO ENGINEERING DRAWINGS, E02.SERIES FOR ADDITIONAL INFORMATION.
- 02 ALL OUTLET LOCATIONS TO BE LAID OUT PER APPROVED TSA LANE CONFIGURATIONS. CONFIRM OUTLET TYPES PER APPROVED TSA EQUIPMENT. TYPICAL AT ALL TSA AREAS.
- 03 COORDINATE POWER REQUIREMENTS AND LOCATIONS WITH SECURITY, IT AND FIRE ALARM EQUIPMENT. RE: ENGINEERING DRAWINGS, SS, TC AND FA SERIES FOR ADDITIONAL INFORMATION.
- 04 COORDINATE POWER REQUIREMENTS AND LOCATION FOR ILLUMINATED ADVERTISEMENT WITH VENDOR AND CONFIRM MOUNTING WITH ARCHITECT.
- 05 REFER TO ENGINEERING DRAWINGS FOR POWER AND LIGHTNING PROTECTION REQUIREMENT ON ALL ROOF LEVELS.
- 06 WALKER DUCT, RE: ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 07 SURFACE MOUNTED
- 08 COORDINATE EXACT LOCATION AND POWER REQUIREMENTS. PLACE STUB UP WITHIN PYLONMILLWORK. REFER TO DETAIL SHEET XX.XX
- 09 RECEPTACLES TO BE TERMINATED ABOVE FINISHED CEILING AND NOT VISIBLE TO THE PUBLIC. COORDINATE MOUNTING OF CPU. REFER TO TC.02 SERIES FOR ADDITIONAL INFORMATION.
- 11 COORDINATE IN-WALL AND UNDERSLAB ROUTING FROM ELEC. CLOSET 0516 TO WALKER DUCT. ROUTING SHOWN FOR DIAGRAMMATICAL PURPOSES ONLY. DO NOT RUN CONDUIT IN SLAB, RADIANT FLOORING INSTALLATION IN THIS AREA.

GENERAL NOTES

- A. COORDINATE ALL WALL MOUNTED DEVICES WITH ASSOCIATED PARTITION TYPES AND FIRE RATING REQUIREMENTS. SEE ALIGNMENT LOCATIONS OF DEVICES ON SHEET A00.13.
- B. COORDINATE ALL CEILING MOUNTED DEVICES WITH ASSOCIATED CEILING TYPES, LIGHT FIXTURE AND EQUIPMENT DEPTHS AND ALL REQUIRED SYSTEMS CLEARANCES.
- C. REFER TO EQUIPMENT SCHEDULE IN PROJECT MANUAL SECTION APPENDIX 'A'.
- D. REFER TO ELECTRICAL DRAWINGS FOR OUTLET TYPES.
- E. REFER TO ELECTRICAL, FIRE ALARM, IT AND SECURITY DRAWINGS, PROJECT MANUAL FOR ADDITIONAL INFORMATION.
- F. REFER TO MANUFACTURER AND LOCAL CODE REQUIREMENTS FOR ELEVATOR AND ESCALATOR INSTALLATIONS.
- G. REFER TO ELECTRICAL DRAWINGS FOR GFI OUTLET LOCATIONS.
- H. PROVIDE ELECTRICAL ROUTING AND IT STUB-UP AT TICKET COUNTERS. 1 SET OF STUB UP FOR EVERY 4 COUNTERS. REFER TO ELECTRICAL AND IT DRAWINGS FOR CABLE AND CIRCUIT INFORMATION. SIZE STUB UP ACCORDINGLY.
- I. PROVIDE WEATHER PROOF DEVICES AT LOCATIONS WHERE REQUIRED.
- J. COORDINATE POWER/DATA ROUTING REQUIREMENTS WITH DOOR HARDWARE. RELAY TIE IN WITH FIRE ALARM SYSTEM AS INDICATED OR REQUIRED BY CODE. ALSO REFER TO SECURITY DRAWINGS.
- K. REFER TO PARTITION TYPES FOR ADDITIONAL INFORMATION ON FIRE RATED ASSEMBLIES. FIRESTOPPING SHALL BE PROVIDED AS REQUIRED BY CODE.
- L. COORDINATE ALL FLOOR BOXES, CORE DRILLS AND STUB-UPS, ETC. WITH RADIANT FLOORING LAYOUT AND INSTALLATION. DO NOT RUN CONDUITS WITHIN SLAB.

KEY PLAN

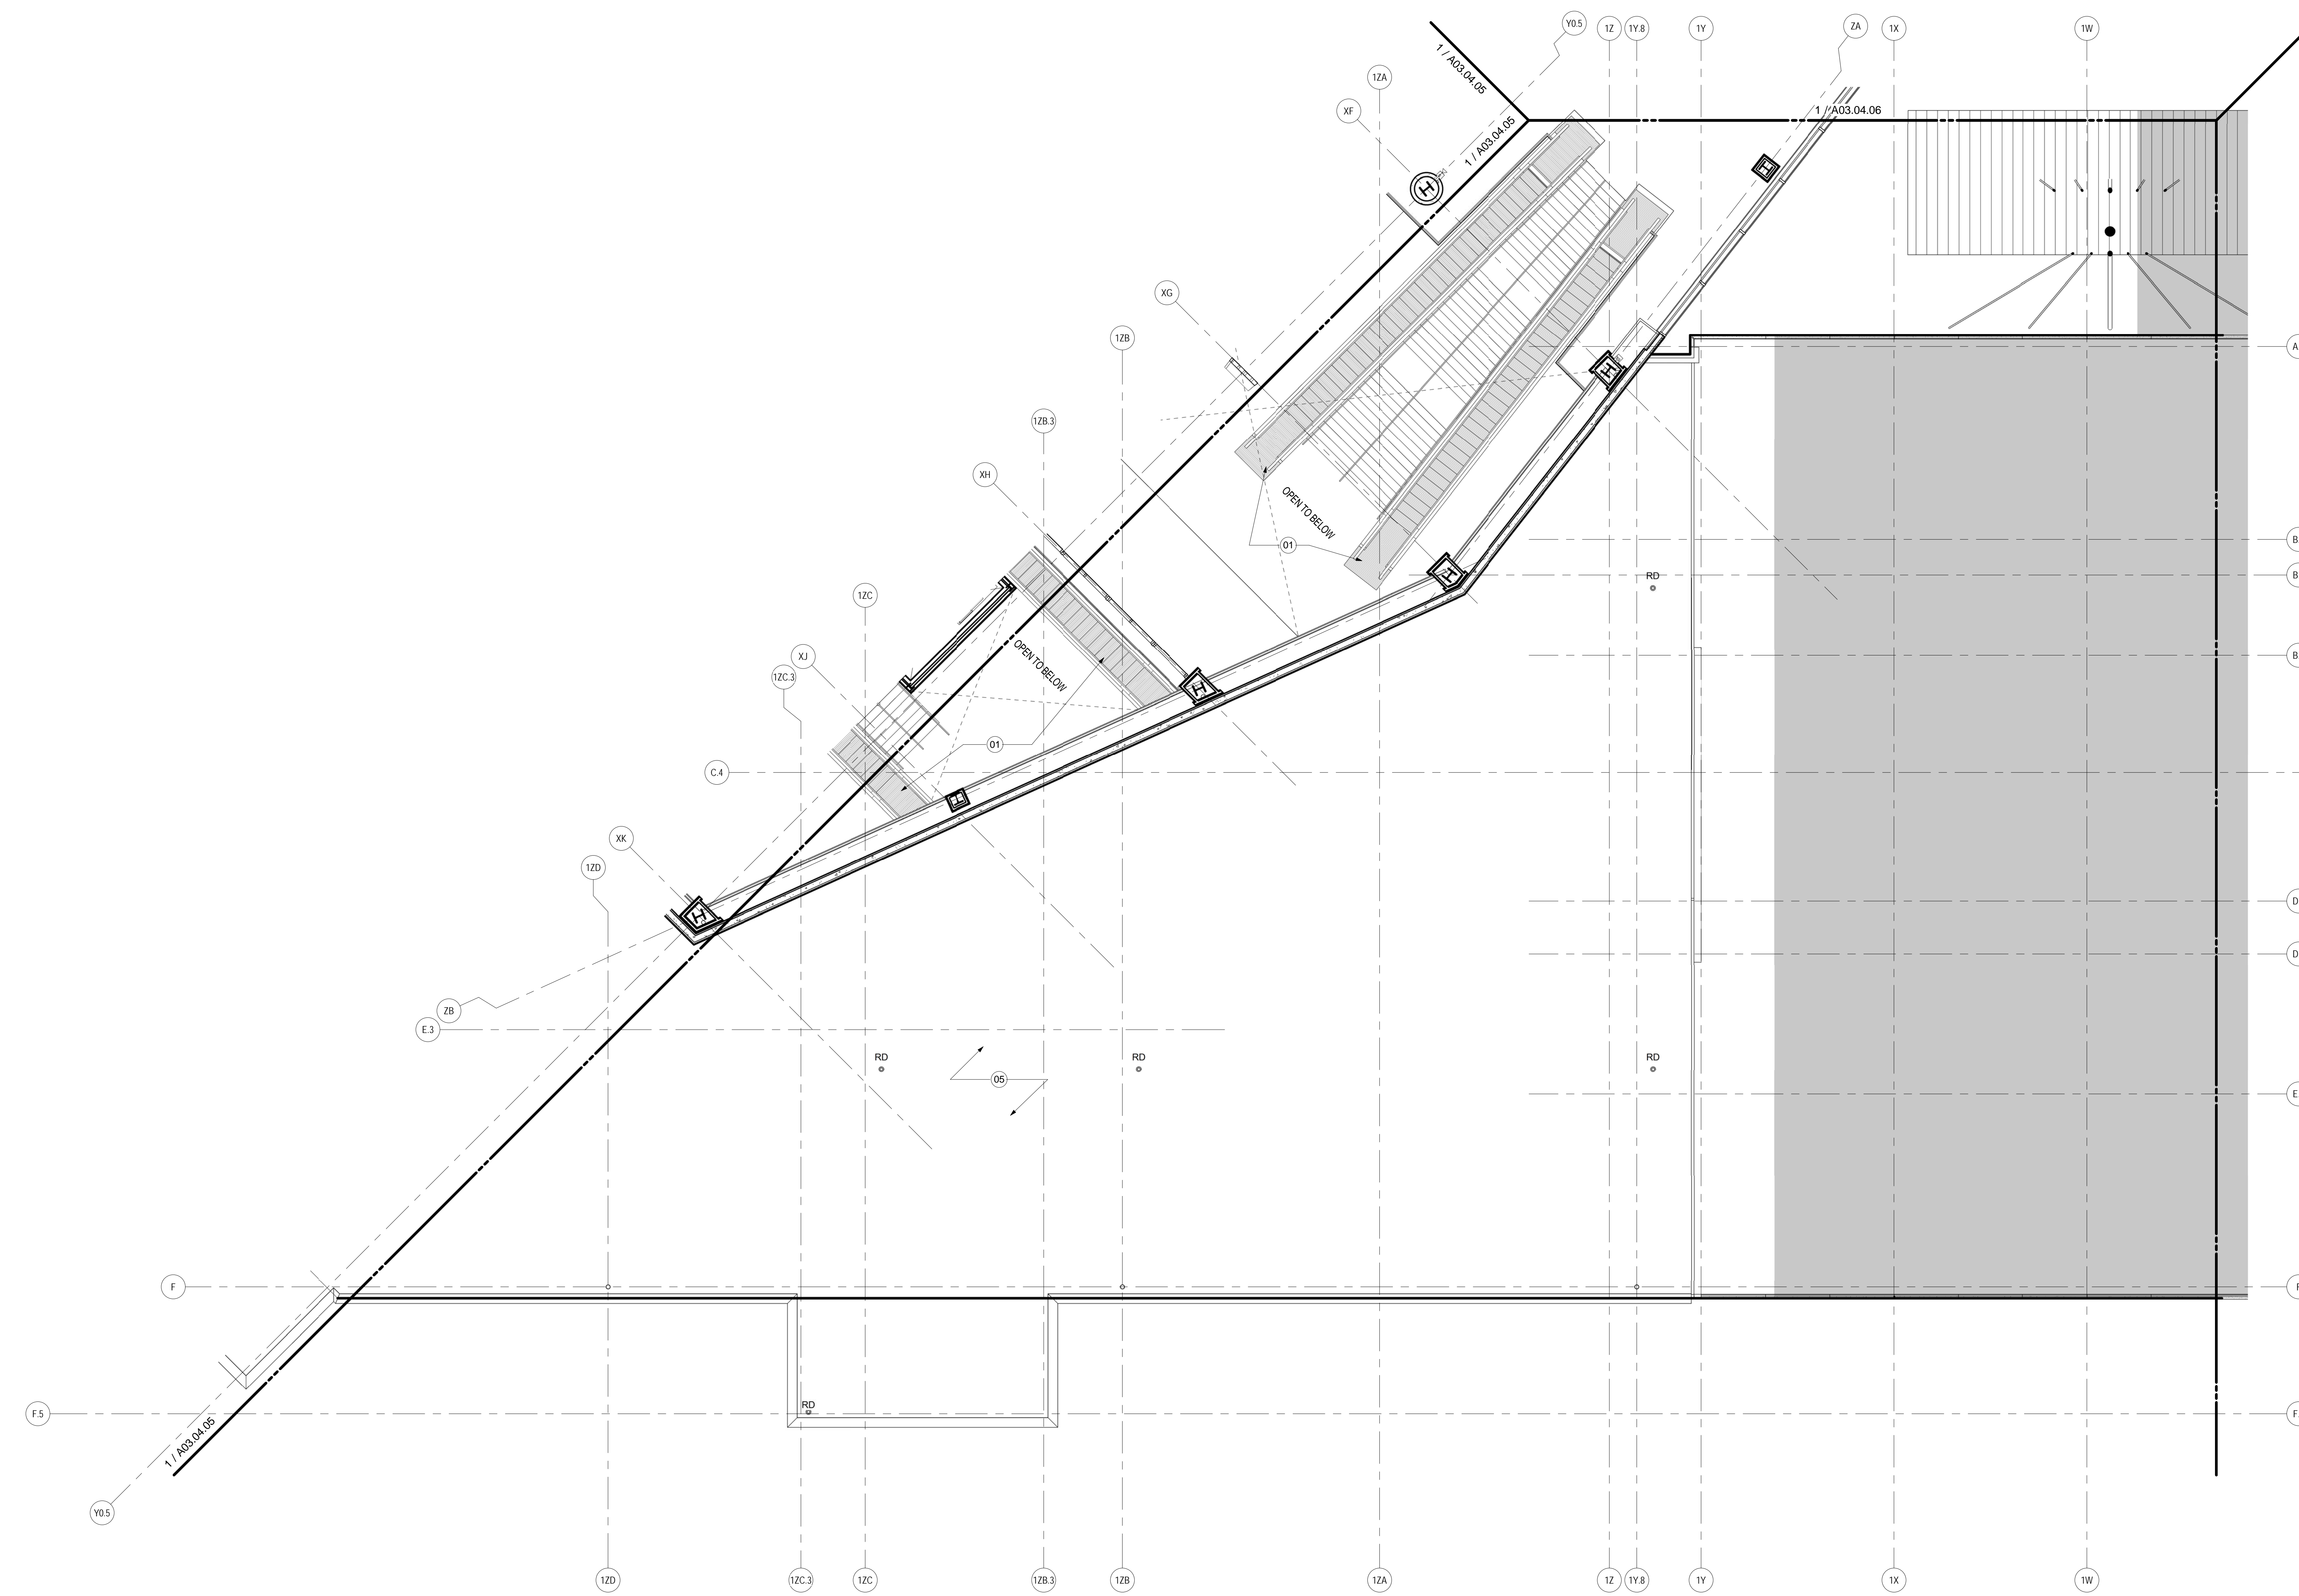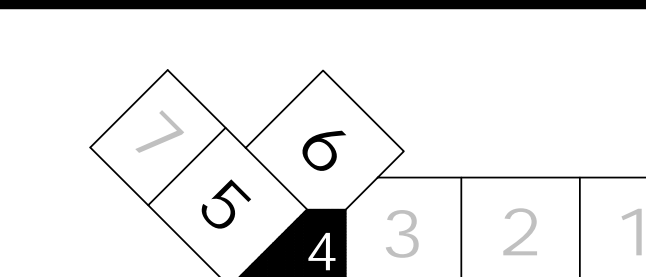

POWER & COMMUNICATION - LEVEL 4 - ZONE 4


SCALE: 1/8" = 1'-0"

A01.DS4

1

Date	Description
09/22/08	DESIGN DEVELOPMENT
12/03/08	75% CONSTRUCTION DOCUMENTS
01/23/09	95% CONSTRUCTION DOCUMENTS
10/26/09	ISSUED FOR PERMIT
145 09/01/11	ISSUED FOR CONSTRUCTION

Seal/Signature

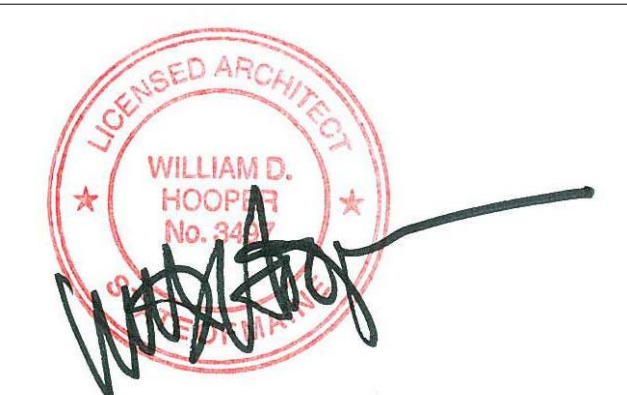

Project Name
PWM Terminal Enhancement

Project Number
09.6395.000

Description
POWER & COMMUNICATION PLAN - LEVEL 4 - ZONE 4

Scale
As indicated

A03.04.04

© 2009 Gensler