



LIGHT FIXTURE SCHEDULE

TYPE	DESCRIPTION	MFR.	LUMPS	NOTES
AA	400W METAL HALIDE SHOE-BOX STYLE FIXTURE WITH TYPE III DISTRIBUTION. PROVIDE PHOTO-EYE AND 4\"/>			
AA1	400W METAL HALIDE SHOE-BOX STYLE FIXTURE WITH TYPE IV DISTRIBUTION. PROVIDE PHOTO-EYE AND 4\"/>			
AA2	2-400W METAL HALIDE SHOE-BOX STYLE FIXTURE WITH TYPE IV DISTRIBUTION. PROVIDE PHOTO-EYE AND 4\"/>			
BB	250 W METAL HALIDE ROUND ROADWAY FIXTURE WITH TYPE III DISTRIBUTION. PROVIDE PHOTO-EYE AND ARM MOUNT.	SPALDING DL2-A-P25-H3-5-DB	1-250W PULSE START MH	PROVIDE 20\"/>
CC	COMPACT FLUORESCENT SITE BOLLARD, WHITE IN COLOR.	AAL CB-12-42-42-HORIZ-FLAT-AGR-1-250CF	1-26W QUAD	PROVIDE WITH COLD WEATHER BALLASTS.
DD	175 W ARCHITECTURAL FLOOD LIGHT W/ONE PIECE, DIE-CAST ALUMINUM HOUSING & FIXED HOOD.	KIM LIGHTING KN-AFL15-80DB-KN-AFL15-80DB	1-175W MH	
EE	PULSE START METAL HALIDE WALL PACK WITH PHOTO-EYE. CUSTOM COLOR TO MATCH SHERWIN WILLIAMS 7047 PORPOISE	HUBBELL LLC-400PS-PTA-S	1-400W MH	MOUNT 25\"/>


ELECTRICAL SITE PLAN
SCALE: 1\"/>

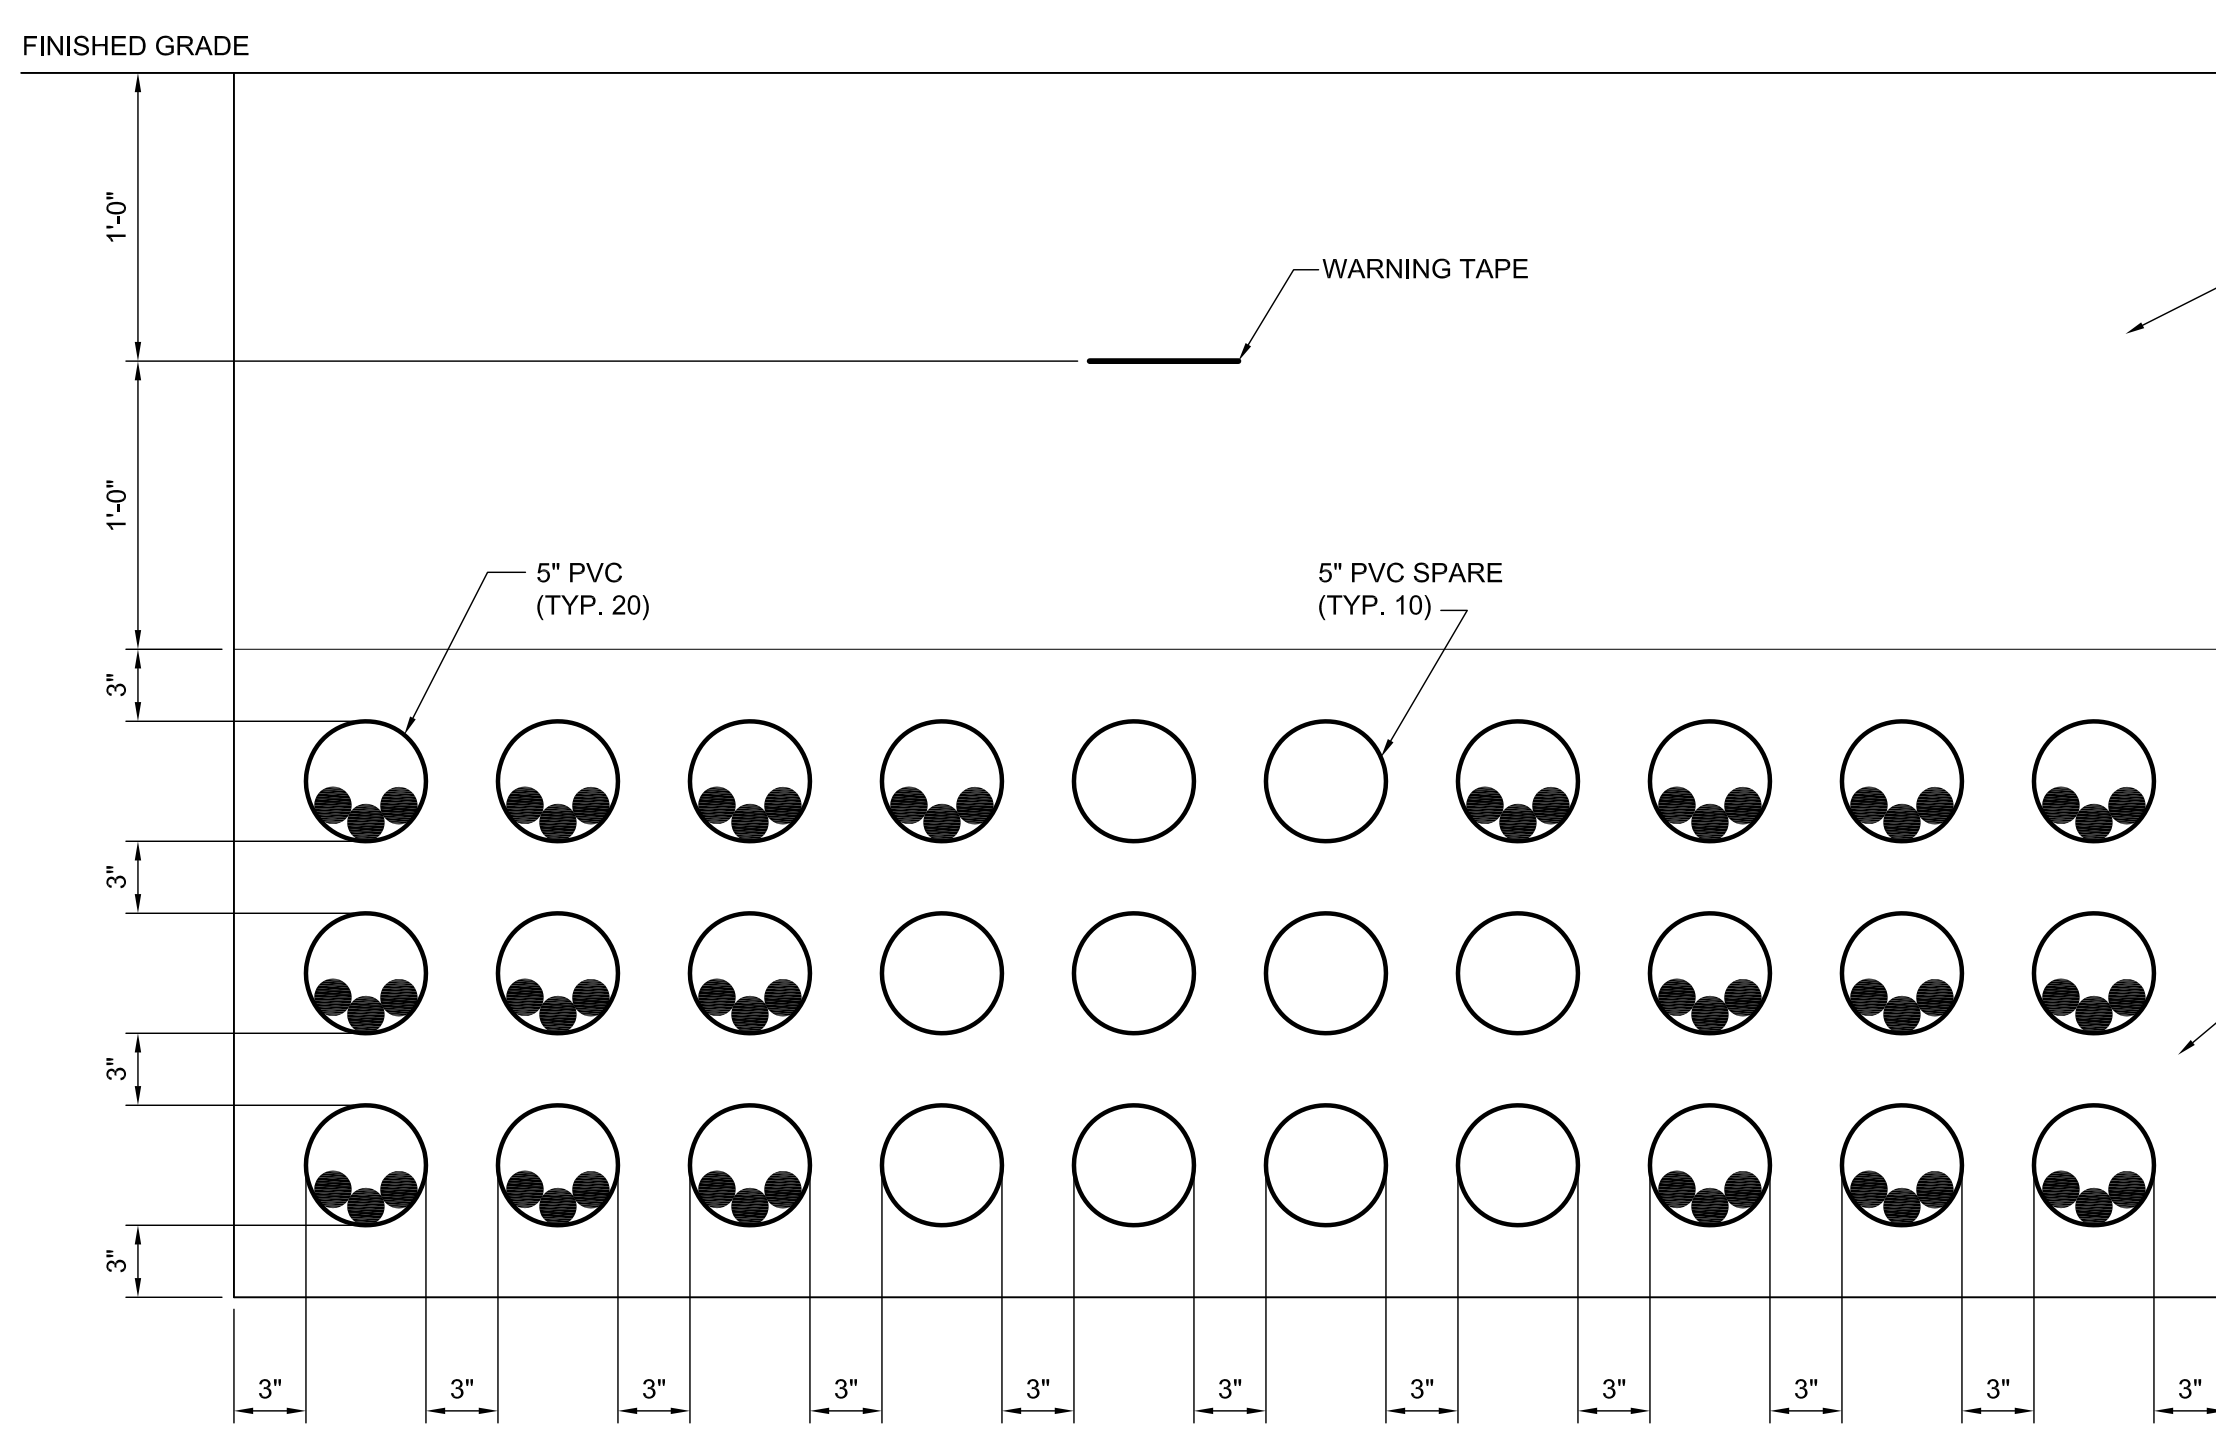


DUCT BANK DETAIL
SCALE: 1-1/2\"/>

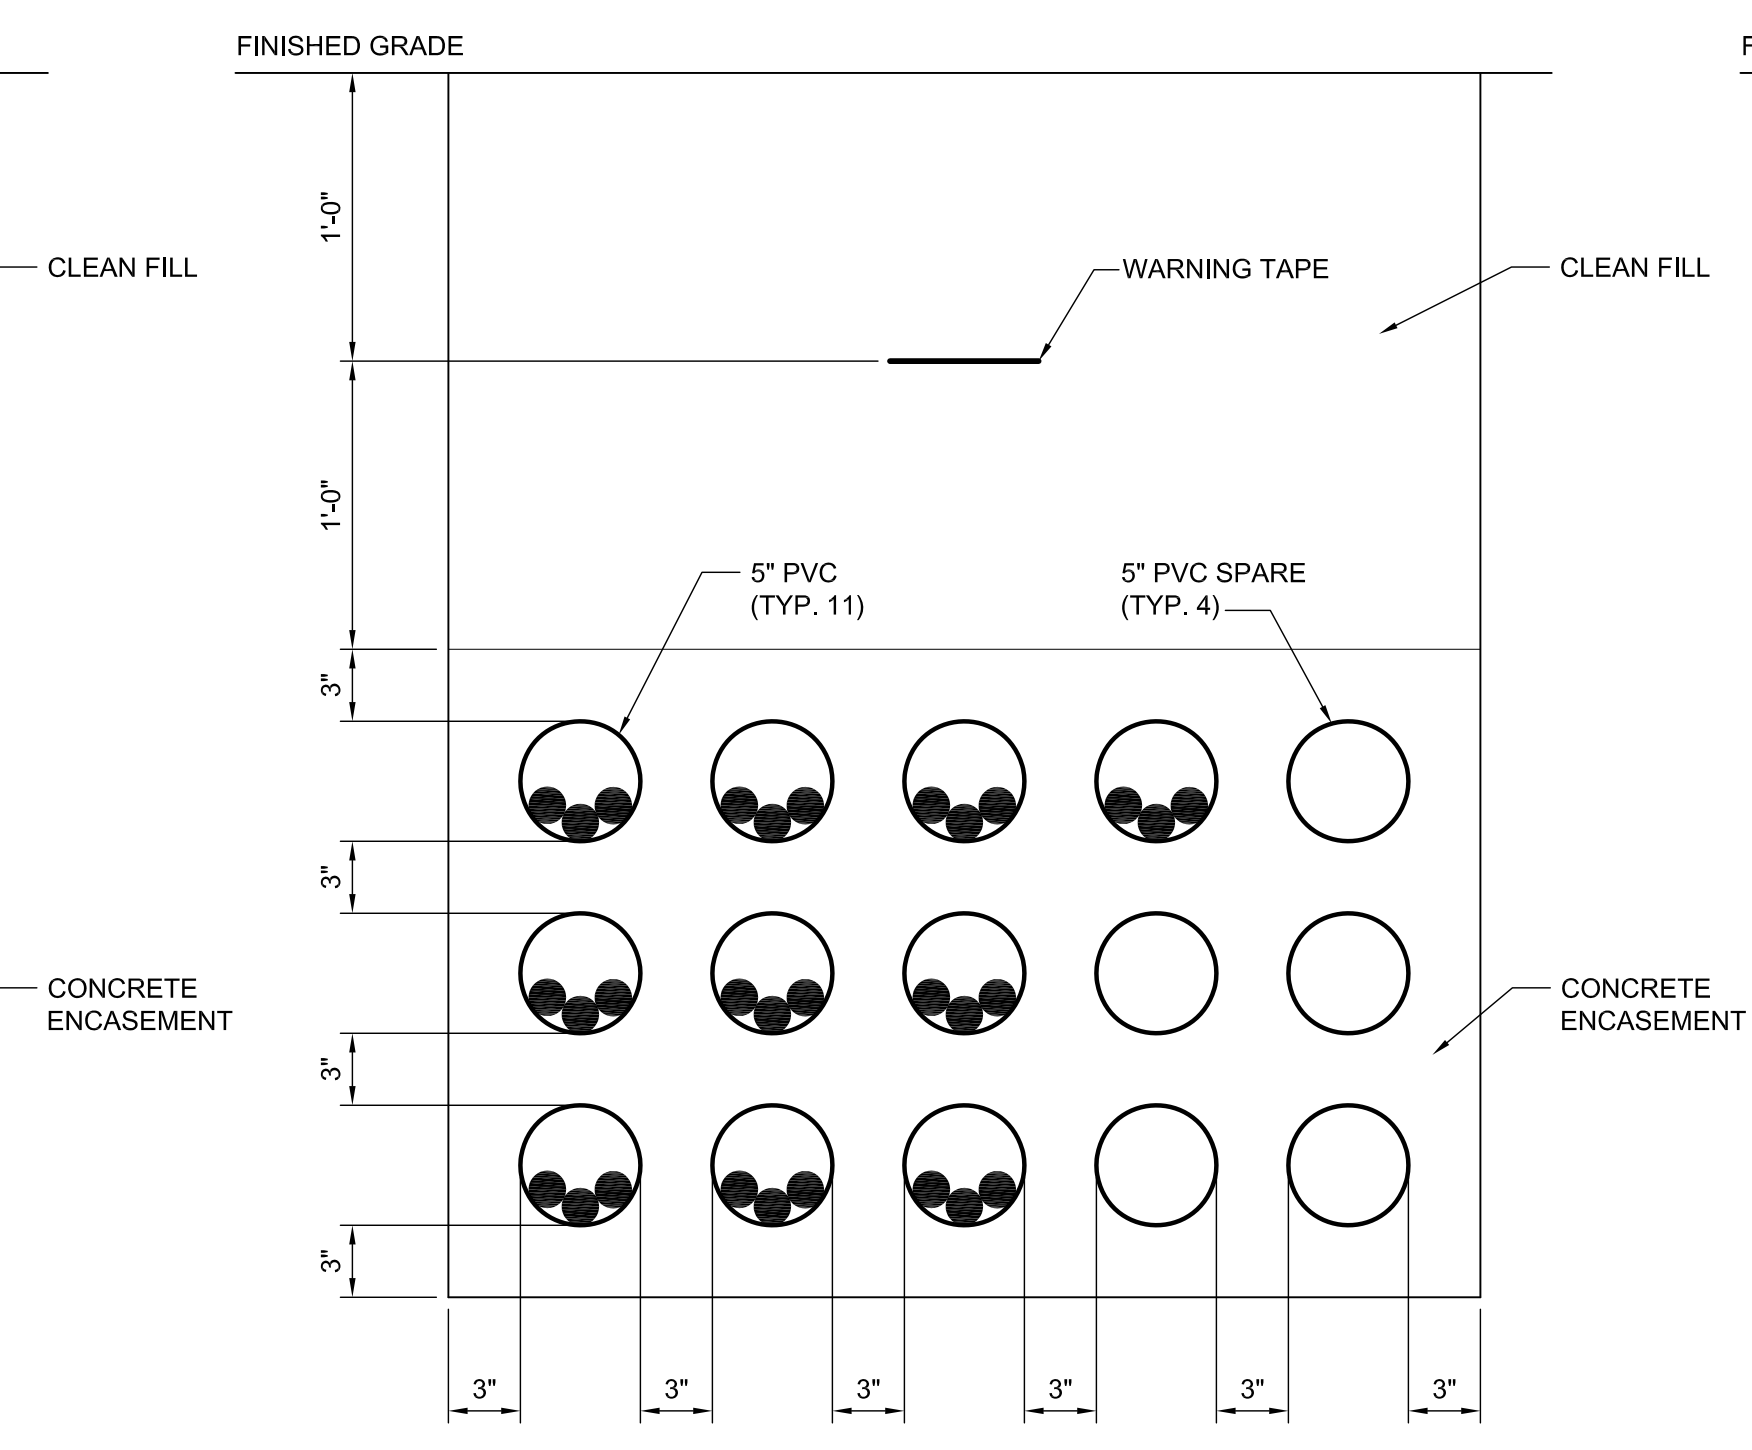

DUCT BANK DETAIL
SCALE: 1-1/2\"/>

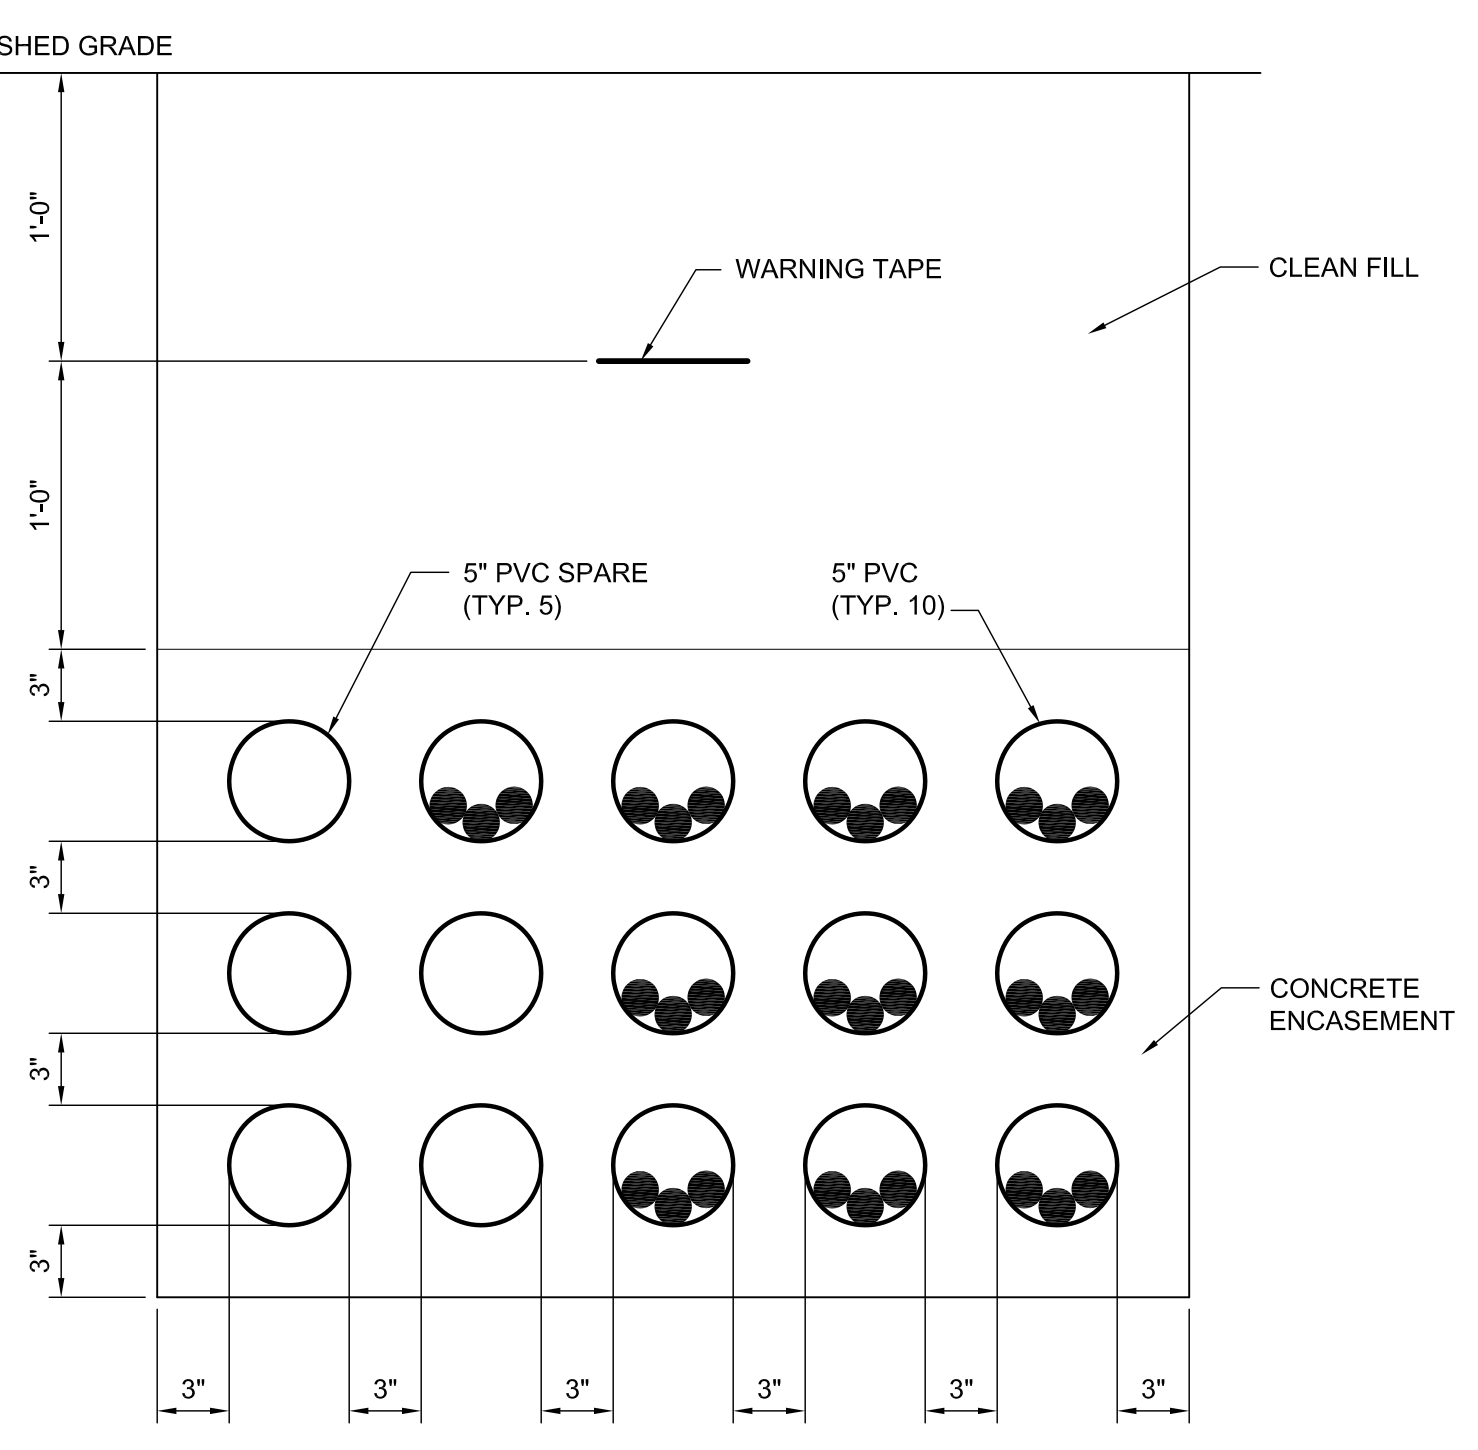

DUCT BANK DETAIL
SCALE: 1-1/2\"/>

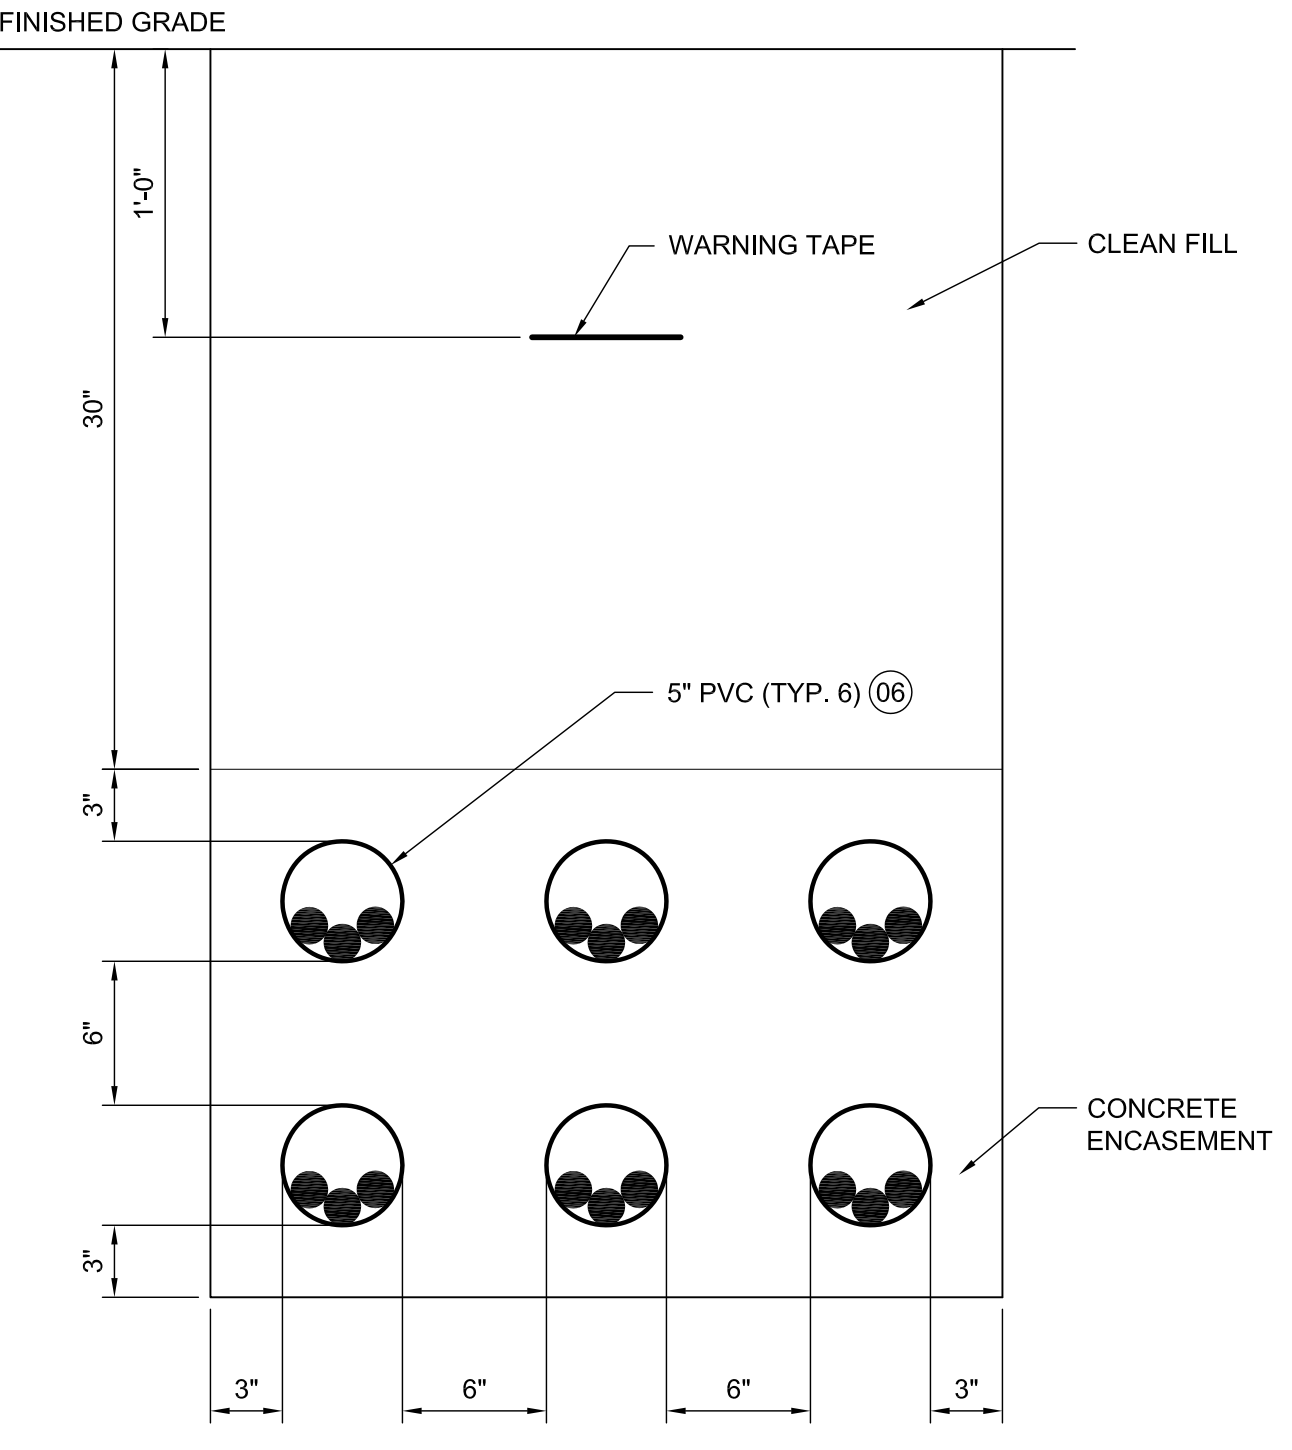

DUCT BANK DETAIL
SCALE: 1-1/2\"/>

SHEET NOTES

- JUNCTION BOX MOUNTED IN GROUND FOR CONNECTION TO PARKING LOT TICKET DISPENSER AND GATES.
- NOT USED.
- NOT USED.
- PROVIDE 5000VA TRANSFORMER WITH 480V PRIMARY AND 120V SECONDARY. PROVIDE NEMA 3R TYPE ENCLOSURE AND COORDINATE INSTALLATION WITH VENDOR.
- CONTRACTOR SHALL COORDINATE EXACT LOCATION OF DISCONNECT WITH OWNER. DISCONNECTS SHALL BE WITHIN SITE OF PUMP STATION. COORDINATE WITH VENDOR AS TO CONDUCTOR INSULATION TYPE.
- COORDINATE TYPE, SIZE AND QUANTITY OF MEDIUM VOLTAGE CABLE WITH CMP.
- CONTRACTOR SHALL PROVIDE 2-2\"/>

GENERAL NOTES

- SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.
- LIGHTING CIRCUITS SHALL BE BURIED A MINIMUM OF 24\"/>

Portland International Jetport
1001 Westbrook Street
Portland, Maine 04102

Gensler
2020 K Street, NW
Suite 200
Washington, DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

oest ASSOCIATES, INC.
361 Gopher Road, South Portland, ME 04106 P: (207) 761-1770 F: (207) 774-1246 www.oest.com
engineers - architects - surveyors - construction managers

amec
343 Gorham Road, South Portland ME 04106
P: (207) 761-1770 F: (207) 774-1246 www.amec.com

THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check	
01	07/11/08	LAM	BHG	
SCHEMATIC DESIGN				
02	09/22/08	LAM	BHG	
DESIGN DEVELOPMENT				
03	12/03/08	LAM	BHG	
75% CONSTRUCTION DOCUMENTS				
04	01/23/09	LAM	BHG	
95% CONSTRUCTION DOCUMENTS				
05	10/28/09	LAM	BHG	
ISSUED FOR PERMIT				
06	11/02/09	LAM	BHG	
ADDENDUM #1				
02	07	11/12/09	LAM	BHG
ADDENDUM #2				
03	08	11/20/09	LAM	BHG
ADDENDUM #3				
04	09	01/12/10	BHG	BHG
BULLETIN #1				
09	10	02/05/10	LAM	BHG
BULLETIN #6				
11	10/01/10	LAM	MSD	
RFI-0252R2 & RFI-427, ESK-067				
16	12	09/01/11	LAM	BHG
ISSUED FOR CONSTRUCTION				

See Signature

GENERAL NOTES

A SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.

B LIGHTING CIRCUITS SHALL BE BURIED A MINIMUM OF 24\"/>

Project Name
PJM Terminal Enhancement

Project Number
09-6395-000

CAD File Name
C:\AMEC\0330101\E00.01.DWG

Description
ELECTRICAL SITE PLAN

Scale
AS NOTED

E00.01

©2009 Gensler