

SHEET NOTES

- 01 JUNCTION BOX FOR CONNECTION TO DRINKING FOUNTAIN.
- 02 PROVIDE PULL BOX FOR CONNECTION TO BAGGAGE HANDLING SYSTEMS POWER DISTRIBUTION PANEL (PDP) INDICATED. PDP SHALL BE PROVIDED BY BAGGAGE HANDLING CONSULTANTS. CONTRACTOR SHALL MOUNT PULL BOX ABOVE PDP AND RUN CONDUCTORS THROUGH PULL BOX AND LEAVE 20' OF EXTRA CABLE COILED NEATLY. TERMINATION OF CONDUCTORS IN PDP WILL BE DONE BY OTHERS. SEE SHEET E12.01 FOR CONDUIT AND WIRE SIZE.
- 03 JUNCTION BOX FOR CONNECTION TO SUMP PUMP. COORDINATE EXACT LOCATION WITH PUMP MANUFACTURER.
- 04 PROVIDE LIEBERT INFINITY MODEL #HB2030712800 20KVA/14KW UPS SYSTEM OR EQUAL. PROVIDE WITH MAINTENANCE BYPASS CABINET & 10 MINUTES AT FULL LOAD RUN TIME.
- 05 SEE ONE-LINE DIAGRAM ON SHEET E12.01 FOR CONDUIT AND CONDUCTOR SIZES ASSOCIATED WITH THIS EQUIPMENT.
- 06 PROVIDE 120V CONTROL CIRCUIT FOR BAGGAGE HANDLING SYSTEMS POWER DISTRIBUTION PANEL (PDP).
- 07 MOUNT RECEPTACLE UNDER SINK IN HIDDEN LOCATION FOR CONNECTION TO AUTOMATIC FAUCETS. COORDINATE EXACT LOCATION WITH MECHANICAL.
- 08 MOUNT RECEPTACLE BEHIND ACCESS PANEL FOR AUTOMATIC FLUSH VALVE. COORDINATE EXACT LOCATION WITH MECHANICAL.
- 09 RELOCATE RECEPTACLE AND EXTEND WIRING IN RIGID GALVANIZED CONDUIT DOWN THE WALL, ACROSS THE FLOOR AND ON THE STANCHION TO THE NEW LOCATION OF ETD MACHINE. REFERENCE BSK:007, BSK:008 AND TSAP4800. INSTALL BLANK COVER PLATE OVER EXISTING RECEPTACLE BOX.

Portland International Jetport
 1001 Westbrook Street
 Portland, Maine 04102

Gensler
 2020 K Street, NW
 Suite 200
 Washington, DC 20006
 Telephone 202.721.5200
 Facsimile 202.872.8587

oest ASSOCIATES, INC.
 343 Gopher Road, South Portland, ME 04106
 P: (207) 761-1770 F: (207) 774-1246 www.oest.com
 engineers - architects - surveyors - construction managers

amec
 343 Gorham Road, South Portland ME 04106
 P: (207) 761-1770 F: (207) 774-1246 www.amec.com


THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check
01	07/11/06	LAM	BHG
02	09/22/08	LAM	BHG
03	12/03/08	LAM	BHG
04	01/23/09	LAM	BHG
05	10/28/09	LAM	BHG
06	11/02/09	LAM	BHG
07	11/12/09	LAM	BHG
08	01/25/10	LAM	BHG
09	03/09/11	LAM	BHG
10	05/03/10	LAM	BHG
11	06/01/11	LAM	BHG

GENERAL NOTES

- A SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.
- B CONTRACTOR SHALL REFER TO FIRE ALARM, SECURITY, IT, AND PUBLIC ADDRESS SYSTEMS DRAWINGS FOR CONDUITS & WIRING REQUIREMENTS.
- C ALL RECEPTACLE LOCATIONS IN OSR, BHS SERVER AND ETD ROOMS SHALL BE COORDINATED WITH BAGGAGE HANDLING SYSTEM PROVIDER.
- D VOICE/DATA JACKS SHOWN IN AIRLINE OPS 1502 SHALL HAVE BOX & 1" CONDUIT INSTALLED TO ABOVE ACCESSIBLE CEILING. TEL/DATA WIRING TO BE BY OTHERS.
- E EXISTING RECEPTABLES ALREADY INSTALLED IN AIRLINE OPS 1502 AS PART OF BID DRAWINGS SHALL BE COVERED WITH BLANK COVER PLATES. CIRCUITS FOR PWM SERVER RACKS HAVE BEEN REUSED.

KEY PLAN

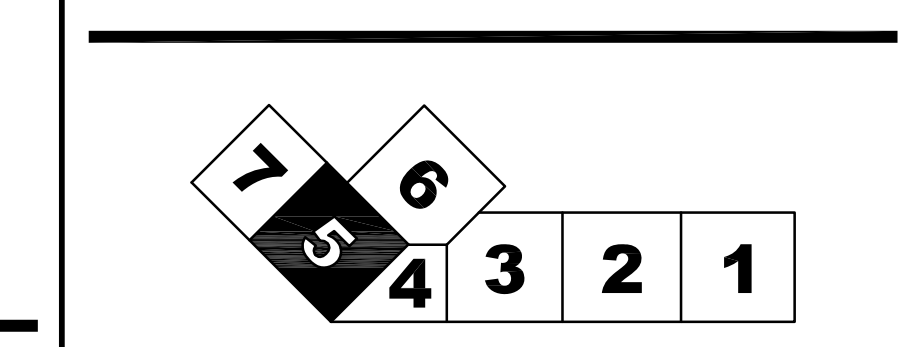

ELECTRICAL POWER PLAN - LEVEL 1 - ZONE 5
 SCALE: 1/8" = 1'-0"

Project Name
 PWM Terminal Enhancement

Project Number
 09-6395-000

CAD File Name
 C:\AMEC\0330101\E02.01.05.dwg

Description
 ELECTRICAL POWER PLAN - LEVEL 1 - ZONE 5

Scale
 1/8" = 1'-0"

Ref. North

E02.01.05

©2009 Gensler