

**SHEET NOTES**

- 01 PROVIDE 4" CONDUIT FROM ATO SPACE TO TICKET COUNTER UNDERSLAB. COORDINATE ACTUAL STUB-UP LOCATIONS WITH ARCHITECTURAL.
- 02 EXTERIOR MOUNTED CAMERA. SEE SECURITY DRAWINGS FOR DETAILS.
- 03 SEE ARCHITECTURAL DRAWINGS FOR ROUTING OF CONDUIT TO THESE RECEPTACLES.
- 04 PROVIDE MANUAL MOTOR STARTER FOR CONNECTION TO OVERHEAD DOOR.
- 05 MOUNT RECEPTACLE AT BACK OF RECESSED PIT FOR DOCK LEVELER MOTOR. CIRCUIT CONDUCTORS SHALL RUN FROM PANELBOARD TO DOCK LEVELER CONTROL BOX (SHOWN ON DRAWINGS) AND THEN TO RECEPTACLE. COORDINATE EXACT MOUNTING LOCATION WITH VENDOR.
- 06 REVOLVING DOOR MOTOR. COORDINATE EXACT LOCATION OF MOTOR WITH VENDOR.
- 07 PROVIDE JUNCTION BOX FOR CONNECTION TO REVOLVING DOOR LIGHTS. COORDINATE EXACT LOCATIONS WITH VENDOR.
- 08 COORDINATE CONNECTION REQUIREMENTS WITH VENDOR.
- 09 JUNCTION BOX FOR CONNECTION TO ELECTRIC CHAIN HOIST. COORDINATE EXACT LOCATION WITH VENDOR.
- 10 NOT USED
- 11 MOUNT DISCONNECT FOR POINT OF USE WATER HEATER IN INCONSPICUOUS LOCATION.
- 12 MOUNT RECEPTACLES IN CEILINGS ABOVE RACKS COORDINATE FINAL LOCATION WITH TEL/COMM DRAWINGS.
- 13 DOOR OPENER AND ASSOCIATED KEY/PUSH PADS. CONTRACTOR SHALL RUN CONTROL WIRING AS PER MANUFACTURER RECOMMENDATION FROM DOOR OPENER TO PUSH PADS. COORDINATE EXACT LOCATION OF PUSH PADS WITH ARCHITECTURAL.
- 14 MOUNT DEVICE 6" ABOVE COUNTER
- 15 PROVIDE 3/4" EMPTY CONDUIT PATH FROM DIP TO GATE DOOR 1525D. CONDUIT TO BE GRG EXCEPT BELOW SLAB SCHED. 80 PVC IS ACCEPTABLE. PENETRATE THE EXTERIOR BLOCK WALL IN ROOM 1530 ABOVE THE FOOTING AND EXTEND TO GATE 1525D BELOW CONCRETE SLAB. STUB UP AT CARD READER. COORDINATE WITH APPLICABLE TRADES AND ACCESS CONTROL INSTALLER FOR ALL LOCATIONS

**Portland International Jetport**  
 1001 Westbrook Street  
 Portland, Maine 04102

**Gensler**  
 2020 K Street, NW  
 Suite 200  
 Washington, DC 20006  
 Telephone 202.721.5200  
 Facsimile 202.872.8557

**oest ASSOCIATES, INC.**  
 385 Gopher Road, South Portland, ME 04106  
 P: (207) 761-1770 F: (207) 774-1246 www.oest.com  
 engineers - architects - surveyors - construction managers

**amec**  
 343 Gorham Road, South Portland ME 04106  
 P: (207) 761-1770 F: (207) 774-1246 www.amec.com


THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check
01	07/11/08	LAM	BHG
02	09/22/08	LAM	BHG
03	12/03/08	LAM	BHG
04	01/23/09	LAM	BHG
05	10/28/09	LAM	BHG
06	11/02/09	LAM	BHG
07	11/12/09	LAM	BHG
08	03/09/11	LAM	BHG
09	09/01/11	LAM	BHG

**GENERAL NOTES**

- A SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.
- B CONTRACTOR SHALL REFER TO FIRE ALARM, SECURITY, IT, AND PUBLIC ADDRESS SYSTEMS DRAWINGS FOR CONDUITS & WIRING REQUIREMENTS.
- C VOICE/DATA JACKS SHOWN IN AIRLINE OPS 1519-1523 SHALL HAVE BOX & 1" CONDUIT INSTALLED TO ABOVE ACCESSIBLE CEILING. TEL/DATA WIRING TO BE BY OTHERS.
- D EXISTING RECEPTACLES ALREADY INSTALLED IN AIRLINE OPS 1519-1523 AS PART OF BID DRAWINGS SHALL BE COVERED WITH BLANK COVER PLATES. CIRCUITS FOR PWM SERVER RACKS HAVE BEEN REUSED.

**KEY PLAN**

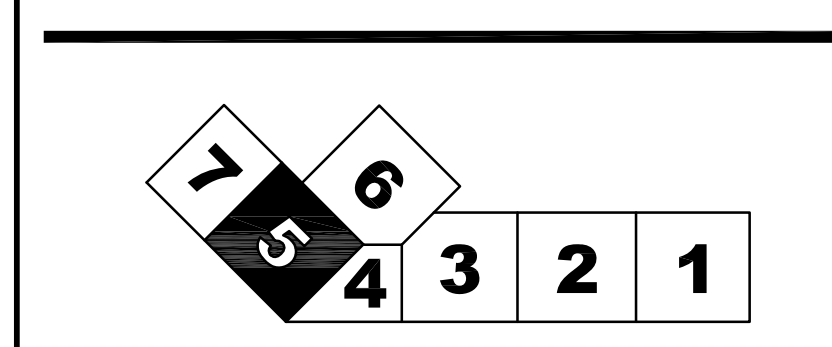

**ELECTRICAL POWER PLAN - LEVEL 2 - ZONE 5**  
 SCALE: 1/8" = 1'-0"

Scale: 1/8" = 1'-0"

**E02.02.05**