

FRAMING PLAN - LEVEL 3 - ZONE 4
SCALE: 1/8" = 1'-0" **1**

SHEET NOTES

- E00 INDICATES EDGE OF DECK.
- INDICATES DIRECTION OF SPAN OF DECKING. DECK TO BE 6" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK REINFORCED WITH 6X6-W2.1XW2.1 W/ 3/4" 5/8" DIAMETER WELD PATTERN AND (2) WELDED SIDE LAP CONNECTIONS PER SPAN. SEE GENERAL NOTES.
- INDICATES DIRECTION OF SPAN OF DECKING. DECK TO BE 5 3/8" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK REINFORCED WITH 6X6-W2.1XW2.1 W/ 3/4" 5/8" DIAMETER WELD PATTERN AND (2) WELDED SIDE LAP CONNECTIONS PER SPAN. SEE GENERAL NOTES.
- INDICATES LOCATION OF MOMENT CONNECTION CAPABLE OF DEVELOPING THE FULL MOMENT CAPACITY OF THE FLEXURAL ELEMENT.
- INDICATES LOCATION OF VERTICAL CROSS BRACING, SEE FRAMING ELEVATIONS.
- INDICATES LOCATION OF VERTICAL BRACING, SEE FRAMING ELEVATIONS.
- 12K (EXAMPLE) INDICATES TOTAL VERTICAL END REACTION IN KIPS (LRFD/FACTORED) FOR STEEL TO STEEL CONNECTION DESIGN.
- 20K(H) (EXAMPLE) INDICATES TOTAL HORIZONTAL END REACTION IN KIPS (LRFD/FACTORED) FOR STEEL TO STEEL CONNECTION DESIGN.
- MA (EXAMPLE) INDICATES MOMENT CONNECTION- SEE MOMENT SCHEDULE THIS SHEET.
- (SL) INDICATES SLOPED BEAM.
- (E) INDICATES EXISTING.

MOMENT SCHEDULE	
MARK	MOMENT
MA	2500 K-FT
MB	2000 K-FT
MC	1500 K-FT
MD	1000 K-FT
ME	750 K-FT
MF	500 K-FT
MG	200 K-FT

Portland International Jetport
1001 Westbrook Street
Portland, Maine 04102

Gensler
2020 K Street, NW
Suite 200
Washington, DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

amec ASSOCIATES, INC.
343 Gorham Road, South Portland, ME 04106
P: (207) 761-1770 F: (207) 774-1246 www.amec.com
engineers • architects • surveyors • construction managers


THESE DRAWINGS ARE ISSUED FOR CONSTRUCTION AND REFLECT ALL AMEC ISSUED BULLETINS AND SKETCHES.

Issue	Date & Issue Description	By	Check
01	07/11/08	JDE	---
02	09/22/08	JDE	---
03	12/03/08	JDE	---
04	01/23/09	JDE	---
05	10/26/09	JDE	---
06	11/12/09	JDE	---
07	01/12/10	JDE	---
08	02/03/10	JDE	---
09	05/03/10	JDE	---
10	09/01/11	JDE	---
145	10/01/11	JDE	---

GENERAL NOTES

1. ALL EXISTING CONDITIONS SHALL BE VERIFIED IN THE FIELD PRIOR TO BEGINNING OF ANY WORK. IF EXISTING FIELD CONDITIONS DO NOT PERMIT THE INSTALLATION OF THE WORK IN ACCORDANCE WITH THE DETAILS AS SHOWN, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY AND PROVIDE A SKETCH OF THE CONDITION WITH PROPOSED MODIFICATION FOR REVIEW BY ARCHITECT.
2. CONTRACTOR TO CONFIRM ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO START OF WORK.
3. FINISHED FLOOR ELEVATION = (+) VARIES, RE: ARCH TOP OF STEEL ELEVATION = (+) 72'-7 1/4" UNLESS NOTED OTHERWISE.
4. FRAMING NOT SPECIFICALLY DIMENSIONED SHALL BE ASSUMED EQUALLY SPACED.
5. SEE SHEET S00.00 FOR GENERAL STRUCTURAL NOTES AND DESIGN LOADS.
6. DIMENSIONS IN PARENTHESIS ARE FOR REFERENCE ONLY.
7. ALL FLOOR FRAMING MEMBERS SHALL BE PROPERLY BRACED BY THE CONTRACTOR UNTIL THE STRUCTURAL FLOOR DIAPHRAGM HAS BEEN COMPLETELY CONSTRUCTED.
8. CONTRACTOR SHALL COORDINATE ALL FLOOR OPENINGS WITH MECHANICAL DRAWINGS. ALL FLOOR OPENINGS LARGER THAN 10" DIAMETER OR SQUARE SHALL BE SUPPORTED ON FRAME (SEE SHEET S12.04). ANY OPENING NOT SHOWN ON THIS DRAWING SHALL NOT BE CONSTRUCTED WITHOUT THE ARCHITECT'S APPROVAL.
9. EXISTING BUILDING INFORMATION USED TO PREPARE PLANS OF THIS AREA WERE TAKEN FROM AS-BUILT DRAWINGS PREPARED BY PUDA DATED SEPTEMBER 2006.
10. METAL STUD GAGES SHALL BE SELECTED BASED ON THE STUD DEPTHS SHOWN ON THE ARCHITECTURAL PLANS. WIND LOAD = 35 PSF AND MAXIMUM DEFLECTION OF 1/360 OR 0.3". BRICK VENER, 1/360 FOR PANEL WALL. - VERTICAL DEFLECTION CLIPS FOR ALL STUDS ATTACHING TO BEAMS.
11. FLOOR SLABS AT THIS LEVEL SHALL BE INSTALLED WITH RADIANT HEAT. COORDINATE W/ ARCH & MECH DWGS.

KEY PLAN

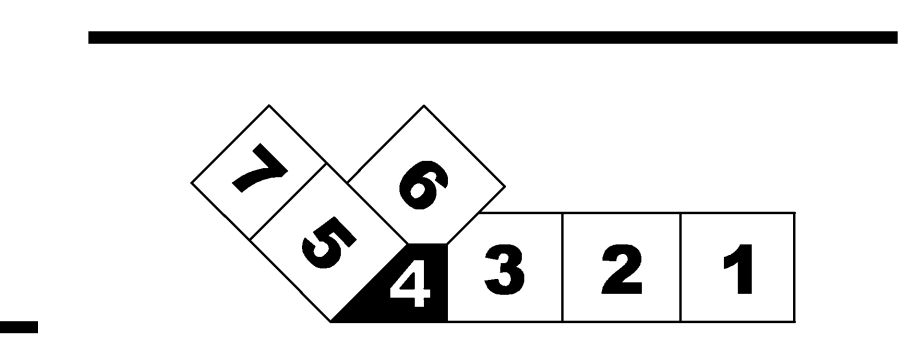

Scale: 1/8" = 1'-0"

S02.03.04

©2009 Gensler