




Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Date: 12/15/14

Range Guard Wet Chemical Systems Pre-Engineered Fire Suppression System

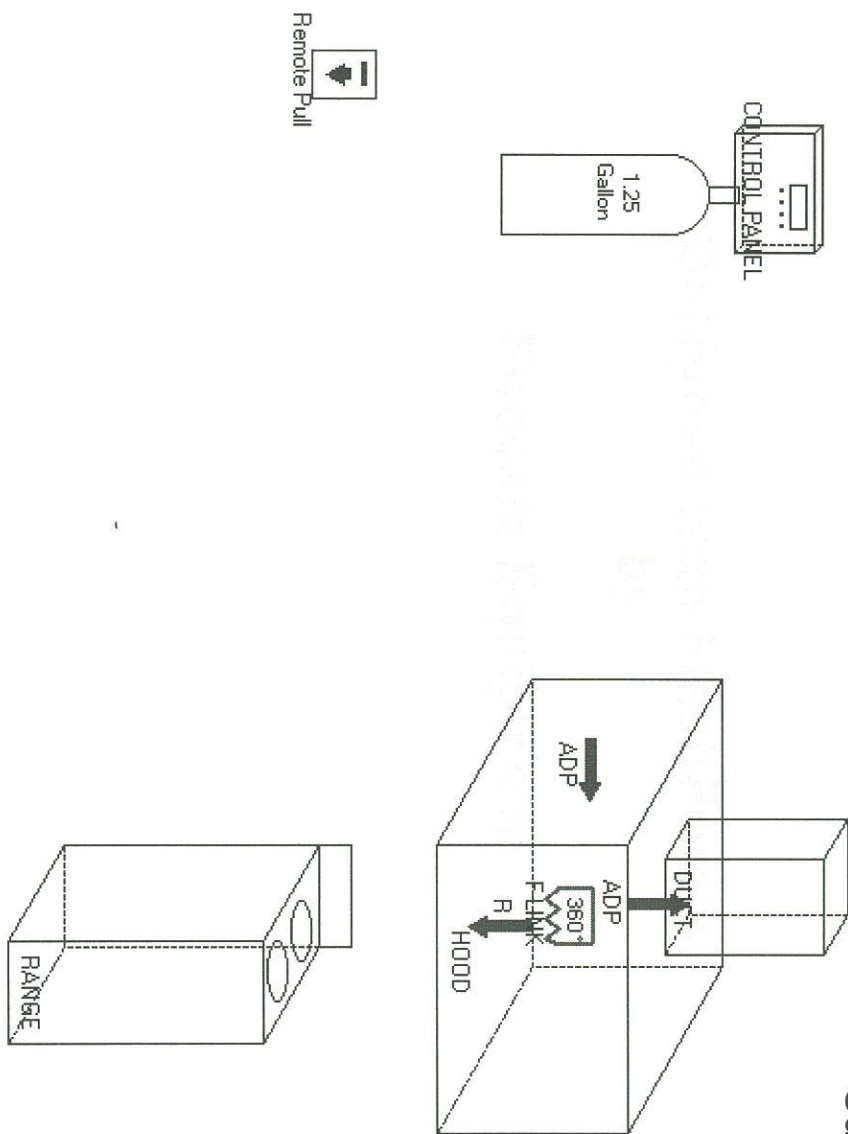

Designed & Installed by:
Firesafe Equipment
PO Box 1355
Auburn, ME 04211
207-784-7525

For:
PORTLAND JETPORT

Lic #:

Designer:

Job #:

Date: 11/10/2014

Stamp



Reviewed for Code Compliance
Inspections Division
Approved with Conditions



Date: 12/15/14

Strengthening a Remarkable City, Building a Community for Life • www.portlandmaine.gov

Jeff Levine, AICP, Director
Director of Planning and Urban Development

Tammy Munson
Director, Inspections Division

Electronic Signature and Fee Payment Confirmation

Notice: Your electronic signature is considered a legal signature per state law.

By digitally signing the attached document(s), you are signifying your understanding this is a legal document and your electronic signature is considered a **legal signature** per Maine state law. You are also signifying your intent on paying your fees by the opportunities below.

I, the undersigned, intend and acknowledge that no permit application can be reviewed until payment of appropriate permit fees are **paid in full** to the Inspections Office, City of Portland Maine by method noted below:

- Within 24-48 hours, once my complete permit application and corresponding paperwork has been electronically delivered, I intend to **call the Inspections Office** at 207-874-8703 and speak to an administrative representative and provide a credit/debit card over the phone.
- Within 24-48 hours, once my permit application and corresponding paperwork has been electronically delivered, I intend to **hand deliver** a payment method to the Inspections Office, Room 315, Portland City Hall.
- I intend to deliver a payment method through the U.S. Postal Service mail once my permit paperwork has been electronically delivered.

Applicant Signature: 

Date: 

I have provided digital copies and sent them on:

Date:

NOTE: All electronic paperwork must be delivered to buildinginspections@portlandmaine.gov or by physical means ie; a thumb drive or CD to the office.



Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Building Inspections - RE: PERMIT - PORTLAND JET AIR PORT

From: "Eileen Mosher" <eileen@fire-safe.com>
To: "Building Inspections" <buildinginspections@portlandmaine.gov>
Date: 11/13/2014 9:47 AM
Subject: RE: PERMIT - PORTLAND JET AIR PORT

Date: 12/15/14

Hi Lenie,

The location of fire suppression is for Portland tower on the air strip.

Let me know if this will be enough.

Thank you

Eileen Lord

From: Building Inspections [mailto:buildinginspections@portlandmaine.gov]
Sent: Wednesday, November 12, 2014 8:22 AM
To: Eileen Mosher
Subject: Re: PERMIT - PORTLAND JET AIR PORT

Please provide the rest of the documents as required.

>>> "Eileen Mosher" <eileen@fire-safe.com> 11/11/2014 12:09 PM >>>
Hi,

Please see attached request for permit for the following.

Any questions, please feel free to contact me at emosher@fire-safe.com
or at 1-800-538-FIRE (3473).

Sincerely,

Eileen Lord
Office Manager

Notice: Under Maine law, documents - including e-mails - in the possession of public officials or city employees about government business may be classified as public records. There are very few exceptions. As a result, please be advised that what is written in an e-mail could be released to the public and/or the media if requested.



Non-Water-Based Fire Suppression System Permi



Reviewed for Code Compliance
Inspections Division
Approved with Conditions

If you or the property owner owes real estate or property taxes or user charges on any prop
within the city, payment arrangements must be made before permits of any kind are accep

Date: 12/15/14

Installation address: Congress Street CBL: _____

Exact location: (within structure) Portland Jet Port

Type of occupancy(s) (NFPA & ICC): Restaurant

Building owner: City of Portland, Maine

Managing Supervisor: Ability Equipment Sales License No: N/A

Supervisor phone: 207-283-8008 E-mail: _____

Installing contractor: Firesafe Equipment / Jeff Driscoll License No: N/A

Contractor phone: 207-784-7525 E-mail: dchapman@fire-safe.com

The suppression work to be done will be: New: Renovation: Addition to existing system:

This is an amendment to an existing permit: Yes: NO Permit no: _____

System Type: Wet Chemical system

NFPA Standard: NFPA 17A Edition: 1996

*Non-NFPA systems are not approved for use within the City of Portland.

Download a new copy of this document from
www.portlandmaine.gov/fire for every submittal. Attach all working
documents as required on electronic PDF's in addition to
full sized plans.

COST OF WORK: \$ 1500.00
PERMIT FEE: \$ 40.00
(\$10 PER \$1,000 + \$30 FOR THE FIRST \$1,000)

Submit all information to the Building Inspections Department, 389 Congress Street, Room 315, Portland, Maine 04101.

Prior to acceptance of any fire protection system, a complete commissioning and acceptance test must be coordinated with
all fire system contractors and the Fire Department, and proper documentation of such test(s) provided.

All installation(s) must comply with NFPA and the Fire Department Technical Standard(s).

Applicant signature: *Ellen Ford* Date: *Nov 11, 14*



Fire Suppression System Design Specificatio

Reviewed for Code Compliance
Inspections Division
Approved with Conditions

Notes

System Ma

Date: 12/15/14

| Item Number | Description | |
|---------------|--|---|
| 87-120016-001 | ADP Nozzle | 1 |
| 87-120019-001 | R Nozzle | 1 |
| WK-282664-000 | ML-360 Link 360 F (182 C), ML, Unpaint | 1 |
| 60-120001-001 | WHDR-125 Cylinder/Valve, 1.25 Gallon | 1 |
| 60-120099-001 | Universal Control Head Assembly | 1 |
| 60-120110-001 | Remote Manual Release, Combination | 1 |
| 60-120064-001 | Universal Link Detector Housing Kit (A+) | 1 |



Designed & Installed by:
Firesafe Equipment
PO Box 1355
Auburn, ME 04211
207-784-7525

For:
PORTLAND JETPORT