

Stantec Consulting Services Inc. 5 Dartmouth Drive, Suite 101 Auburn NH U.S.A. 03032-3984 Tel. 603.669.8672 Fax. 603.669.7636 www.stantec.com

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.

The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

JAMES E. STEWART

CENSED OF

Consultants

Legend

Notes

Stantec

WARNING


DO NOT INITIATE FUEL OR OIL TRANSFERS PRIOR TO CHECKING IN WITH FACILITY PERSONNEL.

Tanik Truck Drivers are responsible for following DOT Procedures (49 CFR Parts 177.834 ans 177.837

- Shut down engine unless used for transfer pumping operation • Set brakes and chock wheels prior to and for the duration of all fuel
- Perform bonding/grounding prior to fuel and oil transfers, if necessary

- Verify complete disconnect of hoses and bonding/grounding prior to removal of wheel chocks
- DO NOT DEPART PRIOR TO CHECKING OUT WITH FACILITY PERSONNEL

OWNER SUPPLIED SIGN TO BE INSTALLED BY CONTRACTOR SIGN#: CAS-HTZ2

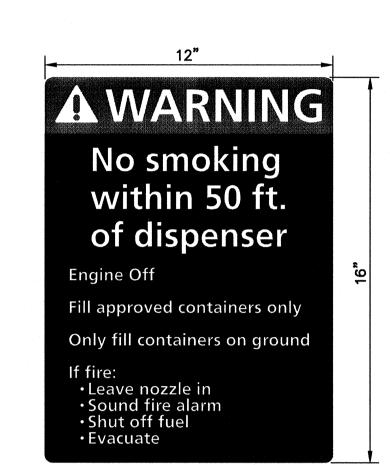

16"X12" SINGLE FACED, COLUMN MOUNTED SIGN. RED BACKGROUND WITH WHITE LETTERS. GASOLINE ADVERTISING PRODUCTS MODEL NUMBER: AS-47

TO BE MOUNTED NEAR FUELING OPERATIONS AREA, ONE PER DISPENSER.

6,000 **GALLONS**

OWNER SUPPLIED SIGN TO BE INSTALLED BY CONTRACTOR SIGN#: CVD-HTZ11

TANK CONTENT LABEL

SCALE: NOT TO SCALE

VAULT TANK

NO SMOKING


OWNER SUPPLIED SIGN TO BE INSTALLED BY CONTRACTOR SIGN#: CVD-HTZ10

VAULT TANK LABEL

SCALE: NOT TO SCALE



OWNER SUPPLIED SIGN TO BE INSTALLED BY CONTRACTOR SIGN#: CVD-HTZ15



OWNER SUPPLIED SIGN TO BE INSTALLED BY CONTRACTOR

DRIVER WARNING SIGN SCALE: NOT TO SCALE



WARNING SIGN SCALE: NOT TO SCALE

MAIN TANK LABEL

SCALE: NOT TO SCALE

NFPA 704 PLACARD SCALE: NOT TO SCALE



IN CASE OF SPILL

 Use Emergency Shut-Off - Call 911

24"X18" SINGLE FACED, COLUMN MOUNTED SIGN. RED BACKGROUND WITH WHITE LETTERS.

TANK FILL AREA.

TO BE MOUNTED NEAR FUELING OPERATIONS AREA AND

EMERGENCY PROCEDURE SIGN

Overfill Alarm When Alarm Sounds Tank is Full

OWNER SUPPLIED SIGN TO BE INSTALLED BY CONTRACTOR SIGN#: CAS-HTZ4

OVERFILL SIGN SCALE: NOT TO SCALE

EMERGENCY SHUT-OFF SIGN SCALE: NOT TO SCALE

18"X18" SINGLE FACED, COLUMN MOUNTED SIGN. RED BACKGROUND WITH WHITE LETTERS.

TO BE MOUNTED ABOVE EMERGENCY FUEL PUMP

SHUT-OFF SWITCH

EMERGENCY

FUEL

SHUT-OFF

SWITCH

SCALE: NOT TO SCALE

JES JES 13.09.27

 JES
 JES
 13.09.10

 By
 Appd.
 YY.MM.DD

THE HERTZ CORPORATION

ABOVEGROUND STORAGE TANK INSTALLATION AND RELATED WORK PORTLAND, ME

ABOVEGROUND STORAGE TANK SIGN DETAILS

Project No. **AS NOTED** FS.C.6

ORIGINAL SHEET - ARCH D