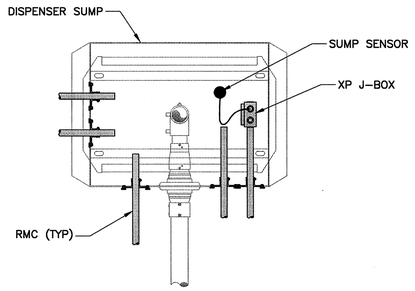

1 FS.E.3 DISPENSER CONDUIT PLAN
SCALE: N.T.S.

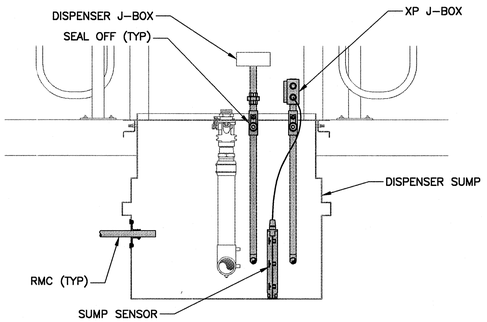

2 FS.E.3 TYPICAL DISPENSER CONDUIT ELEVATION
SCALE: 1/4"=1"

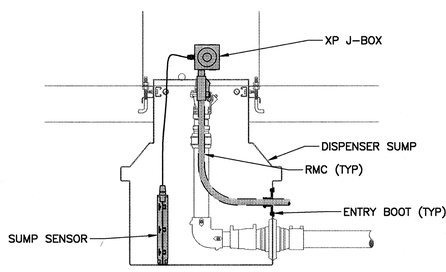

3 FS.E.3 DISPENSER CONDUIT ELEVATION
SCALE: N.T.S.

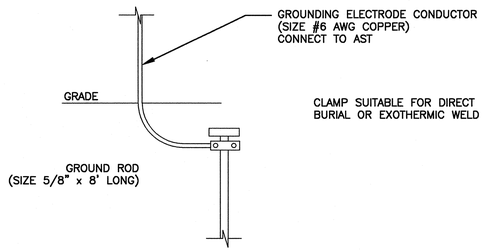

4 FS.E.3 AST GROUNDING DETAIL
SCALE: NOT TO SCALE

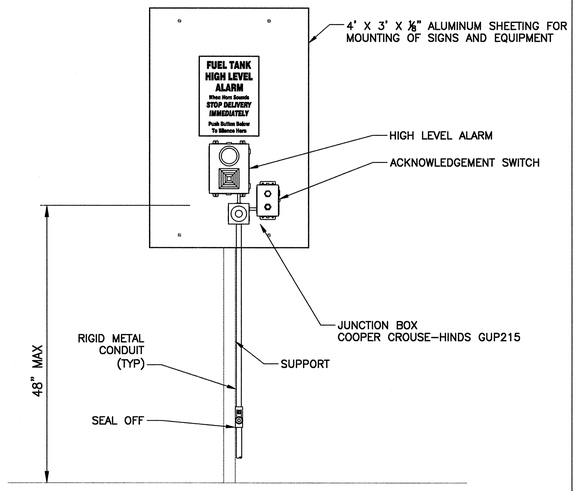

5 FS.E.3 HIGH LEVEL ALARM DETAIL
SCALE: NONE

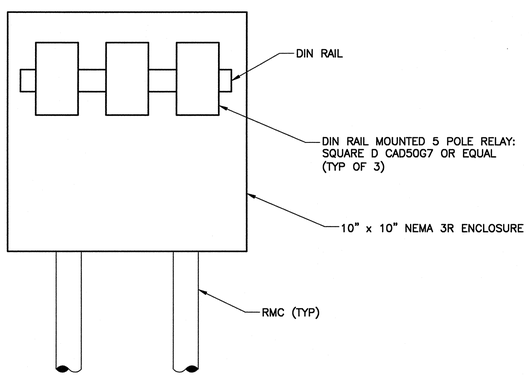

6 FS.E.3 E-STOP DISCONNECT DETAIL
SCALE: NOT TO SCALE

7 FS.E.3 EDIS SCHEMATIC
SCALE: NONE

Stantec Consulting Services Inc.
5 Dartmouth Drive, Suite 101
Auburn NH U.S.A.
03032-3984
Tel. 603.669.8672
Fax. 603.669.7636
www.stantec.com

Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing – any errors or omissions shall be reported to Stantec without delay.
The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

Consultants

Legend

Notes

STATE OF MAINE
JAMES E. STEWART
No. 9848
LICENSED PROFESSIONAL ENGINEER
9-27-13

Revision	By	Appd.	YY.MM.DD
ISSUE FOR PERMIT	JES	JES	13.09.27
ISSUE FOR BID	JES	JES	13.09.10
Issued	By	Appd.	YY.MM.DD
File Name: 04_191711186_FS.E.dwg	JSW Dwn.	JKM/JSC Chkd.	JSW Dsgn.	1-20-12 YY.MM.DD

Hertz

Client/Project
THE HERTZ CORPORATION

ABOVEGROUND STORAGE TANK INSTALLATION AND RELATED WORK
PORTLAND, ME

Title
ELECTRICAL DETAILS

Project No.	Scale	
191711186	AS NOTED	
Drawing No.	Sheet	Revision
FS.E.3	18 of 19	0

ORIGINAL SHEET – ARCH D