


ONE WALL MOUNTED FIRE SUPPRESSION TO BE PROVIDED TO PROTECT 2 HOODS, ITEM #40

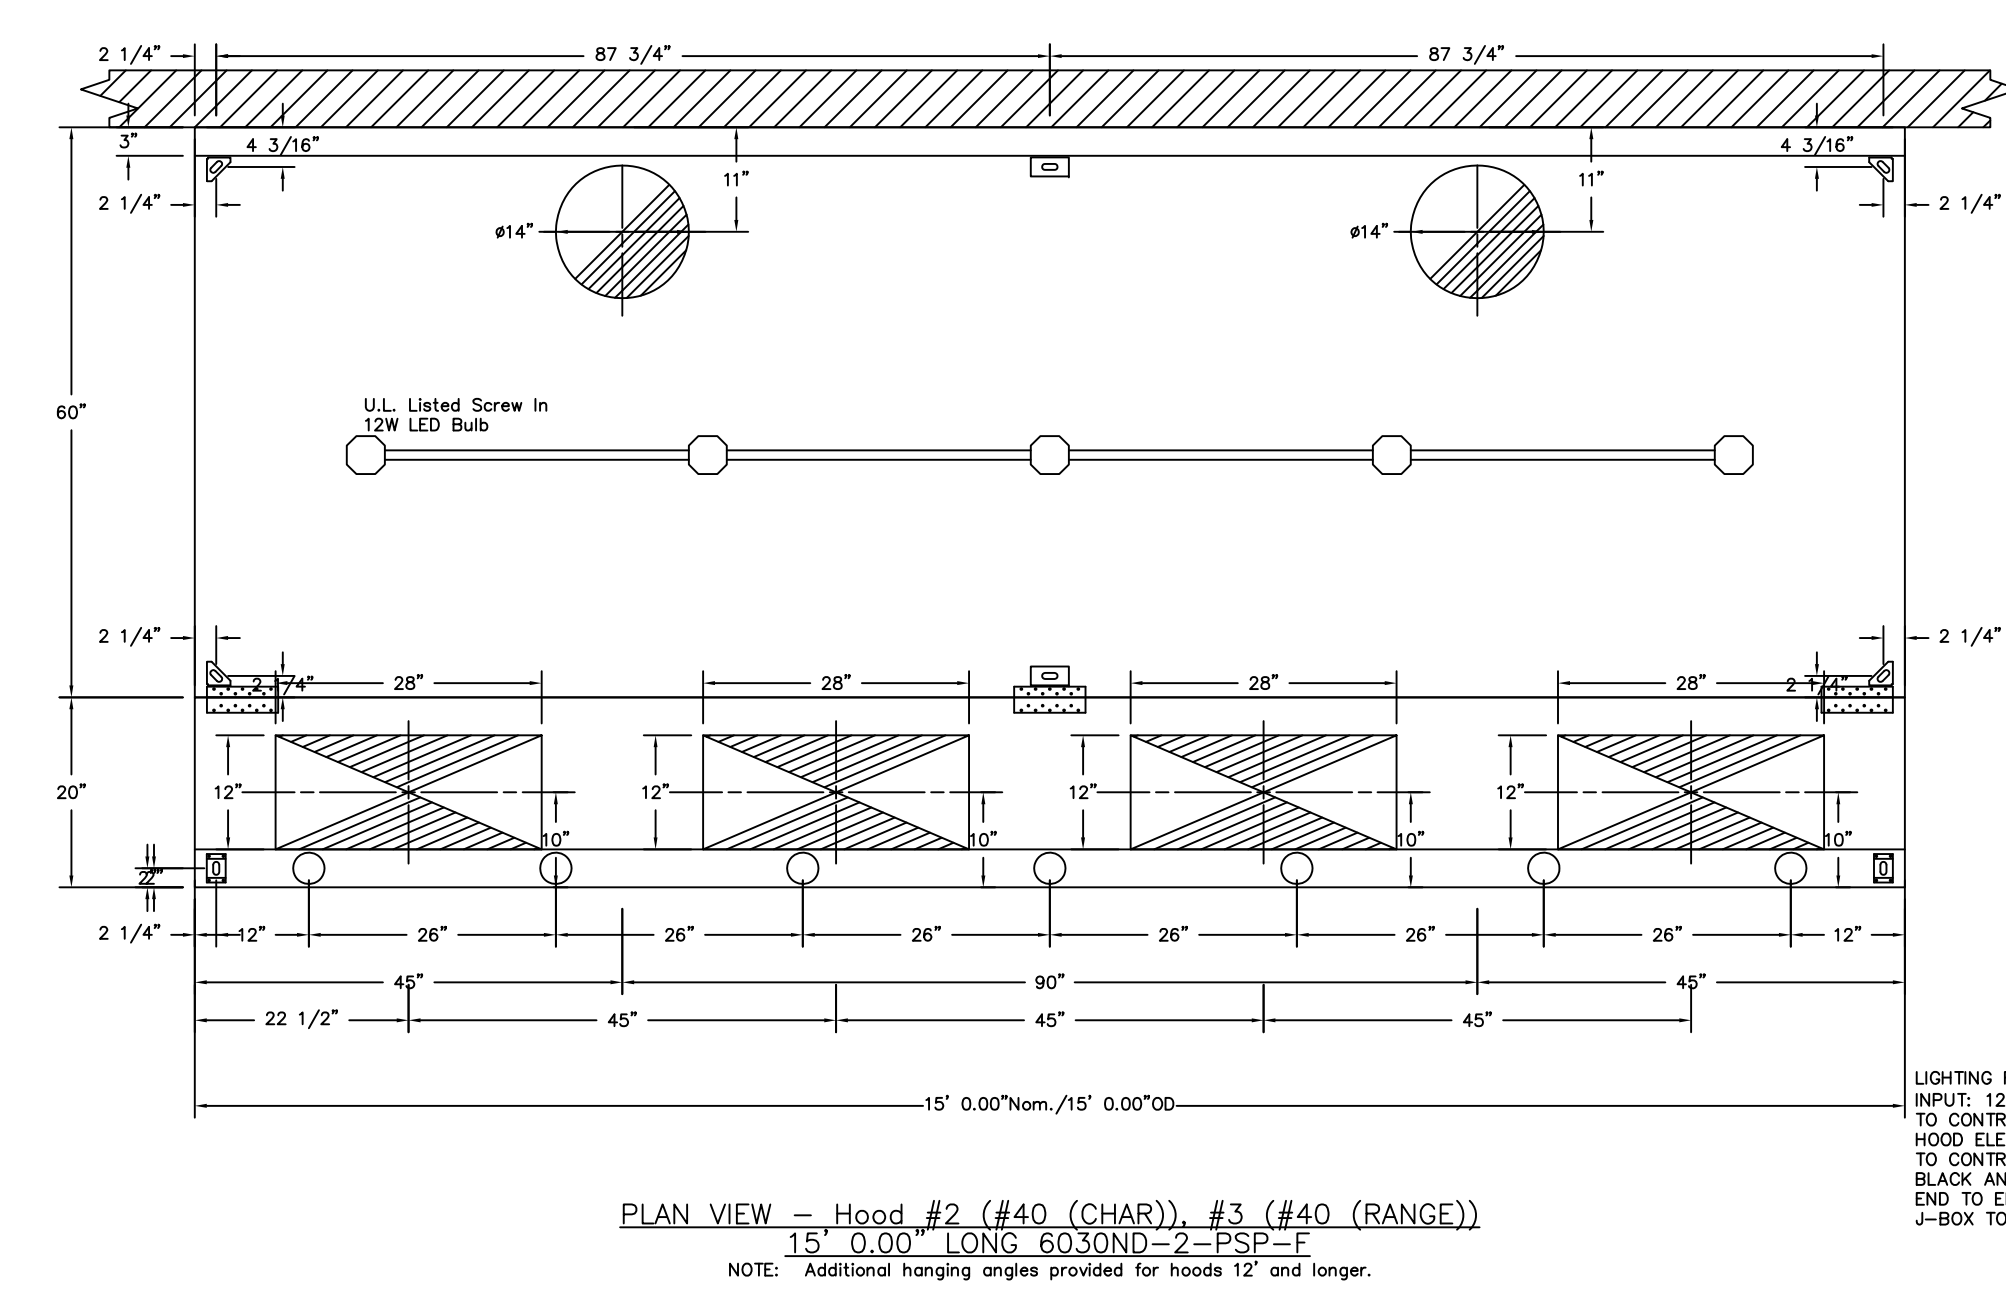

LIGHTING FOR ACSPS Job # 2723392 - Hood #2
 INPUT: 120V AC, 1 Phase, 50/60Hz, 3.5 Watts per light.
 TO CONTROL LIGHTS WITH HOOD LIGHT SWITCH, WIRE PER HOOD ELECTRICAL CONTROL PANEL SCHEMATIC.
 TO CONTROL LIGHTS WITH BUILDING LIGHT SWITCH, WIRE BLACK AND WHITE WIRE TO A 120VAC SERVICE.
 END TO END ACSPS REQUIRE 120VAC FIELD WIRING FROM J-BOX TO J-BOX. REPLACE LIGHTS WITH LED LIGHTS ONLY.

REVISIONS	
DESCRIPTION	DATE

CAPTIVE

MAINE OFFICE
 www.captivefire.com
 PO Box 86, 173 South Rd., Topsham, ME 04480 PHONE: (207) 796-2550 FAX: (919) 227-5848 EMAIL: req2@captivefire.com

Thompson Point r1
 PORTLAND, ME, 04101

DATE: 7/22/2016
 DWG #: 2723392
 DRAWN BY: BFC-21
 SCALE: 3/4" = 1'-0"
 MASTER DRAWING

SHEET NO.
 2

THOMPSON POINT - BRICK SOUTH
 CATERING KITCHEN

THIS DRAWING AND ALL INFORMATION HEREIN ARE THE PROPERTY OF THE DESIGNER AND MAY NOT BE USED OR COPIED, EITHER IN WHOLE OR IN PART, WITHOUT THE EXPRESSED WRITTEN CONSENT OF THE DESIGNER	
REV NO:	REVISIONS:
PROJECT:	DATE:
BRICK SOUTH KITCHEN	
DRAWN BY:	CHECKED BY:
T. MCARDLE	T. MCARDLE
SHEET TITLE:	SHEET NO:
FOODSERVICE EQUIPMENT EXHAUST HOOD DETAILS	FS-6
SCALE: 3/4"=1'-0"	