



NOTE:  
CONTRACTOR SHALL BE REQUIRED TO PROTECT ALL BEARING SOILS FROM EXCESSIVE DISTURBANCE. SHOULD SUBGRADE BECOME YIELDING OR DIFFICULT TO WORK, DISTURBED AREAS SHOULD BE EXCAVATED AND COMPACTED WITH SELECT GRANULAR FILL OR CRUSHED STONE AT NO EXTRA EXPENSE TO THE OWNER. WOVEN GEOTEXTILE TENSILE FABRIC (MIRAFI 600X OR EQUAL) SHALL BE PLACED OVER UNSUITABLE SUBGRADE AS DIRECTED PRIOR TO OR DURING CONSTRUCTION BY THE OWNER'S REPRESENTATIVE, AT NO EXTRA EXPENSE TO THE OWNER.

**A** LIGHT DUTY BITUMINOUS CONCRETE PAVEMENT SECTION  
N.T.S.

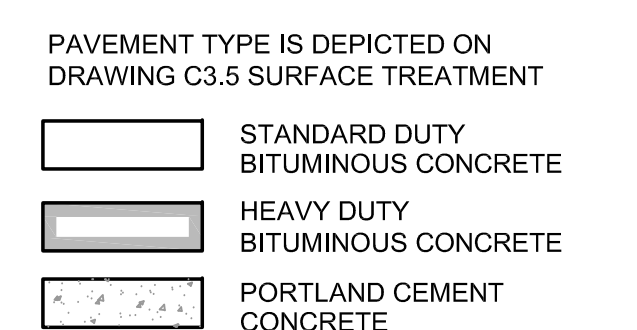


NOTES:  
1. APPLY TACK COAT BETWEEN BINDER AND SURFACE COURSES.  
2. ALL MATERIALS SHALL CONFORM TO MDOT SPECIFICATIONS, LATEST REVISION COMPACTED TO BE IN ACCORDANCE WITH THE SPECIFICATIONS AND GEOTECHNICAL REPORTS PREPARED BY THE GEOTECHNICAL ENGINEER WHICHEVER IS MORE STRINGENT

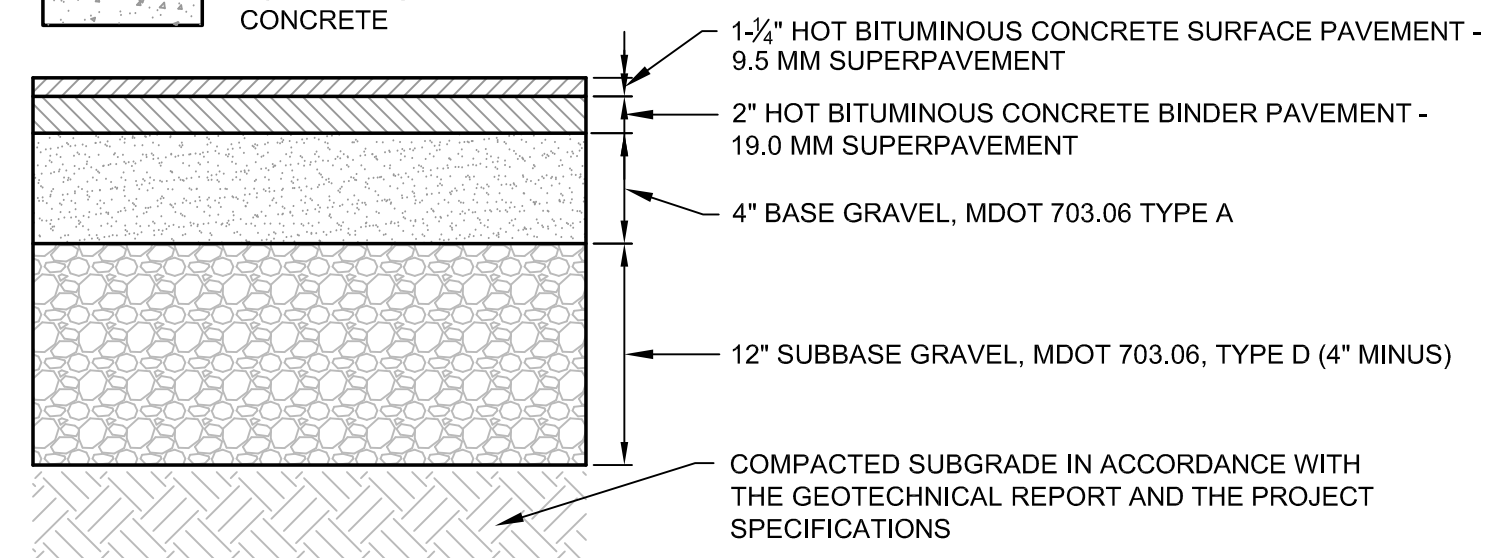


NOTE:  
CONTRACTOR SHALL BE REQUIRED TO PROTECT ALL BEARING SOILS FROM EXCESSIVE DISTURBANCE. SHOULD SUBGRADE BECOME YIELDING OR DIFFICULT TO WORK, DISTURBED AREAS SHOULD BE EXCAVATED AND COMPACTED WITH SELECT GRANULAR FILL OR CRUSHED STONE AT NO EXTRA EXPENSE TO THE OWNER. WOVEN GEOTEXTILE TENSILE FABRIC (MIRAFI 600X OR EQUAL) SHALL BE PLACED OVER UNSUITABLE SUBGRADE AS DIRECTED BY THE OWNER'S REPRESENTATIVE, AT NO EXTRA EXPENSE TO THE OWNER.

**B** STANDARD DUTY BITUMINOUS CONCRETE PAVEMENT SECTION  
N.T.S.

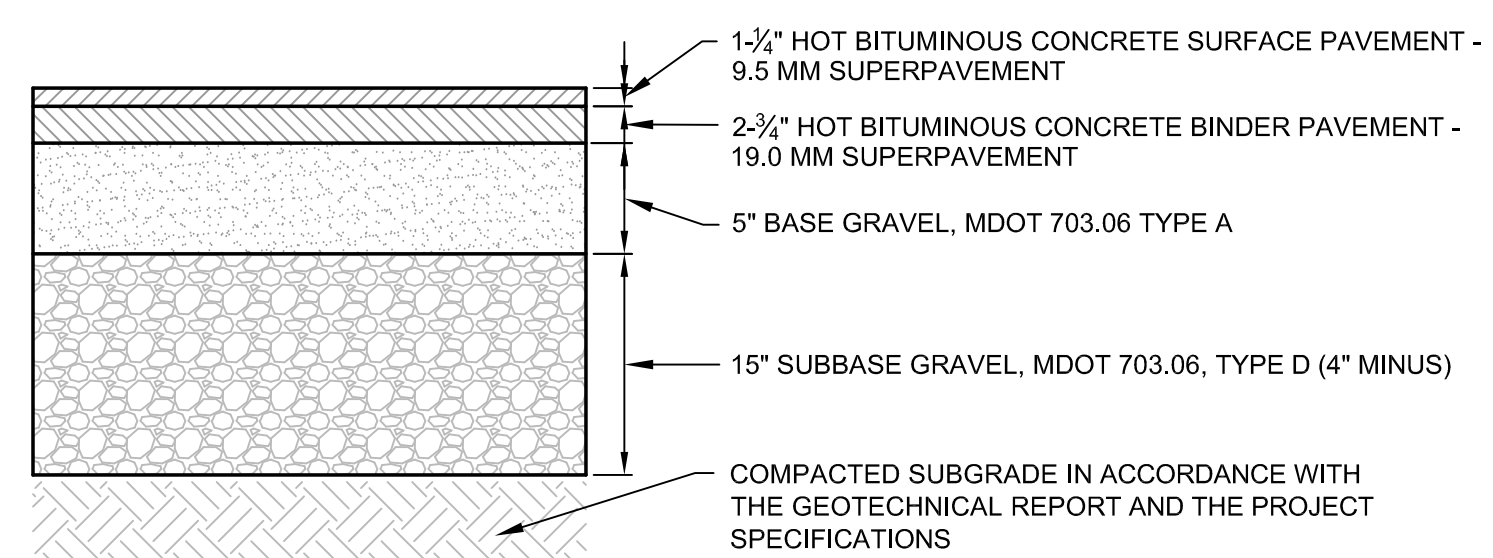


NOTE:  
CONTRACTOR SHALL BE REQUIRED TO PROTECT ALL BEARING SOILS FROM EXCESSIVE DISTURBANCE. SHOULD SUBGRADE BECOME YIELDING OR DIFFICULT TO WORK, DISTURBED AREAS SHOULD BE EXCAVATED AND COMPACTED WITH SELECT GRANULAR FILL OR CRUSHED STONE AT NO EXTRA EXPENSE TO THE OWNER. WOVEN GEOTEXTILE TENSILE FABRIC (MIRAFI 600X OR EQUAL) SHALL BE PLACED OVER UNSUITABLE SUBGRADE AS DIRECTED PRIOR TO OR DURING CONSTRUCTION BY THE OWNER'S REPRESENTATIVE, AT NO EXTRA EXPENSE TO THE OWNER.

**C** HEAVY DUTY BITUMINOUS CONCRETE PAVEMENT SECTION  
N.T.S.

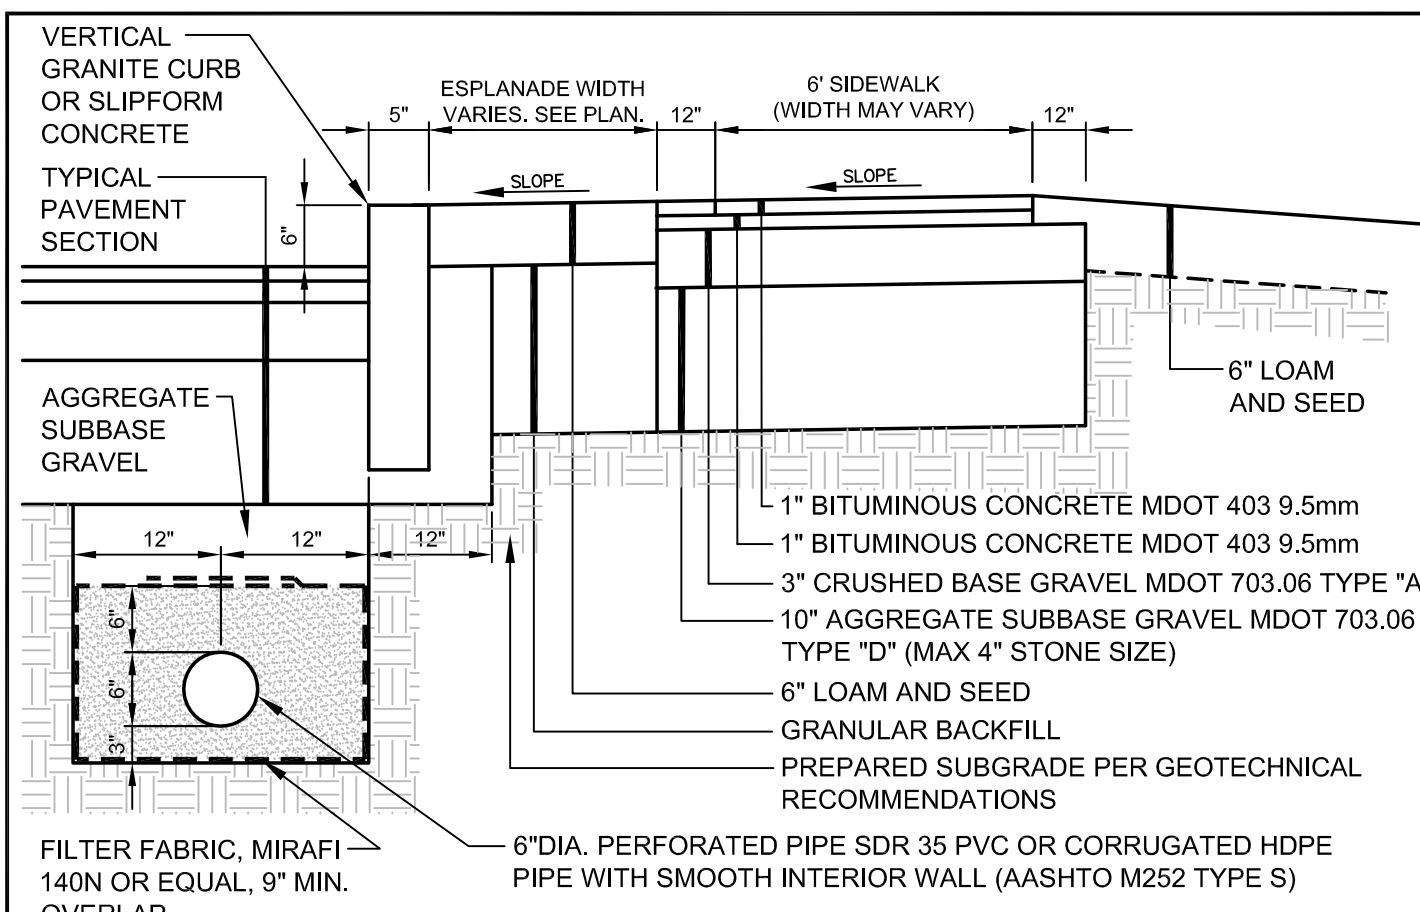


NOTES:  
1. UNDERDRAIN REQUIRED WHERE CALLED FOR ON PLANS OR AS RECOMMENDED BY THE GEOTECHNICAL ENGINEER  
2. UNDERDRAIN PIPE ELEVATIONS SHALL BE AT LEAST 42" BELOW GUTTER GRADE  
3. PERFORATIONS IN UNDERDRAIN SHALL BE ORIENTATED DOWN


**D** BITUMINOUS SIDEWALK DETAIL-CURBED AREAS (WITH ESPLANADE)  
N.T.S.

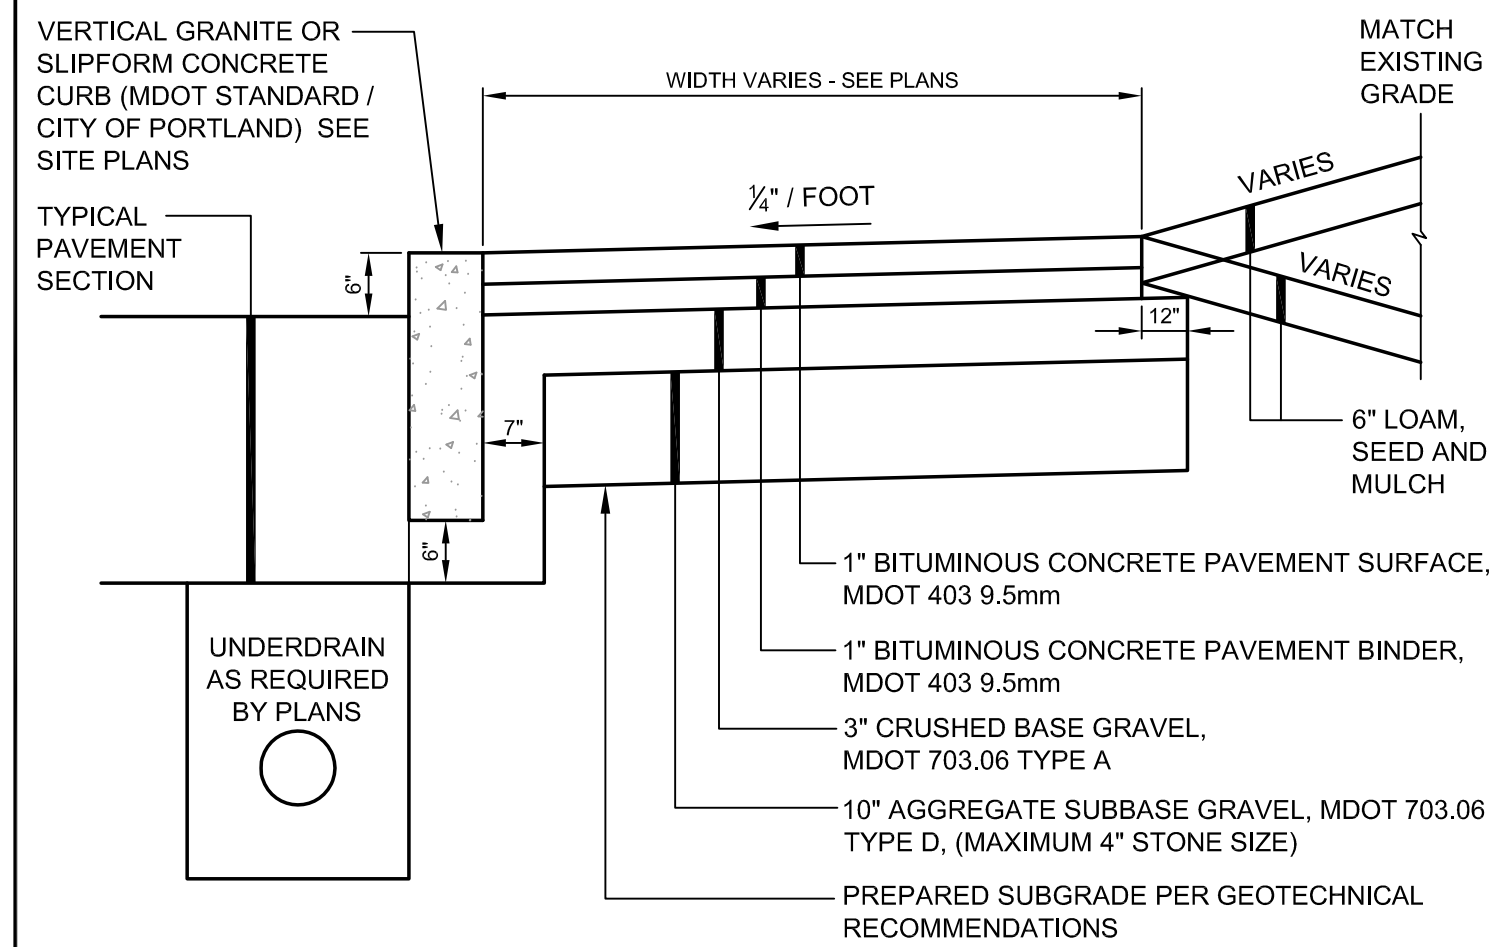


**E** BITUMINOUS SIDEWALK DETAIL-VERTICAL CURB (WITHOUT ESPLANADE)  
N.T.S.

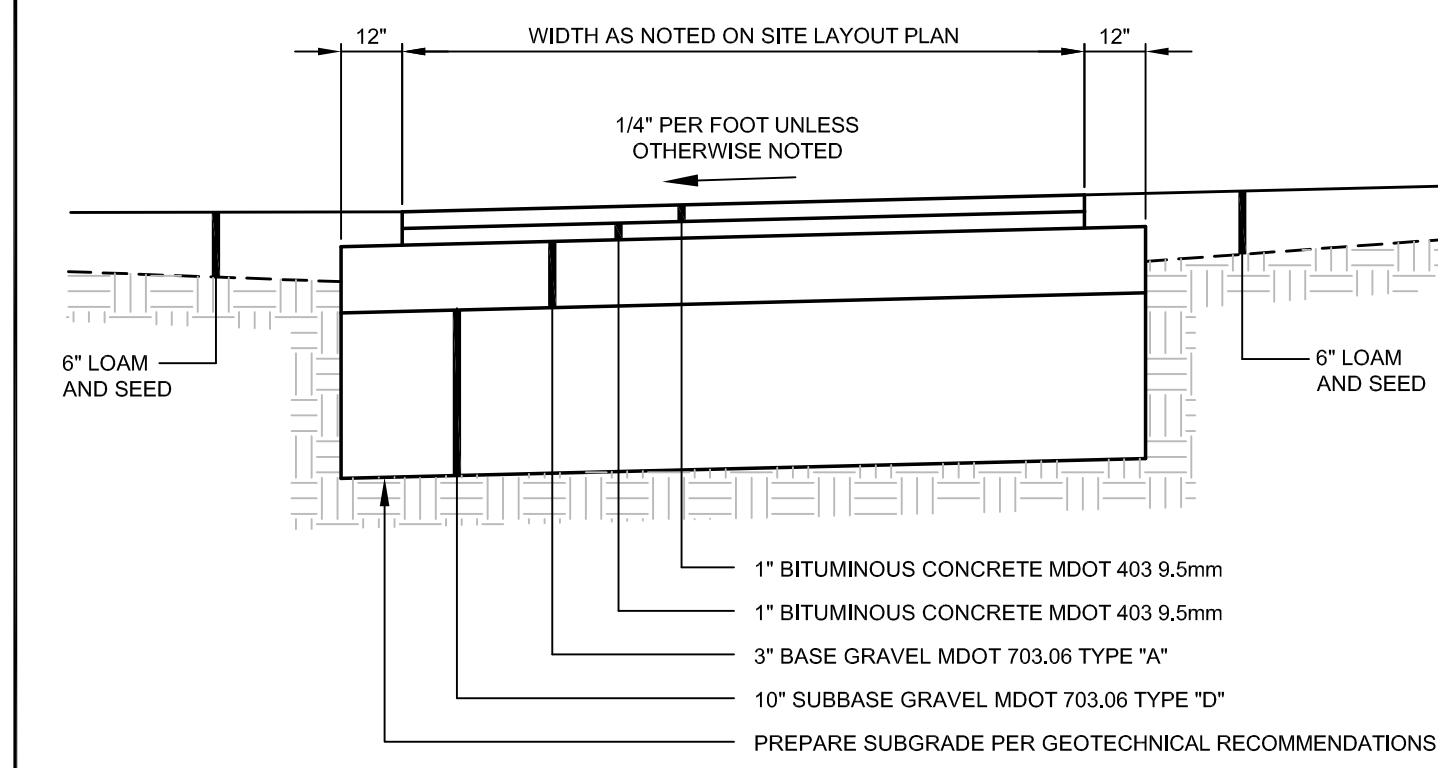


**F** NON-CURBED AREAS BITUMINOUS SIDEWALK/WALKWAY DETAIL  
N.T.S.

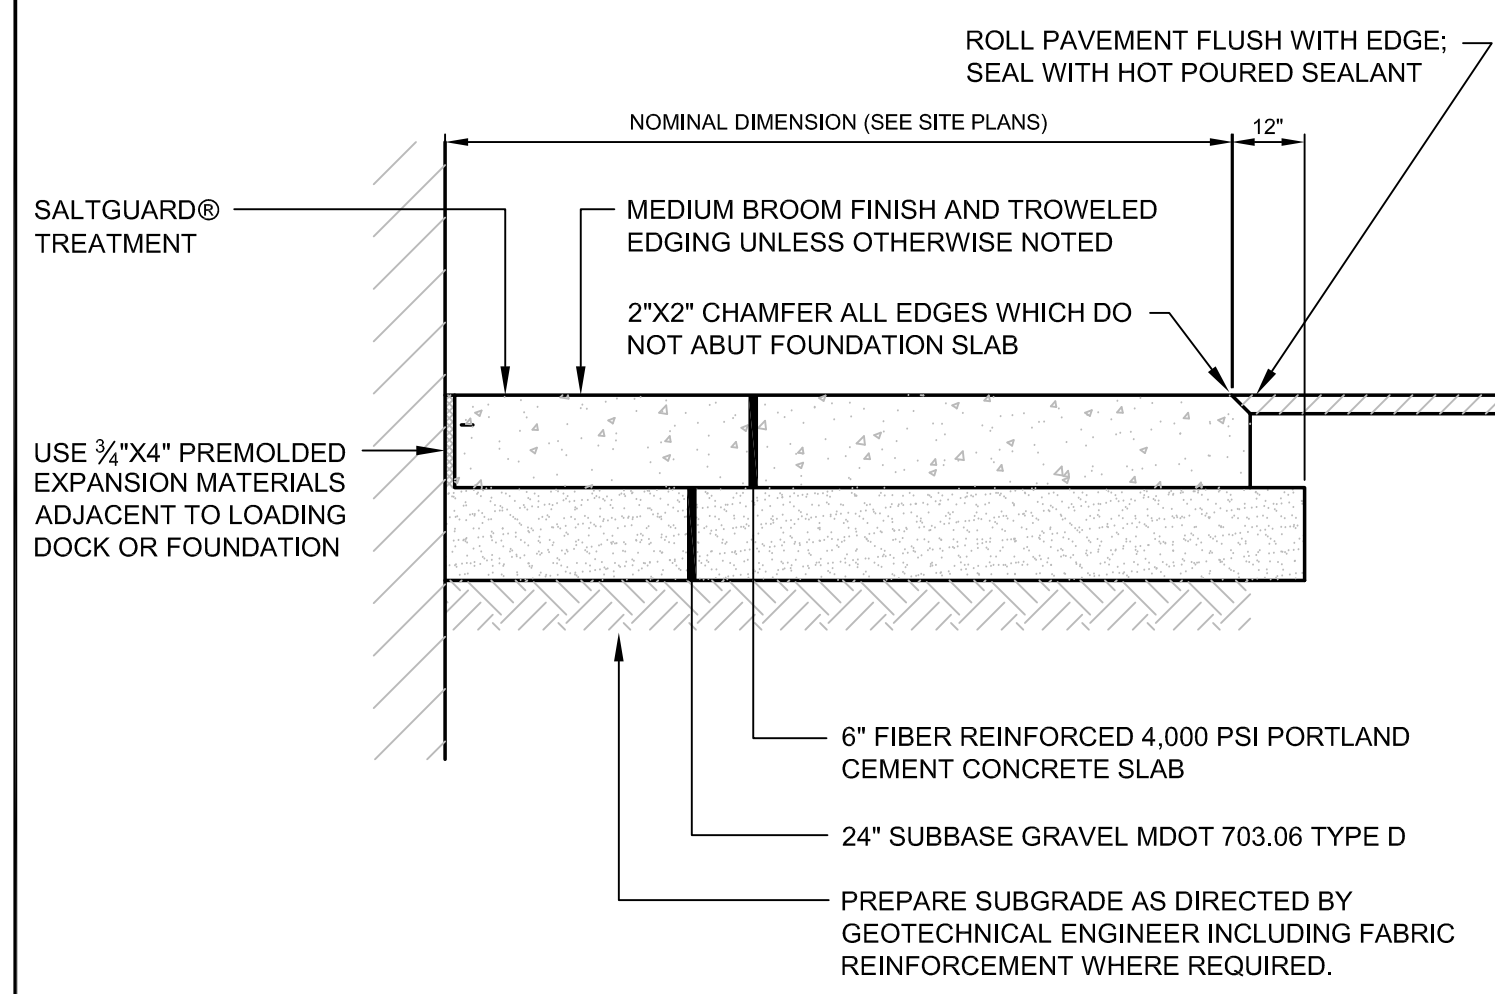


**G** CONCRETE SLAB DETAIL  
N.T.S.

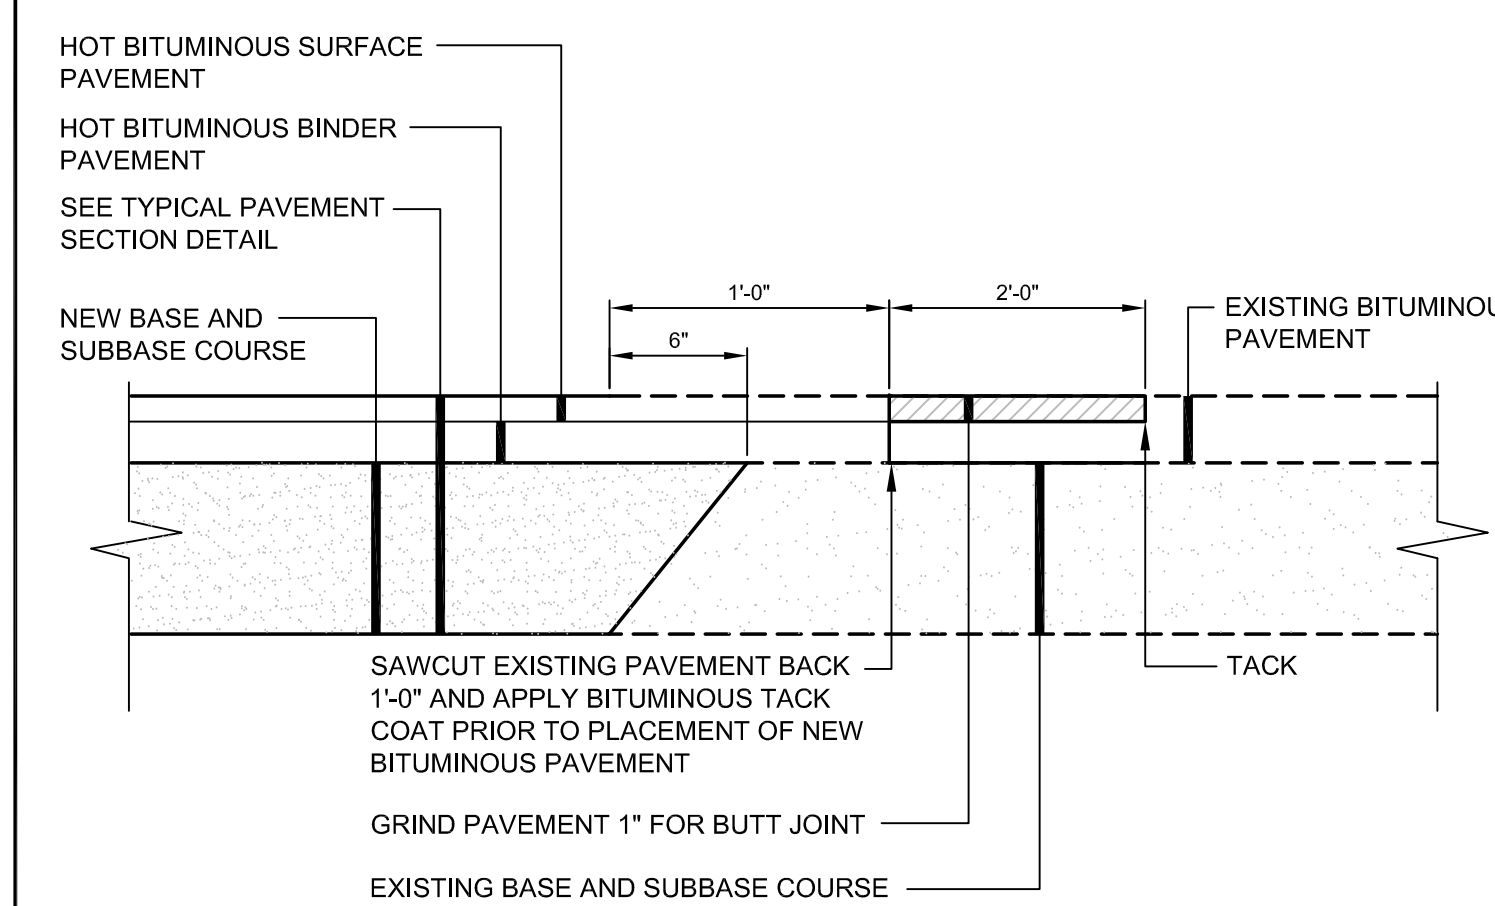

**H** PAVEMENT SAWCUT DETAIL  
N.T.S.

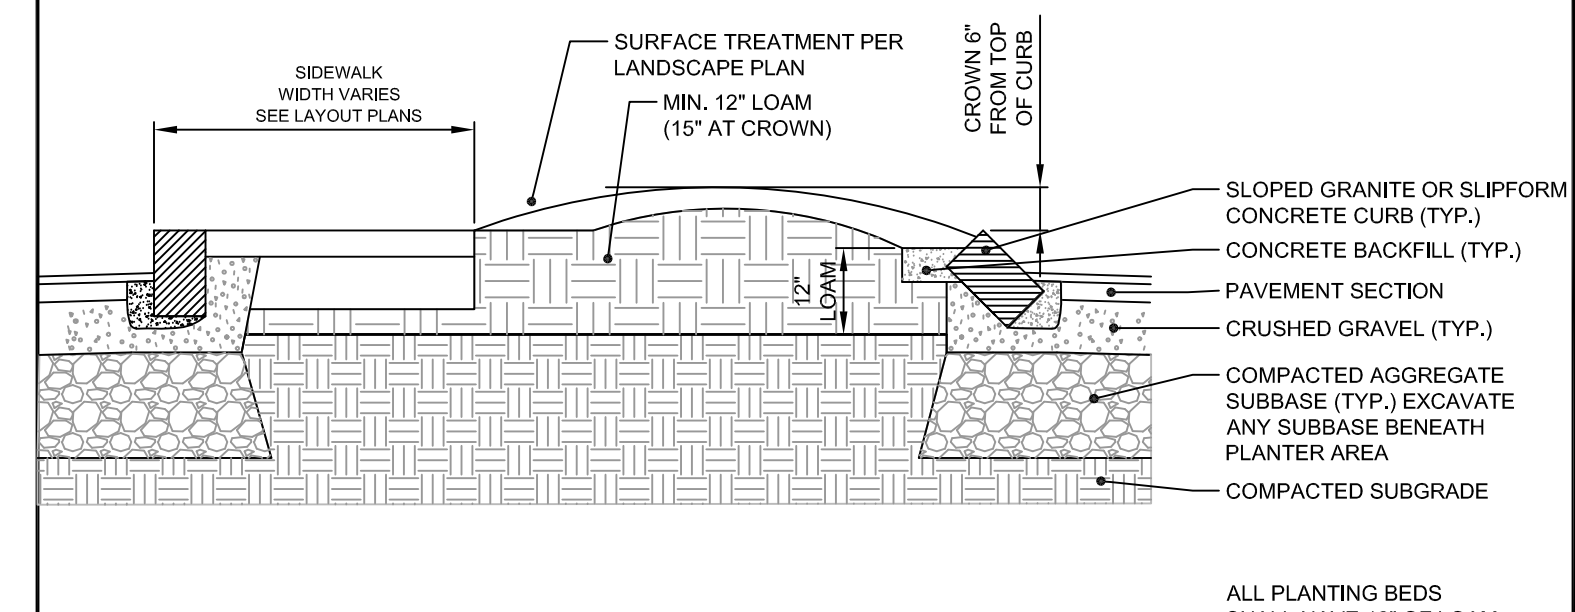


**I** TYPICAL ISLAND PLANTING BEDS WITH SIDEWALK  
N.T.S.

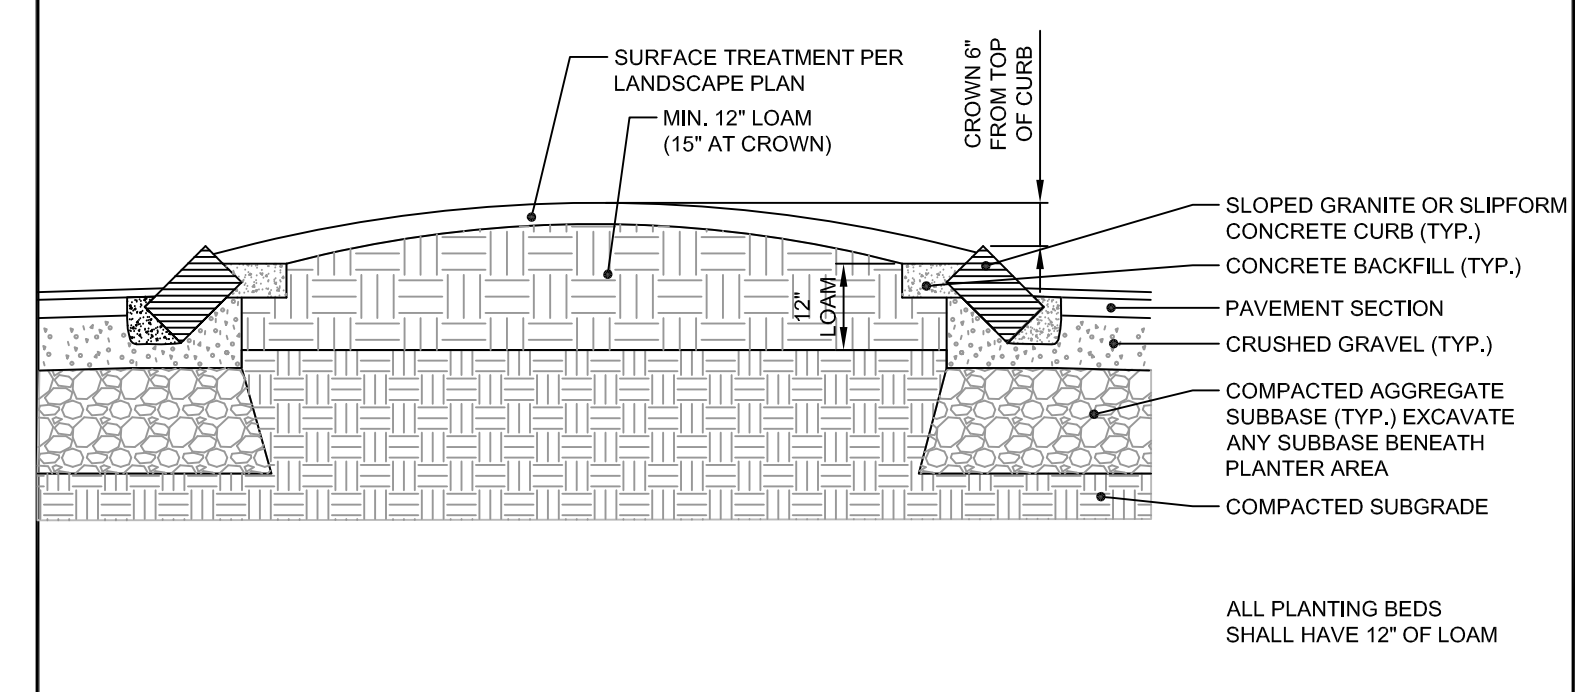

**J** TYPICAL ISLAND PLANTING BEDS WITHOUT SIDEWALK  
N.T.S.

REV	DATE	DESCRIPTION
2	08.17.16	FINAL PLAN SUBMISSION TO CITY
1	09.01.15	FINAL BRICK SOUTH LEVEL III SITE PLAN APPLICATION

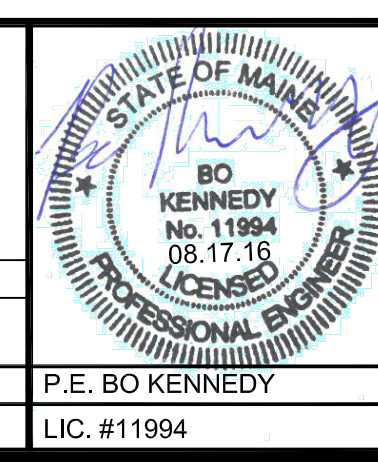

PROJECT  
BRICK NORTH AND SOUTH BUILDINGS AT THE FOREFRONT AT THOMPSON'S POINT  
SHEET TITLE  
PAVEMENT SECTIONS AND SIDEWALK DETAILS  
CLIENT  
FOREFRONT PARTNERS | LP

STANTEC CONSULTING SERVICES INC.  
482 PAYNE ROAD  
SCARBOROUGH, ME 04074  
WWW.STANTEC.COM  
DRAWN: DED DATE: APRIL 2015  
DESIGNED: BEK SCALE: AS NOTED  
CHECKED: SRB JOB NO. 195350044  
FILE NAME: 2982.05-B5 DET SHEET  
C-8.0