

... Fire Protection by Computer Design

HIGH TECH FIRE PROTECTION
84 HACKETT MILLS ROAD
P.O. BOX 156
POLAND, ME 04274
207-998-2551

Job Name : Brick South Function Area #1
Drawing : FP-01 REVISED
Location : Thompsons Point
Remote Area : #1
Contract :
Data File : Function area 1 REVISED NO STEEL PROTECTION.WXF

HYDRAULIC CALCULATIONS
for

Project name: Brick South Function Area #1
Location: Thompsons Point
Drawing no: FP-01 REVISED
Date: 1-16-17

Design

Remote area number: #1
Remote area location: Function Area
Occupancy classification: Ordinary Hazard 1
Density: .15 - Gpm/SqFt
Area of application: 1500 - SqFt
Coverage per sprinkler: 121 - SqFt
Type of sprinklers calculated: quick response upright
No. of sprinklers calculated: 13
In-rack demand: n/a - GPM
Hose streams: 250 - GPM
Total water required (including hose streams): 497 - GPM @ 56 - Psi
Type of system: Wet System
Volume of dry or preaction system: n/a - Gal

Water supply information

Date: 9-13-15
Location: Sewall Road
Source: Portland Water District

Name of contractor: HIGH TECH FIRE PROTECTION
Address: 84 HACKETT MILLS ROAD / P.O. BOX 156 / POLAND, ME 04274
Phone number: 207-998-2551
Name of designer: Ed Poulin
Authority having jurisdiction: State of Maine / City of Portland
Notes: (Include peaking information or gridded systems here.)


Water Supply Curve (C)

HIGH TECH FIRE PROTECTION
Brick South Function Area #1

Page 2
Date 1-16-17

City Water Supply:
C1 - Static Pressure : 98
C2 - Residual Pressure: 92
C2 - Residual Flow : 1519

Demand:
D1 - Elevation : 19.056
D2 - System Flow : 246.109
D2 - System Pressure : 55.174
Hose (Demand) : 250
D3 - System Demand : 496.109
Safety Margin : 42.069

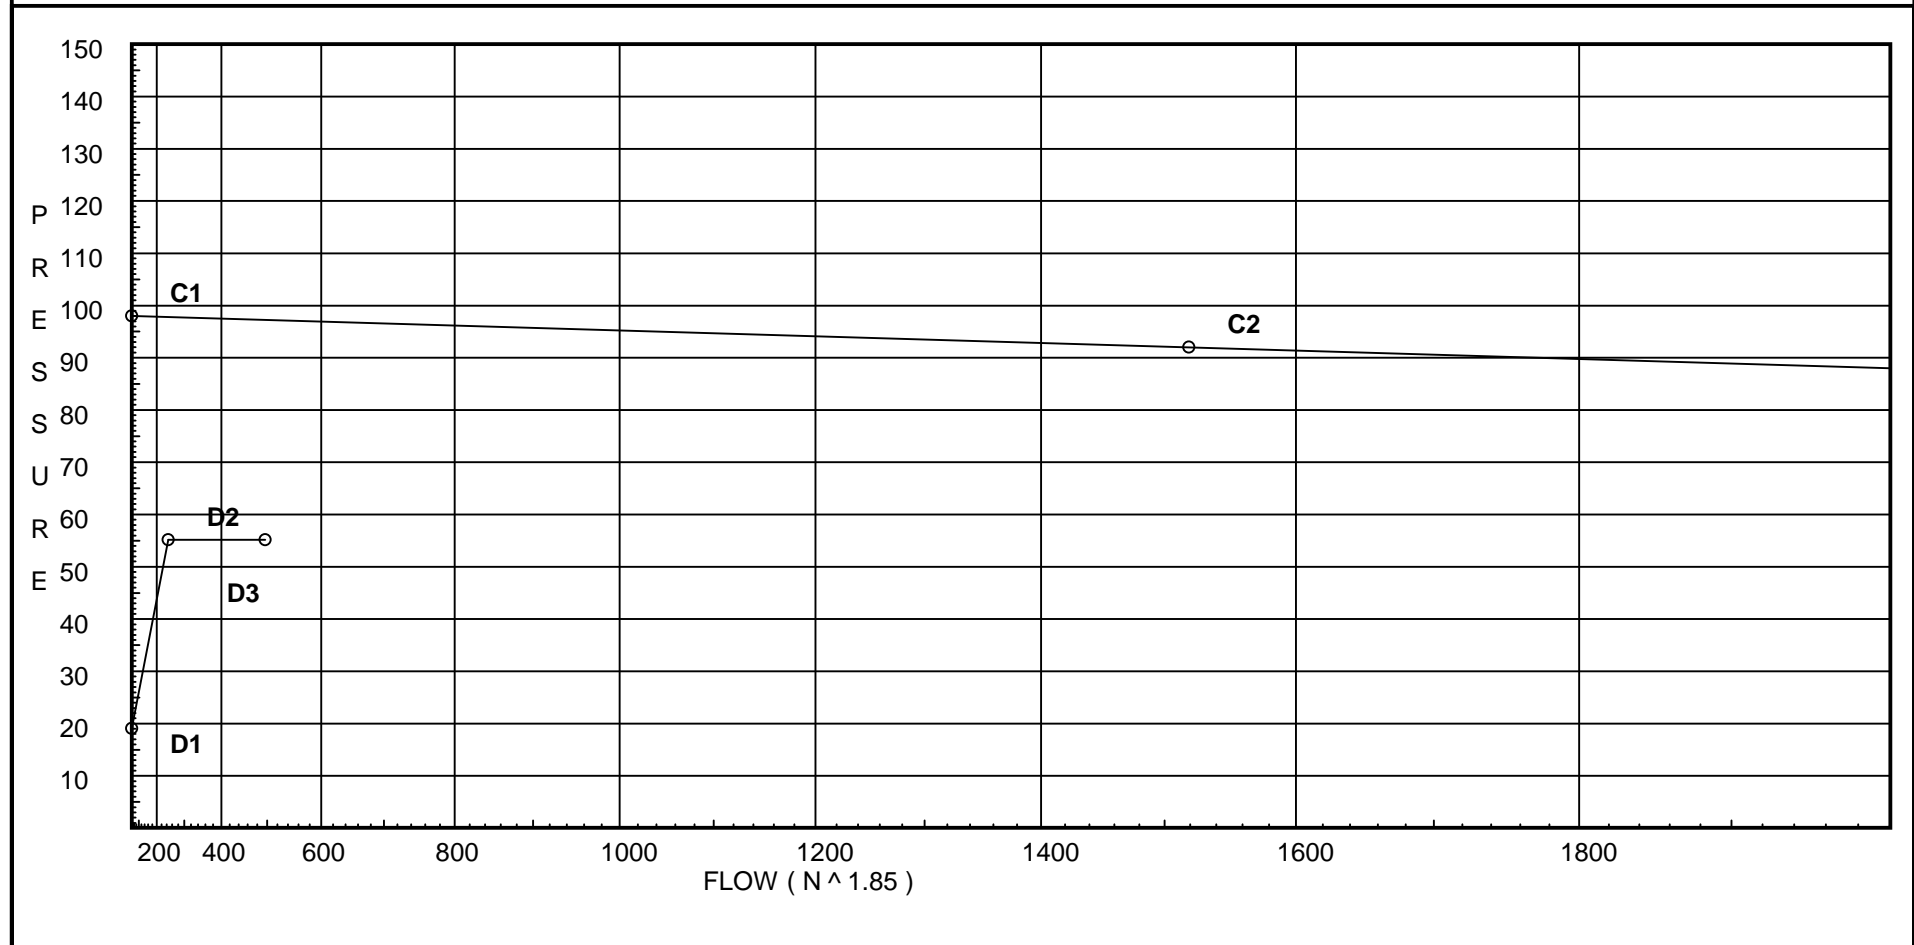

Fittings Used Summary

HIGH TECH FIRE PROTECTION
Brick South Function Area #1

Page 3
Date 1-16-17

Fitting Legend

Abbrev.	Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
E	NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
Fsp	Flow Switch Potter VSR	Fitting generates a Fixed Loss Based on Flow																			
G	NFPA 13 Gate Valve	0	0	0	0	1	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
T	NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
V	90' Ell Firelock #001	0	0	0	0	3.5	3.5	4.3	5	0	6.8	8.5	10	13	0	0	0	0	0	0	0
X	90'Tee-BranchFirelock002	0	0	0	0	8	8.5	10.8	13	0	16	21	25	33	0	0	0	0	0	0	0
Zib	Wilkins 350A	Fitting generates a Fixed Loss Based on Flow																			

Units Summary

Diameter Units	Inches
Length Units	Feet
Flow Units	US Gallons per Minute
Pressure Units	Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Pressure / Flow Summary - STANDARD

HIGH TECH FIRE PROTECTION
Brick South Function Area #1

Page 4
Date 1-16-17

Node No.	Elevation	K-Fact	Pt Actual	Pn	Flow Actual	Density	Area	Press Req.
10	25.0	5.6	10.5	na	18.15	0.15	121	7.0
11	25.0	5.6	10.62	na	18.25	0.15	121	7.0
12	25.0	5.6	11.06	na	18.62	0.15	121	7.0
13	25.0	5.6	11.99	na	19.39	0.15	121	7.0
14	25.0		13.19	na				
20	25.0	5.6	10.55	na	18.19	0.15	121	7.0
21	25.0	5.6	10.67	na	18.29	0.15	121	7.0
22	25.0	5.6	11.11	na	18.66	0.15	121	7.0
23	25.0	5.6	12.05	na	19.44	0.15	121	7.0
24	25.0		13.25	na				
30	25.0	5.6	10.72	na	18.34	0.15	121	7.0
31	25.0	5.6	10.84	na	18.44	0.15	121	7.0
32	25.0	5.6	11.29	na	18.81	0.15	121	7.0
33	25.0	5.6	12.24	na	19.59	0.15	121	7.0
34	25.0		13.46	na				
43	25.0	5.6	15.32	na	21.92	0.15	121	7.0
44	25.0		15.44	na				
15	24.0		15.24	na				
25	24.0		15.31	na				
35	24.0		15.54	na				
45	24.0		16.04	na				
50	24.0		22.18	na				
51	20.0		24.49	na				
TOR	20.0		30.15	na				
FLW	7.0		39.06	na				
BOR	0.0		45.62	na				
BASE	0.0		46.24	na				
HOSE	0.0		46.49	na	250.0			
TEST	-19.0		55.17	na				

The maximum velocity is 10.86 and it occurs in the pipe between nodes 33 and 34

Final Calculations - Hazen-Williams

HIGH TECH FIRE PROTECTION
Brick South Function Area #1

Page 5
Date 1-16-17

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
10	18.15	1.682		0.0	11.000	10.504				
to		120.0		0.0	0.0	0.0			K Factor = 5.60	
11	18.15	0.0109		0.0	11.000	0.120				Vel = 2.62
11	18.25	1.682		0.0	11.000	10.624				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
12	36.4	0.0395		0.0	11.000	0.435				Vel = 5.26
12	18.63	1.682		0.0	11.000	11.059				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
13	55.03	0.0849		0.0	11.000	0.934				Vel = 7.95
13	19.39	1.682	1V	4.331	3.750	11.993				K Factor = 5.60
to		120.0		0.0	4.331	0.0				
14	74.42	0.1485		0.0	8.081	1.200				Vel = 10.75
14	0.0	1.682	1T	9.9	1.000	13.193				
to		120.0		0.0	9.900	0.433				
15	74.42	0.1484		0.0	10.900	1.618				Vel = 10.75
	0.0									
	74.42					15.244				K Factor = 19.06
20	18.19	1.682		0.0	11.000	10.552				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
21	18.19	0.0109		0.0	11.000	0.120				Vel = 2.63
21	18.30	1.682		0.0	11.000	10.672				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
22	36.49	0.0397		0.0	11.000	0.437				Vel = 5.27
22	18.66	1.682		0.0	11.000	11.109				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
23	55.15	0.0853		0.0	11.000	0.938				Vel = 7.96
23	19.44	1.682	1V	4.331	3.750	12.047				K Factor = 5.60
to		120.0		0.0	4.331	0.0				
24	74.59	0.1490		0.0	8.081	1.204				Vel = 10.77
24	0.0	1.682	1T	9.9	1.000	13.251				
to		120.0		0.0	9.900	0.433				
25	74.59	0.1491		0.0	10.900	1.625				Vel = 10.77
	0.0									
	74.59					15.309				K Factor = 19.06
30	18.34	1.682		0.0	11.000	10.722				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
31	18.34	0.0112		0.0	11.000	0.123				Vel = 2.65
31	18.44	1.682		0.0	11.000	10.845				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
32	36.78	0.0403		0.0	11.000	0.443				Vel = 5.31
32	18.81	1.682		0.0	11.000	11.288				K Factor = 5.60
to		120.0		0.0	0.0	0.0				
33	55.59	0.0865		0.0	11.000	0.952				Vel = 8.03
33	19.59	1.682	1V	4.331	3.750	12.240				K Factor = 5.60
to		120.0		0.0	4.331	0.0				
34	75.18	0.1512		0.0	8.081	1.222				Vel = 10.86
34	0.0	1.682	1T	9.9	1.000	13.462				
to		120.0		0.0	9.900	0.433				
35	75.18	0.1513		0.0	10.900	1.649				Vel = 10.86

Final Calculations - Hazen-Williams

HIGH TECH FIRE PROTECTION
Brick South Function Area #1

Page 6
Date 1-16-17

Hyd. Ref. Point	Qa Qt	Dia. "C" Pf/Ft	Fitting or Eqv.	Ln.	Pipe Ftng's Total	Pt Pe Pf	Pt Pv Pn	*****	Notes	*****
	0.0 75.18						15.544		K Factor = 19.07	
43 to 44	21.92	1.682 120.0	1V	4.331 0.0	3.750 4.331	15.318 0.0			K Factor = 5.60	
44 to 45	21.92	0.0155		0.0	8.081	0.125			Vel = 3.17	
44 to 45	0.0	1.682 120.0	1T	9.9 0.0	1.000 9.900	15.443 0.433				
	21.92	0.0154		0.0	10.900	0.168			Vel = 3.17	
	0.0 21.92						16.044		K Factor = 5.47	
15 to 25	74.42	3.26 120.0		0.0 0.0	11.000 0.0	15.244 0.0				
25 to 35	74.42	0.0059		0.0	11.000	0.065			Vel = 2.86	
25 to 35	74.59	3.26 120.0		0.0 0.0	11.000 0.0	15.309 0.0				
	149.01	0.0214		0.0	11.000	0.235			Vel = 5.73	
35 to 45	75.18	3.26 120.0		0.0 0.0	11.000 0.0	15.544 0.0				
	224.19	0.0455		0.0	11.000	0.500			Vel = 8.62	
45 to 50	21.92	3.26 120.0	1X	17.471 0.0	96.000 17.471	16.044 0.0				
	246.11	0.0541		0.0	113.471	6.134			Vel = 9.46	
50 to 51	0.0	3.26 120.0	1V	6.72 0.0	4.000 6.720	22.178 1.732				
	246.11	0.0541		0.0	10.720	0.580			Vel = 9.46	
51 to TOR	0.0	3.26 120.0	1V	6.72 0.0	98.000 6.720	24.490 0.0				
	246.11	0.0541		0.0	104.720	5.661			Vel = 9.46	
TOR to FLW	0.0	4.26 120.0	1Fsp	0.0 0.0	19.000 0.0	30.151 8.630			* Fixed loss = 3	
	246.11	0.0147		0.0	19.000	0.280			Vel = 5.54	
FLW to BOR	0.0	4.26 120.0	1Zib	0.0 0.0	5.000 0.0	39.061 6.490			* Fixed loss = 3.458	
	246.11	0.0146		0.0	5.000	0.073			Vel = 5.54	
BOR to BASE	0.0	6.16 140.0	1G 2E	4.304 40.168	250.000 87.509	45.624 0.0				
	246.11	0.0018	1T	43.037	337.509	0.619			Vel = 2.65	
BASE to HOSE	0.0	8.27 140.0		0.0 0.0	560.000 0.0	46.243 0.0				
	246.11	0.0004		0.0	560.000	0.244			Vel = 1.47	
HOSE to TEST	250.00	12.46 100.0	1G 1E	5.275 23.735	1050.000 81.754	46.487 8.229			Qa = 250	
	496.11	0.0004	1T	52.745	1131.754	0.458			Vel = 1.31	
	0.0 496.11						55.174		K Factor = 66.79	