

SCHEDULE OF SILT FENCE REQUIREMENTS

SILT FENCE	TYPE PURPOSE	TIME OF INSTALLATION	
——— SB1 ——— TYPE 1 SILT FENCE	TO TRAP SEDIMENT ALONG THE GRADING EDGE WHERE THE NEW CONTOURS NEARLY PARALLEL THE EXISTING CONTOURS	AT INITIAL SITE PREPARATION; PRIOR TO OTHER WORK	

ALL RUNOFF FROM DISTURBED AREAS SHALL BE DIRECTED TO A FILTERING DEVICE DESIGNATED TO LIMIT TURBIDITY IN ALL DISCHARGE TO THE FORE RIVER. THE FILTERING DEVICE MAY BE BUT IS NOT LIMITED TO SAND FILTERS, EROSION CONTROL MIX, STRAW WHATTLES, FLOCCULATION CHEMICALS, DIRT GLUE AND SILT FENCE


ALL CATCH BASINS TO HAVE 4" UNDERDRAIN PER DETAIL `L' ON SHEET C-8.5 ALL SUBSURFACE DETENTION AREAS ARE NOT TO BE PLACED "ON-LINE" UNTIL TRIBUTARY AREA IS

STABILIZED WITH PAVEMENT OR 75% VEGETATION COVERAGE 4. STOCKPILES TO BE TEMPORARILY SEEDED AND MULCHED AS REQUIRED BY THE PROJECT

5. THE CONTRACTOR SHALL TREAT DISTURBED AREAS AND CONSTRUCTION HAUL PATH WITH DUST CONTROL BMPS TO LIMIT ALL FUGITIVE DUST

Summary of Storm Water Discharges						
Discharge ID	Approximate Drainage Area (Ac)	Full Build Out 25 Yr Peak Flow (CFS)	Outlet Pipe Size (In)	Description	*Minimum Required Riprap D50 (IN)	
F0	1.88	9.6	36	RCP Flared End W/ Bar Rack, Riprap Slope Apron	12	
D0	0.99	20.21	36	RCP Flared End W/ Bar Rack, Riprap Slope Apron	12	
D0.1	1.4	0.018	12	HDPE Flared End, Riprap Slope Apron	Existing	

size of the D50. The contractor shall protect existing riprap slope or replace rock to the meet the minimum required

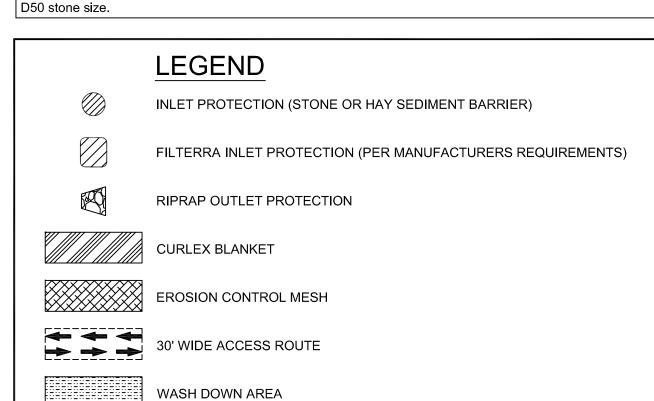

STONE CONSTRUCTION ENTRANCE