

## STORMTECH® SC-740™ CHAMBER SYSTEMS MATERIAL LOCATION DESCRIPTION AASHTO M43 AASHTO M145 COMPACTION/DENSITY DESIGNATION DESIGNATION REQUIREMENT FILL MATERIAL FROM 18" TO GRADE ABOVE ANY SOIL/ROCK MATERIALS, NATIVE SOILS OR PREPARE PER ENGINEER'S PLANS. PAVED INSTALLATIONS CHAMBERS PER ENGINEER'S PLANS. CHECK PLANS FOR MAY HAVE STRINGENT MATERIAL AND PREPARATION PAVEMENT SUBGRADE REQUIREMENTS. REQUIREMENTS. GRANULAR WELL-GRADED SOIL/AGGREGATE 3, 357, 4, 467, 5, COMPACT IN 6" LIFTS TO A MINIMUM 95% STANDARD PROCTOR FILL MATERIAL FOR 6" TO 18" ELEVATION MIXTURES, <35% FINES. 56, 57, 6, 67, 68, 7, DENSITY. ROLLER GROSS VEHICLE WEIGHT NOT TO EXCEED ABOVE CHAMBERS (24" FOR UNPAVED 78, 8, 89, 9, 10 12,000 LBS. DYNAMIC FORCE NOT TO EXCEED 20,000 LBS. INSTALLATIONS) WASHED ANGULAR STONE WITH THE MAJORITY 3, 357, 4, 467, 5, 56, N/A (B) EMBEDMENT STONE SURROUNDING AND TO A NO COMPACTION REQUIRED OF PARTICLES BETWEEN 3/4 - 2 INCH 6" ELEVATION ABOVE CHAMBERS

PLEASE NOTE: THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE WASHED CRUSHED ANGULAR. FOR EXAMPLE, THE STONE MUST BE SPECIFIED AS WASHED, CRUSHED, ANGULAR NO. 4 STONE.

3, 357, 4, 467, 5,

WASHED ANGULAR STONE WITH THE MAJORITY

OF PARTICLES BETWEEN 3/4 - 2 INCH

(A) FOUNDATION STONE BELOW CHAMBERS

B STORMTECH® ACCEPTABLE FILL MATERIALS N.T.S.	NOTES:  1. THE INSTALLATION OF STORMTECH® CHAMBERS SHALL BE IN ACCORDANCE WITH THE LATEST STORMTECH® INSTALLATION INSTRUCTIONS  2. THE CONTRACTOR IS ADVISED TO REVIEW AND UNDERSTAND THE INSTALLATION INSTRUCTIONS PRIOR TO BEGINNING SYSTEM INSTALLATION. CALL 1.888.892.2694 OR VISIT WWW.STORMTECH.COM TO RECEIVE A COPY OF THE LATEST STORMTECH® INSTALLATION INSTRUCTIONS.
CATCH BASIN OR MANHOLE WITH OVERFLOW WEIR	INSPECTION PORT, TYP.  COVER ENTIRE ROW WITH NON-WOVEN ADS™ 601 GEOTEXTILE OR EQUAL SC-740—8' WIDE STRIP, SC-310—5' WIDE STRIP  STORMTECH® END CAP  INSPECTION MANHOLE

WOVEN GEOTEXTILE THAT MEETS ADS 9530TK GEOTEXTILE OR EQUAL, —

BETWEEN FOUNDATION STONE AND CHAMBERS THE ENTIRE LENGTH

SC-740--5'-6' WIDE STRIP


FOR STORMTECH® INFORMATION CALL 1-888-892-2694

ADS 601 NON-WOVEN GEOTEXTILE (OR EQUAL)

BETWEEN STONE AND SAND CUSHION

 FLOOR BOX FRAME AND LID W/S.S. ONE INSPECTION PORT IS REQUIRED FOR CAP SCREW **LI**D C**L**OSURE EVERY 500 S.F. OF STORMTECH® CHAMBERS - CLEANOUT WITH SCREW-IN CAP CLASS "C" CONCRETE PAVEMENT ---\_ ADS™ 601 GEOTEXTILE OR EQUAL 4" PVC RISER — SC-740™ CHAMBER — INSPECTION PORT TO BE ATTACHED THROUGH WOVEN ADS™ 9530TK-KNOCK-OUT LOCATED GEOTEXTILE OR EQUAL AT CENTER OF CHAMBER (ENTIRE LENGTH OF 30 MIL LINEAR LOW DENSITY CHAMBER) POLYETHYLENE LINER SANDWICHED BETWEEN 8 oz. FILTER FABRIC ADS 601 GEOTEXTILE OR EQUAL -— TWO 4" SAND LAYERS

STORMTECH® ISOLATOR ROW DETAIL

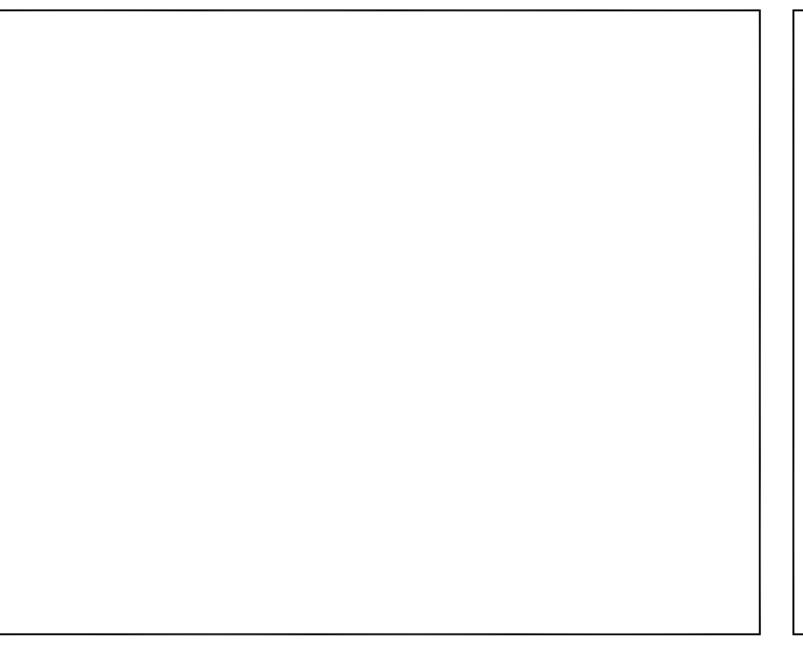


— TWO 4" SAND LAYERS


— 30 MIL LINEAR LOW DENSITY POLYETHYLENE LINER SANDWICHED BETWEEN 8 oz. FILTER FABRIC

FOR STORMTECH® INFORMATION CALL 1-888-892-2694

PLATE COMPACT OR ROLL TO ACHIEVE A 95%

STANDARD PROCTOR DENSITY

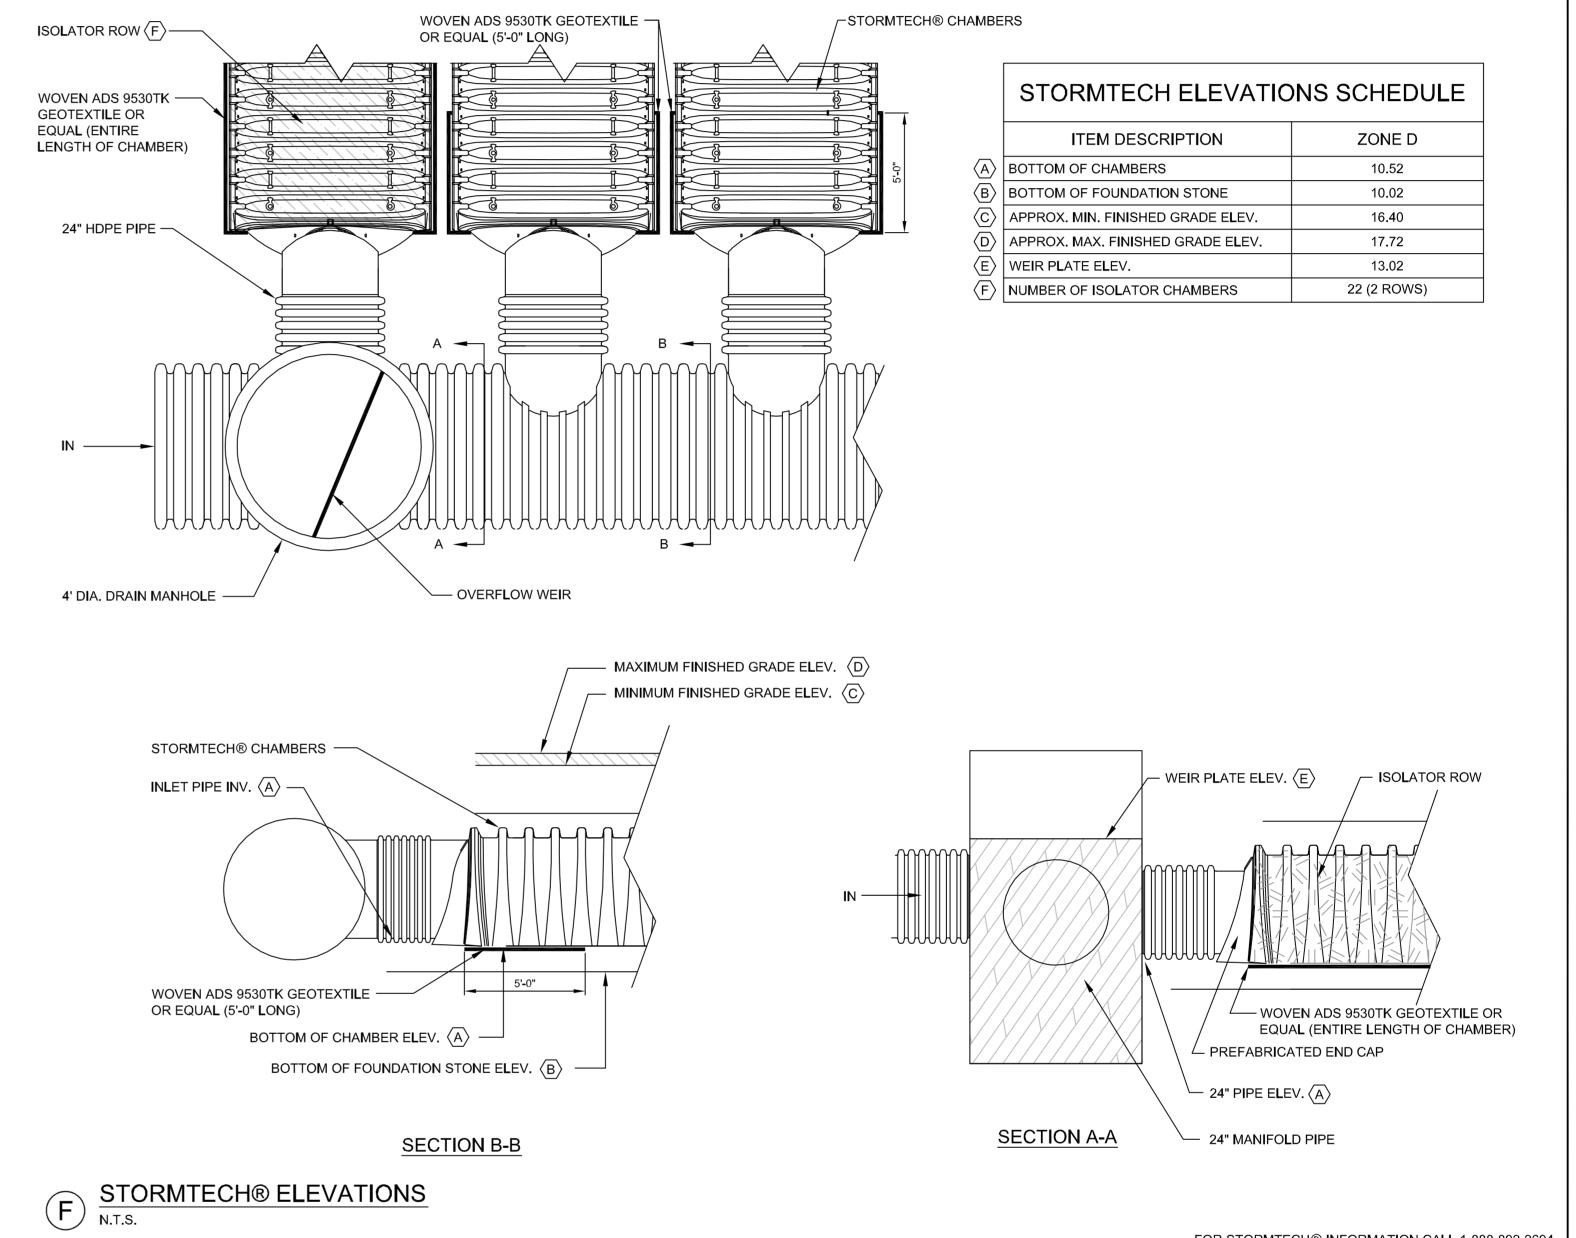

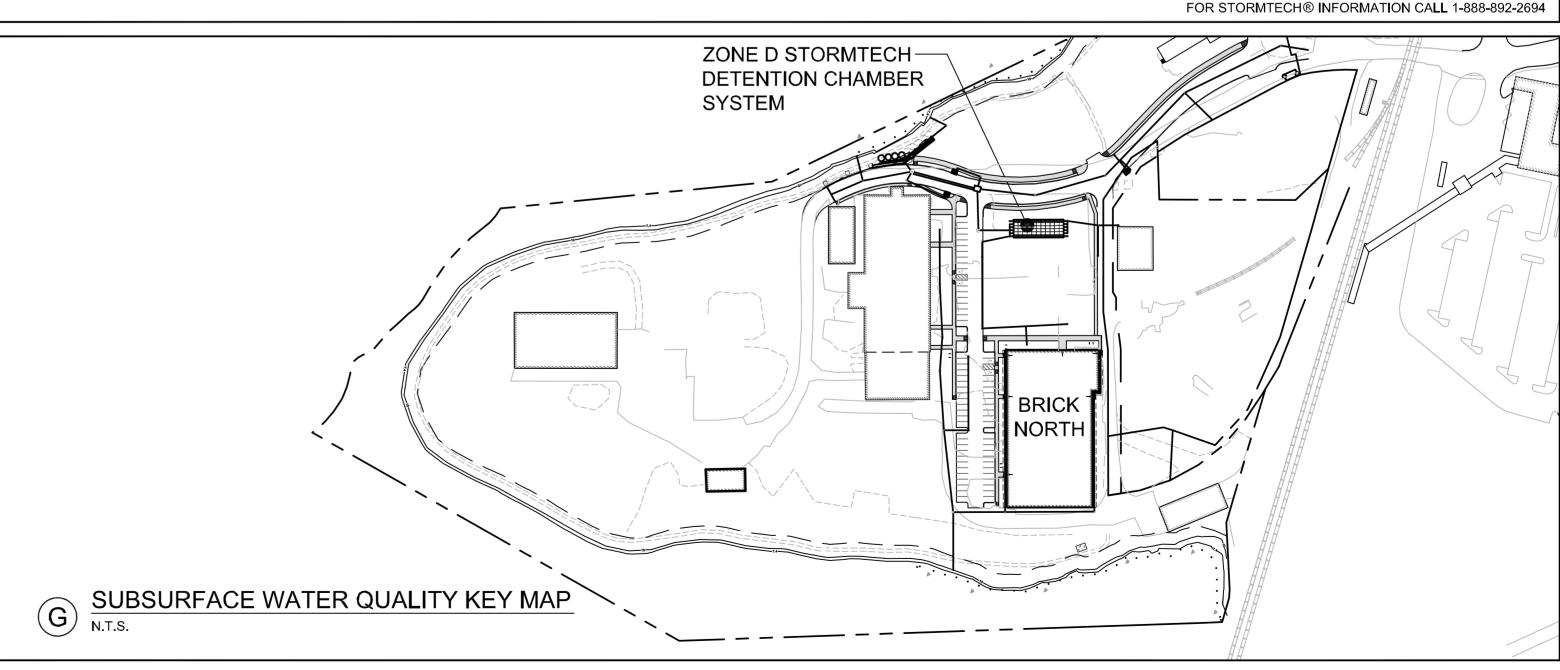

3 12.01.14 FINAL PHASE 1A SITE PLAN SUBMITTED TO CITY
2 07.29.14 REVISED PHASE 1A SITE PLAN SUBMITTED TO CITY
1 06.30.14 AMENDED PHASE 1A SITE PLAN SUBMITTED TO CITY
CITY
REV DATE DESCRIPTION
P.E. BO RENNEDY
REVISIONS
LIC. #11994

BRICK NORTH BUILDING AT
THE FOREFRONT AT THOMPSON'S POIN

SHEET TITLE
STORMWATER DETAILS
STORMTREAT M WATER QUALITY
VOLUME STORAGE DETAILS

FAY, SPOFFORD & THORNDIKE
ENGINEERS · PLANNERS · SCIENTISTS
778 MAIN ST, SUITE 8, SOUTH PORTLAND, ME 0410

STORMTREAT WATER QUALITY
VOLUME STORAGE DETAILS

DRAWN: DED DATE: JUNE 2014
DESIGNED: SCALE: CIN.Y.S.P.F. PORTLAND

CHECKED: JOB NO.P. P. 2020 FED SITE PLAN

FILE NAME: SHEET

Tourist Conditions of Approva

C-7.1 Dec 4 2011

PRELIMINARY - NOT FOR CONSTRUCTION

STORMTECH® ISOLATOR

NSPECTION PORT DETAIL