


Item	Date



The Shipyard
Main Terminal - Lower Level
Portland International Jetport
1001 Westbrook Street
Portland, ME 04102

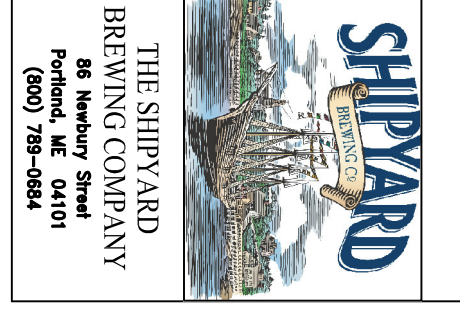

HMS Host
6600 Rockledge Drive
Bethesda, MD 20817
Tel: (240) 646-4625
Fax: (240) 694-1175

L2M Foodservice
DESIGN GROUP
811 Cornwell Park Drive
Glen Burnie, MD 21061
Ph: (410) 863-1302
Fx: (410) 863-1308


Building Engineering Resources, Inc.
28 Main Street, Bldg. 43A
North Easton, MA 02556
Tel: (508) 234-0200
Fax: (508) 234-0201
E: ber@buildingresources.com

LLOYD ARCHITECTS
Two High Cliff, Plymouth MA 02360
TEL: (508) 746-4646
FAX: (508) 746-1236
E-MAIL: info@lloydarch.com

Job No.: 072117
Scale: 1/4"=1'-0"
Issue: 12/11/07

Fire Protection
Lower Level
Plan

FP3

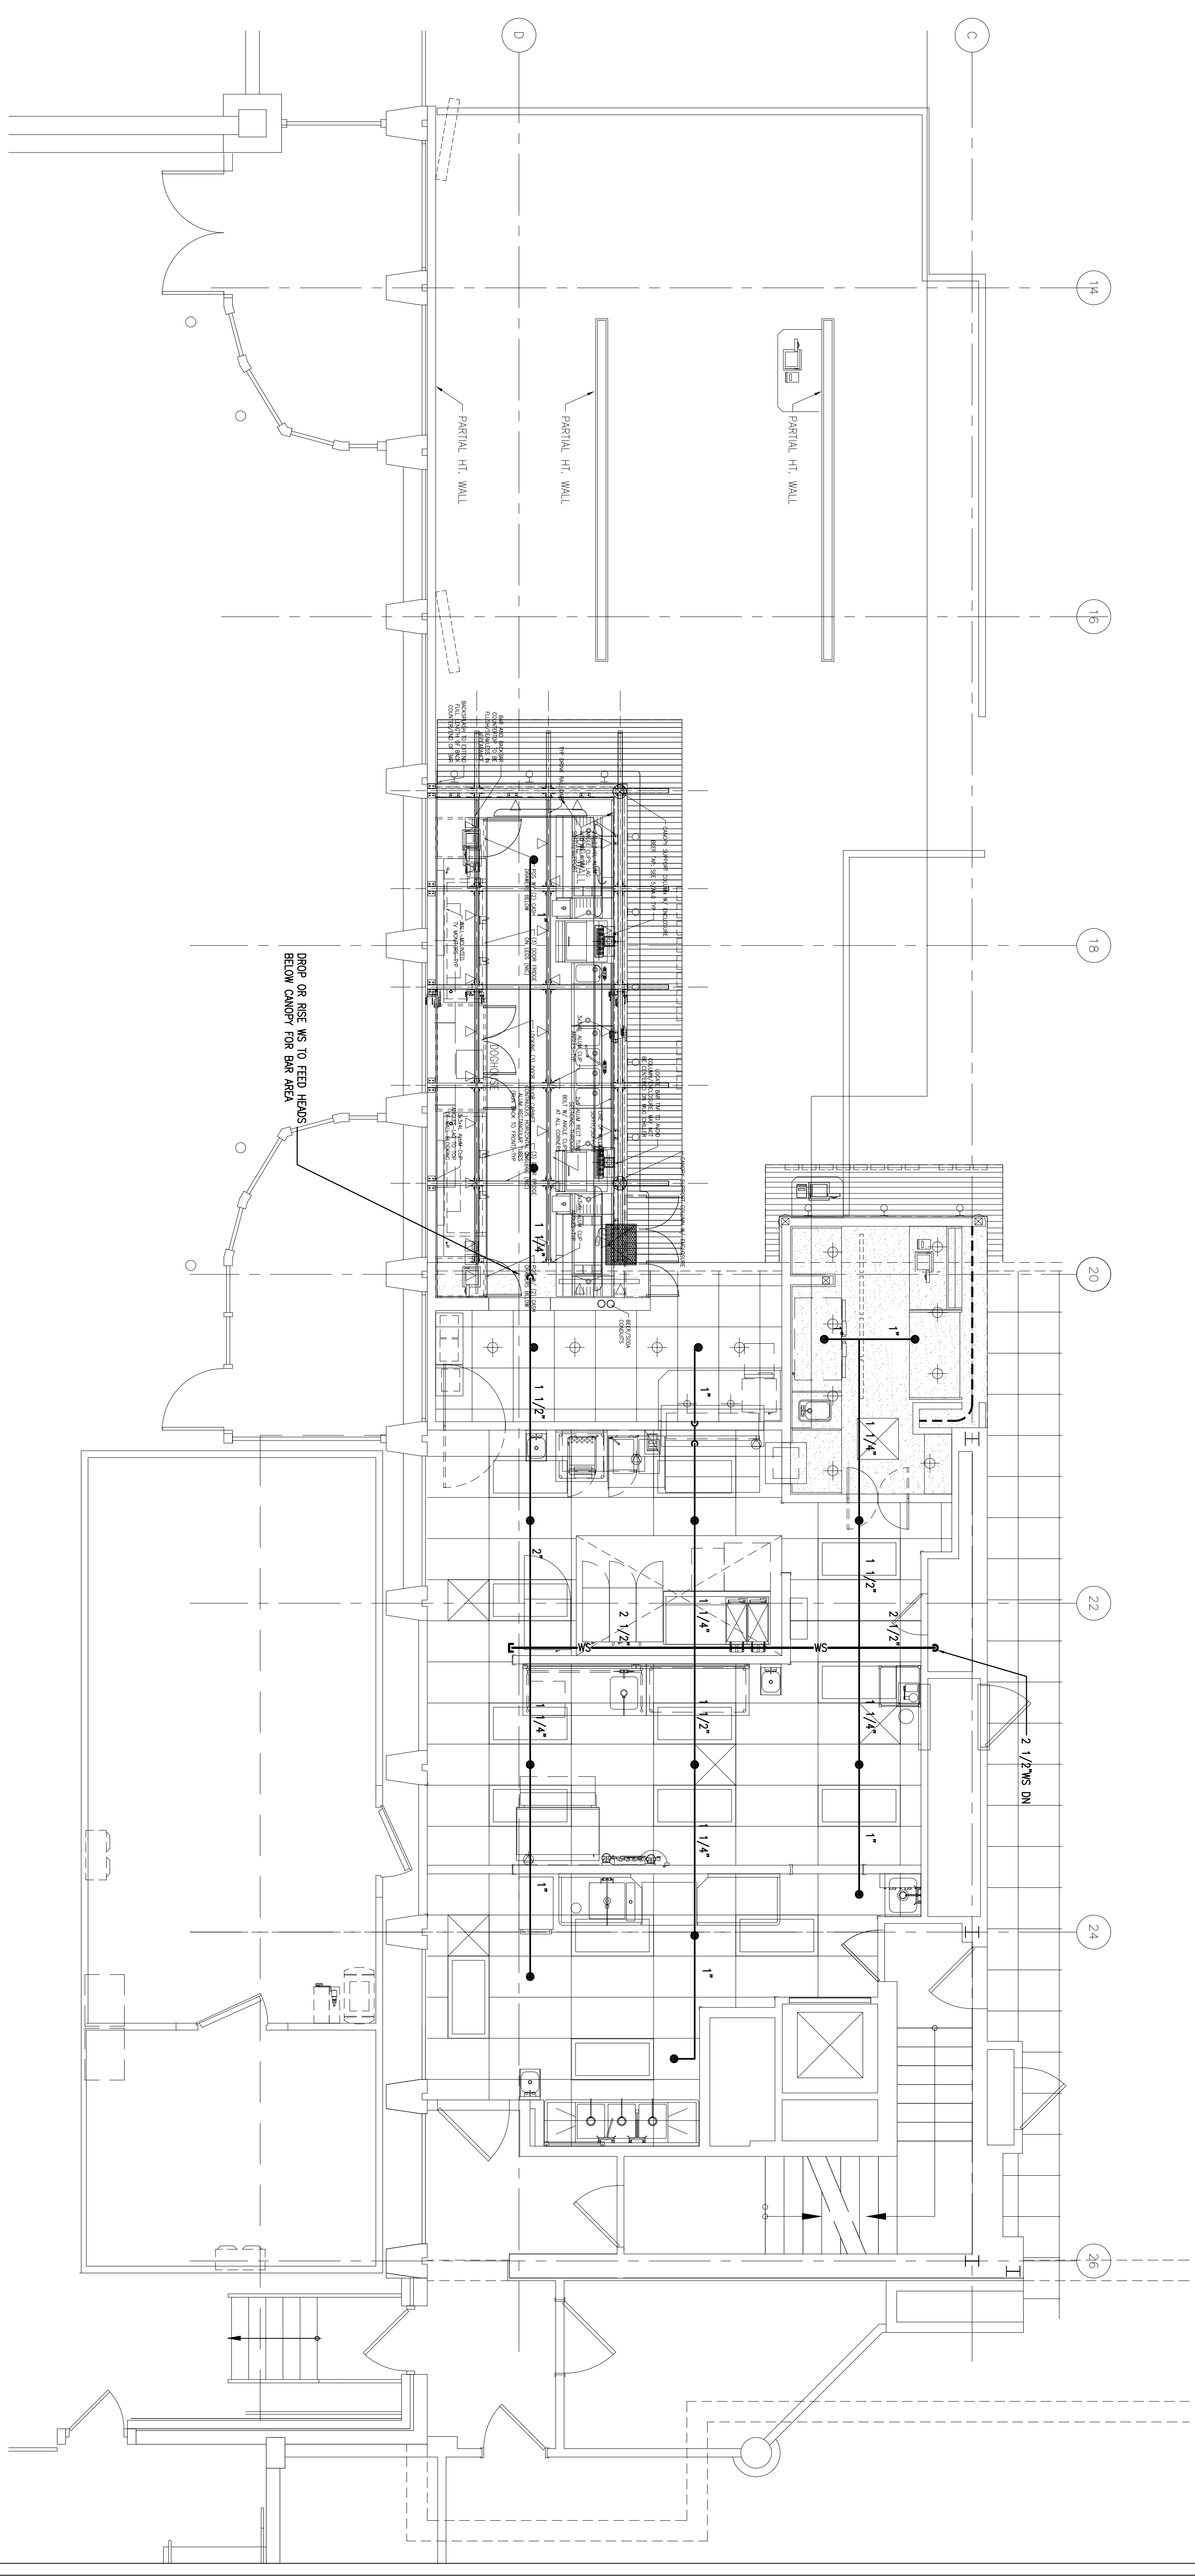

- NOTES**
1. PIPING SIZES BASED ON NFPA-13 PIPE SCHEDULE. CONTRACTOR MAY PROVIDE HYDRAULIC CALCULATIONS TO INSTALL SMALLER PIPE SIZES.
 2. THE CONTRACTOR REQUIREMENTS ARE TO OBTAIN THE DESIGN AUTHORITY TO COMPLETE THE PRELIMINARY SUBMISSION TO THE AUTHORITIES HAVING JURISDICTION. SUBMIT FABRICATION DRAWINGS TO AUTHORITY FOR FINAL APPROVAL PRIOR TO INSTALLATION.