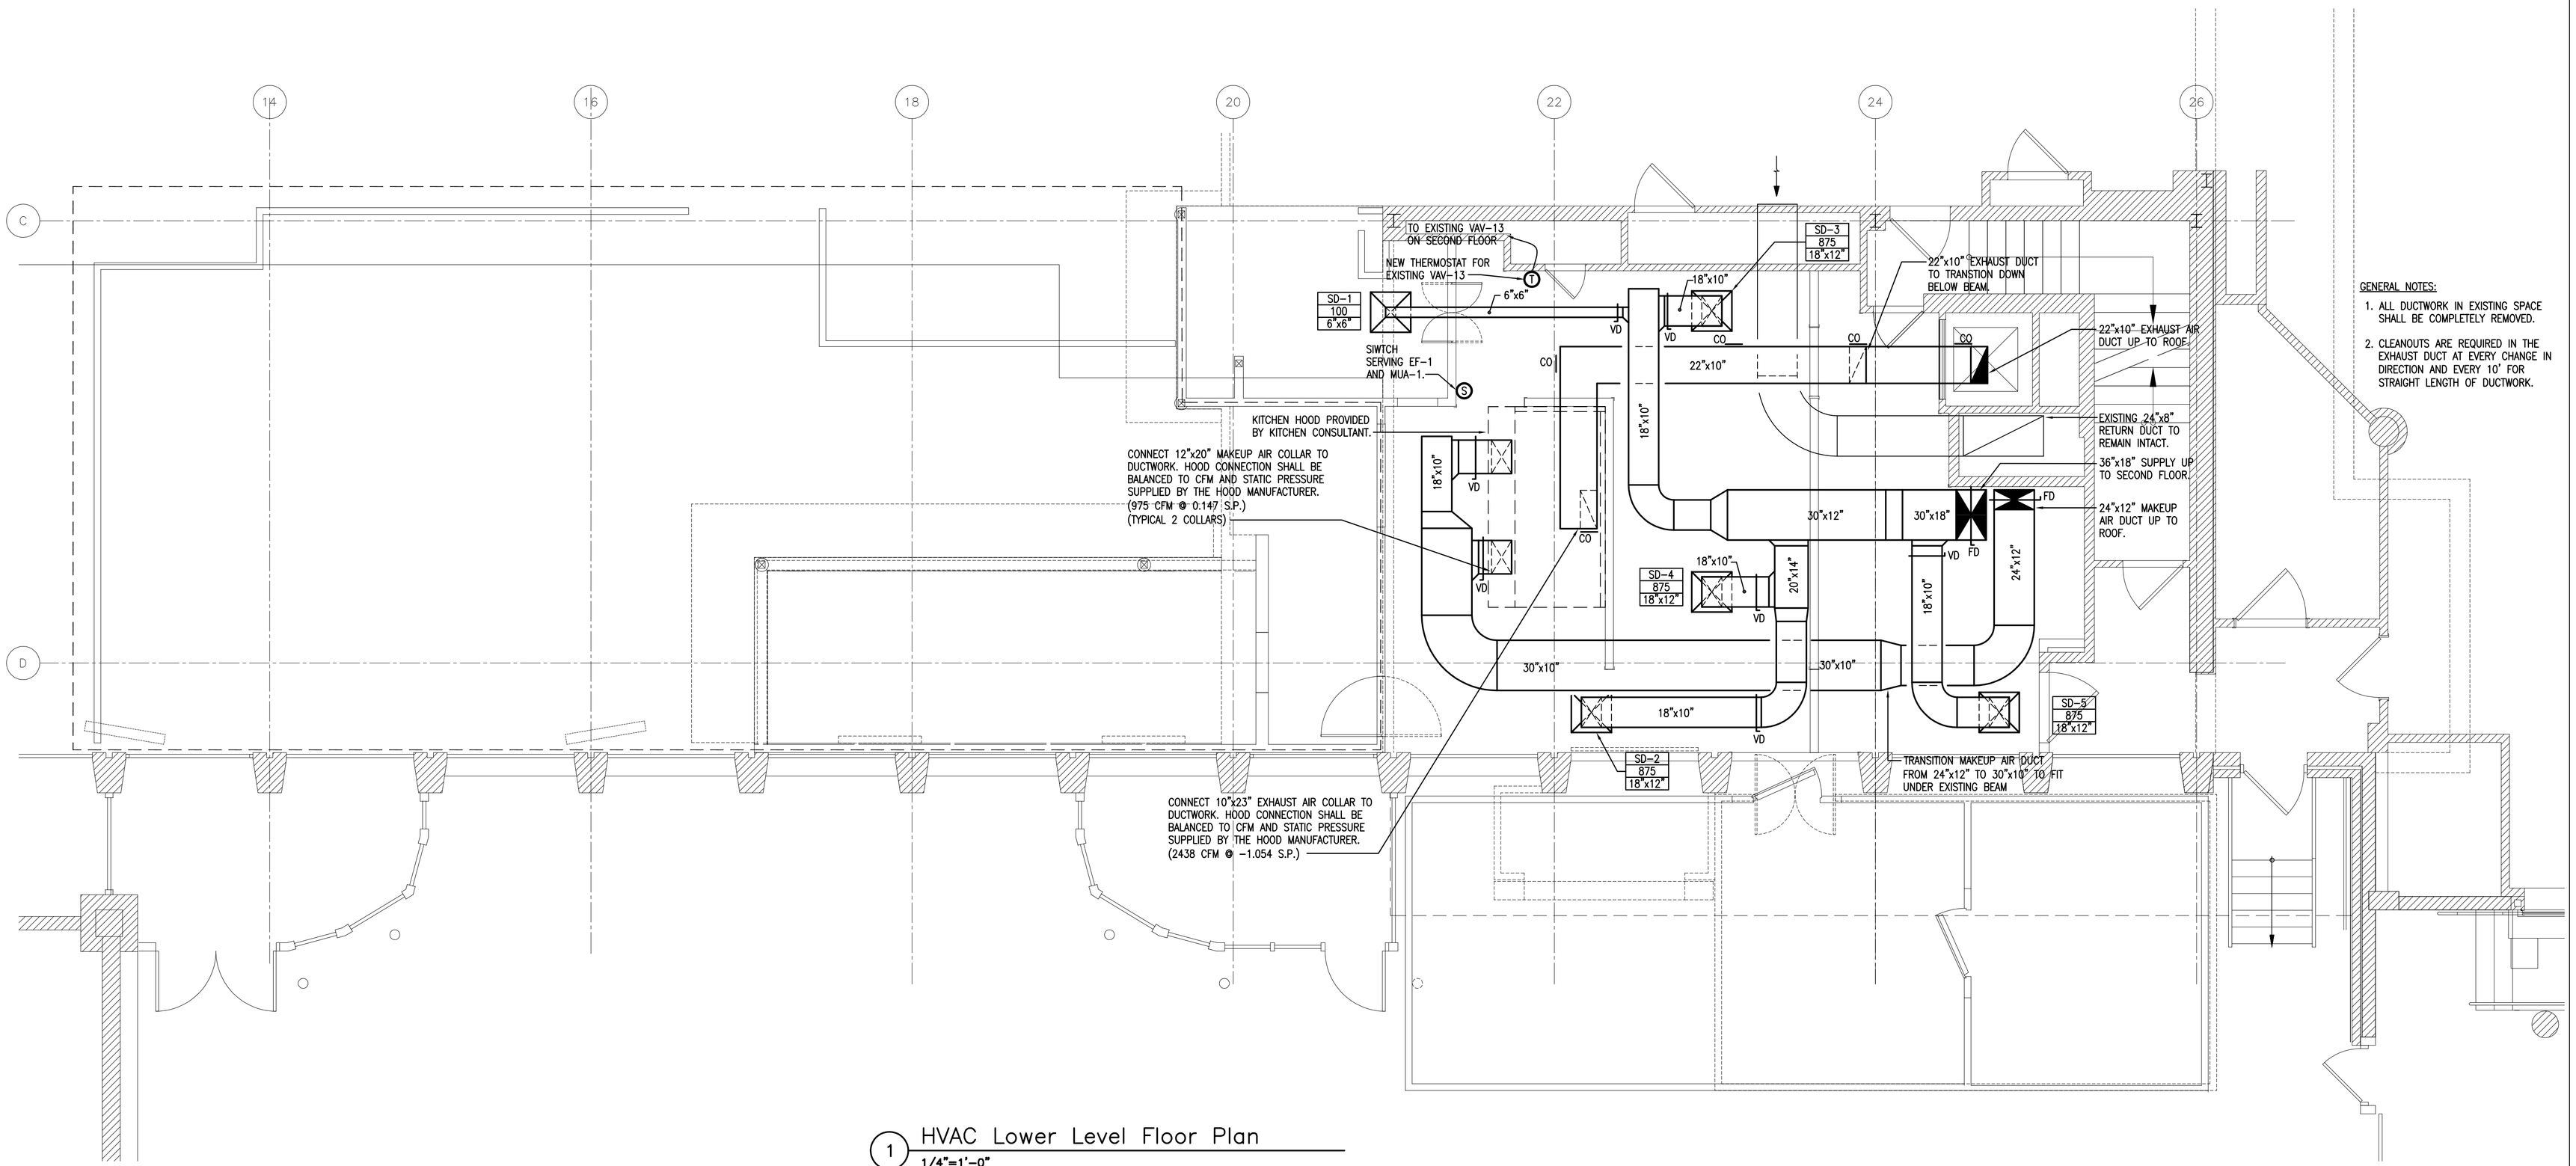

GENERAL NOTES:

1. ALL DUCTWORK IN EXISTING SPACE SHALL BE COMPLETELY REMOVED.
2. CLEANOUTS ARE REQUIRED IN THE EXHAUST DUCT AT EVERY CHANGE IN DIRECTION AND EVERY 10' FOR STRAIGHT LENGTH OF DUCTWORK.

1 HVAC Lower Level Floor Plan

1/4"=1'-0"

Item	Date

THE SHIPYARD BREWING COMPANY
86 Newbury Street
Portland, ME 04101
(800) 789-0684

The Shipyard
Main Terminal - Lower Level
Portland International Jetport
1001 Westbrook Street
Portland, ME 04102

HMS Host
6600 Rockledge Drive
Bethesda, MD 20817
Ph: (240) 694-4693
Fax: (240) 694-4175

L2M Foodservice Design Group
811 Cromwell Park Drive
Suite 113
Glen Burnie, MD 21061
ph: (410) 863-1302
fx: (410) 863-1308

Building Engineering Resources, Inc.
28 Main Street, Bldg. #3A
North Easton, MA 02356
T: (508) 230-0260
F: (508) 230-0265
E: ber@ber-engineering.com

LLOYD ARCHITECTS
Two High Cliff, Plymouth MA 02360
TEL: (508) 746-4646
FAX: (508) 746-1376
E-MAIL: info@lloydarch.com

Job No.: 07417

Scale: 1/4"=1'-0"

Issued: 12/11/07

Mechanical
First Floor Plan

M2