




WORKSHEET

SFRM THICKNESS ON BEAM OR COLUMN ASTM E605

Project Name: Phase II Parking Garage/ Jetport
 Project Number: 07-1299
 Client: Becker Structural Engineers

SFRM Supplier: W.R. Grace
 SFRM Material: Medium Density Z-106/HY
 SFRM Installer: New England Fireproofing
 Installation Date: _____

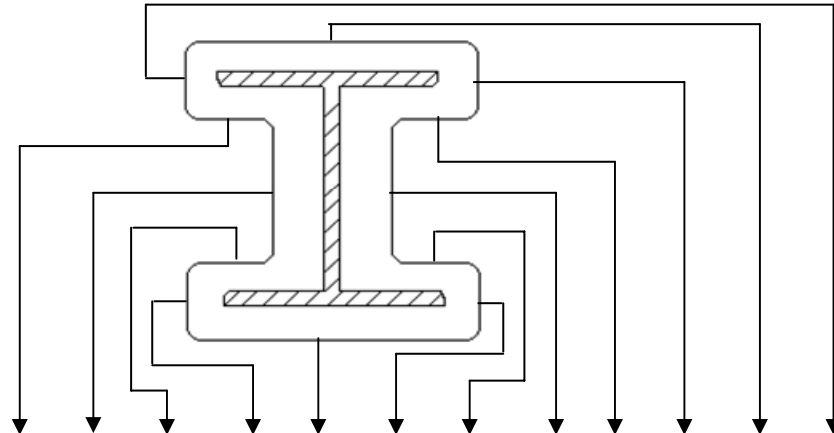

Floor No.	Column/Beam No.	Type	Test Date	Spec.	1	2	3	4	5	6	7	8	9	10*	11*	12*	Average
Ground Floor	E.1, 2-3 W21X83	Beam	11/6/08	0.813	1.000	0.875	1.125	0.563	1.063	1.000	1.313	1.375	1.125				0.972
					1.000	1.125	1.063	0.563	0.875	1.000	1.375	1.375	1.125				
Floor No.	Column/Beam No.	Type	Test Date	Spec.	1	2	3	4	5	6	7	8	9	10*	11*	12*	Average
Floor No.	Column/Beam No.	Type	Test Date	Spec.	1	2	3	4	5	6	7	8	9	10*	11*	12*	Average
Floor No.	Column/Beam No.	Type	Test Date	Spec.	1	2	3	4	5	6	7	8	9	10*	11*	12*	Average

* Not Required for Beams




WORKSHEET

SFRM THICKNESS ON BEAM OR COLUMN ASTM E605

Project Name: Phase II Parking Garage/ Jetport
 Project Number: 07-1299
 Client: Becker Structural Engineers

SFRM Supplier: W.R. Grace
 SFRM Material: Medium Density Z-106/HY
 SFRM Installer: New England Fireproofing
 Installation Date: _____

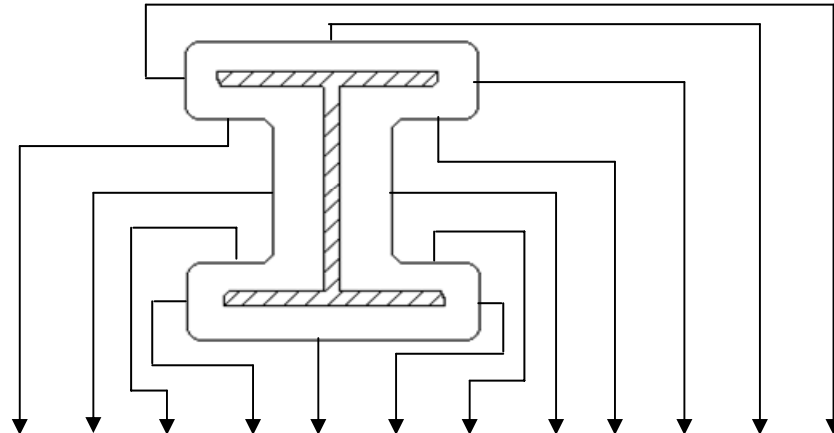

Floor No.	Column/Beam No.	Type	Test Date	Spec.	1	2	3	4	5	6	7	8	9	10*	11*	12*	Average
Ground Floor	E.1 - 3 W14X145	Col	11/6/08	0.875	1.313	1.563	1.313	1.188	1.125	1.188	1.063	1.375	1.313	1.188	1.125	1.188	1.120
					1.250	1.313	1.125	1.000	1.375	1.000	1.125	1.188	1.125	1.000	1.375	1.000	1.375
Ground Floor	E.1-6 W14X90	Col	11/6/08	1.188	1.813	2.063	1.813	1.250	1.750	1.500	1.750	3.625	1.750	1.813	1.125	1.250	1.380
					1.625	1.750	1.625	1.250	1.813	1.125	1.563	1.750	1.563	1.625	1.813	1.250	1.250
Ground Floor	E.1-11 W14X145	Col	11/6/08	0.875	1.438	2.250	2.063	0.875	1.500	1.000	2.063	2.250	1.438	0.875	1.250	1.000	1.063
					1.063	2.188	1.750	0.750	1.500	0.810	1.750	2.375	1.063	0.750	1.313	0.750	0.995
Ground Floor	E.1, 11-12 W21X93	Beam	11/6/08	0.813	0.813	1.188	0.938	1.125	0.875	0.875	0.563	0.875	1.063				0.903
					0.813	1.188	0.875	1.125	0.875	1.063	0.563	1.063	1.063				0.938

* Not Required for Beams