


LEVEL 1 - UNDERGROUND CONDUIT ROUTING PLAN
SCALE: 1/8"=1'-0"

CONTRACTOR TO VERIFY CONDITION OF EXISTING CONDUITS AT CONTRACTOR'S OPTION PROVIDE NEW CONDUITS TO GARAGE AND NEW ELECTRIC ROOMS IN PHASE 2. ROUTE CONDUITS ALONG CEILING OF LEVEL 1.


EMERGENCY SYSTEMS CIRCUITS SHALL BE SEPARATED FROM NORMAL CIRCUITS.

NORMAL HANDHOLE MIN. 30" X 48" DEPT. MIN. 30" X 48" DEPT. STANDBY SYSTEM HANDHOLE MIN. 17" X 30" DEPT. MIN. 17" X 30" DEPT. SYSTEM HANDHOLE MIN. 17" X 30" DEPT.

CONFORMED SET FOR FIELD USE



Stantec
Stantec Consulting Services Inc.
22 Free Street, Suite 205
Portland, ME U.S.A.
04101-3600 3011
Tel. 207/775-6434
Fax 207/775-6434
www.stantec.com

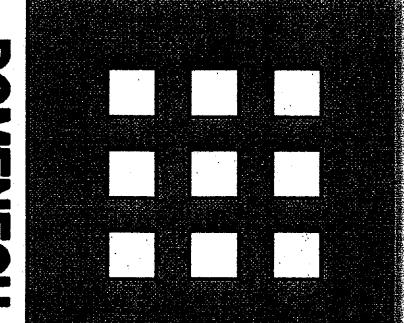

**DOMENECH
HICKS &
KROCKMALNIC
ARCHITECTS**
155 Massachusetts Ave.
Boston, MA 02115
617-267-6408
Fax 617-267-1990

CITY OF PORTLAND
PORTLAND, MAINE
DEPARTMENT OF
WATERFRONT AND
TRANSPORTATION



PORTLAND
INTERNATIONAL
JETPORT
PHASE II
PARKING GARAGE
1001 WESTBROOK ST.,
PORTLAND, MAINE

No.	Issue	Description

Scale AS SHOWN

LEVEL 1 - UG CONDUIT ROUTING PLAN

Drawn by: MLC
Checked by: MLC
Date: 10/21/11
Drawing No. 02/25/08

E0-3

If this sheet is less than 30"x42" in size, it has been reduced. Graphic scales must be adjusted accordingly.