



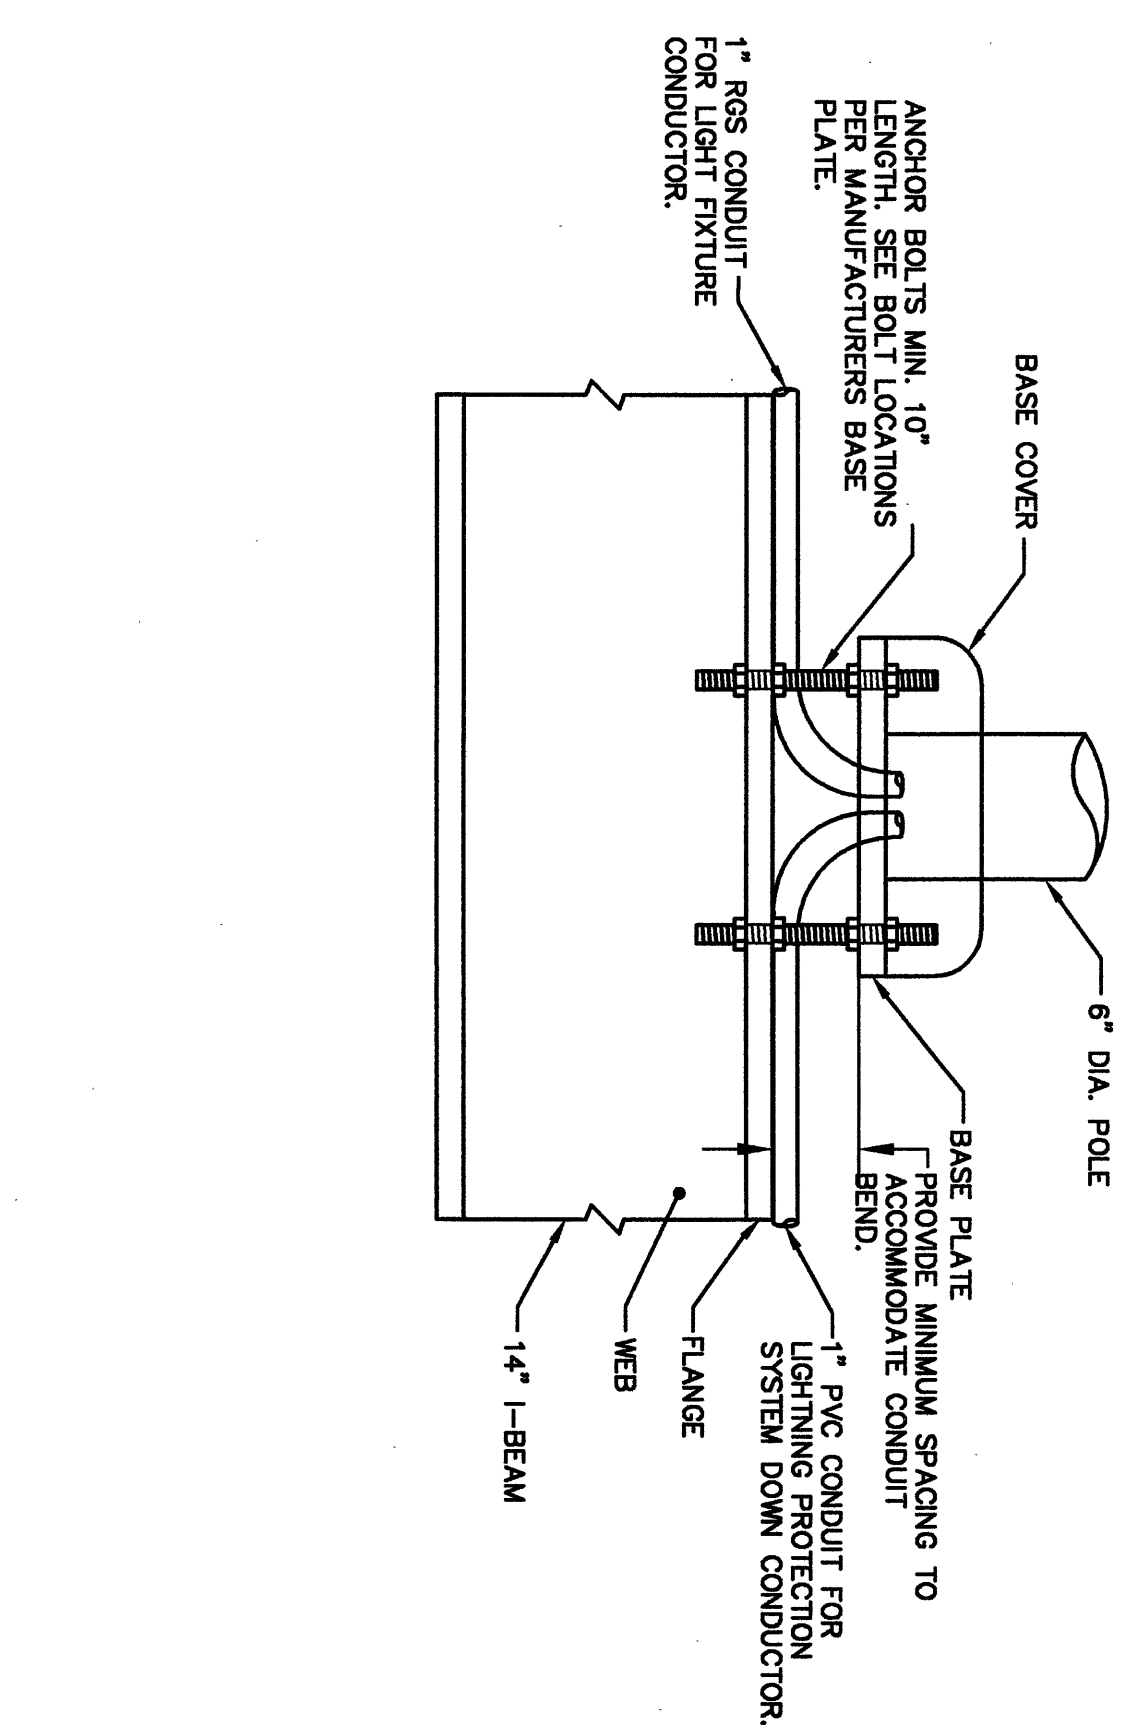


NOT TO SCALE

1. ALL CONCRETE BASES TO BE CONCRETE CLASS B, AND SHALL HAVE A SMOOTH LEAVE TOP SURFACE FINISHED WITH A 1/2" RADIUS EDGING TOOL.
2. ALL REINFORCING STEEL TO CONFORM TO THE REQUIREMENTS FOR "REINFORCING STEEL".
3. TEMPLATE FOR ANCHOR BOLTS, STAINLESS STEEL, ANCHOR BOLTS, NUTS AND WASHERS TO BE OBTAINED BY CONTRACTOR PRIOR TO CONSTRUCTION OF BASES.
4. SCORE TOP OF CONCRETE BASE TO SHOW LOCATION OF CONDUIT(S).
5. CONDUIT SIZE - AS SHOWN ON THE PLANS.
6. ALL EXPOSED METAL HARDWARE SHALL BE GALVANIZED OR STAINLESS STEEL.
7. IF THE ELECTRICAL CONDUIT IN THE CONCRETE BASE IS GALVANIZED STEEL, GROUNDING BUSINNESS SHALL BE USED.
8. THE MINIMUM RADII FOR RIGID METALLIC OR NONMETALLIC ELECTRICAL CONDUIT SHALL BE SIX TIMES THE INSIDE DIAMETER OF THE CONDUIT.

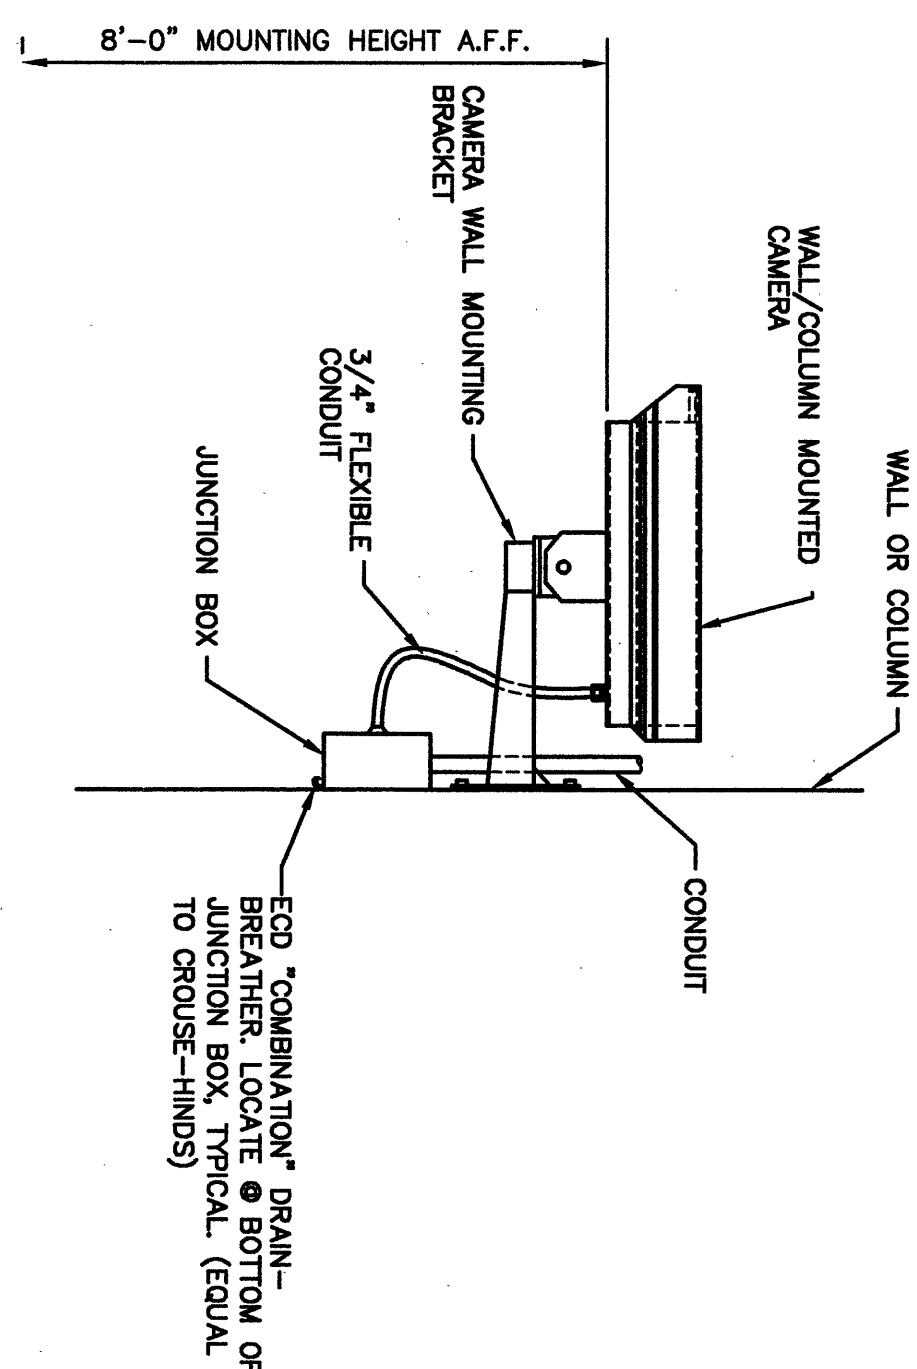


NO SCALE

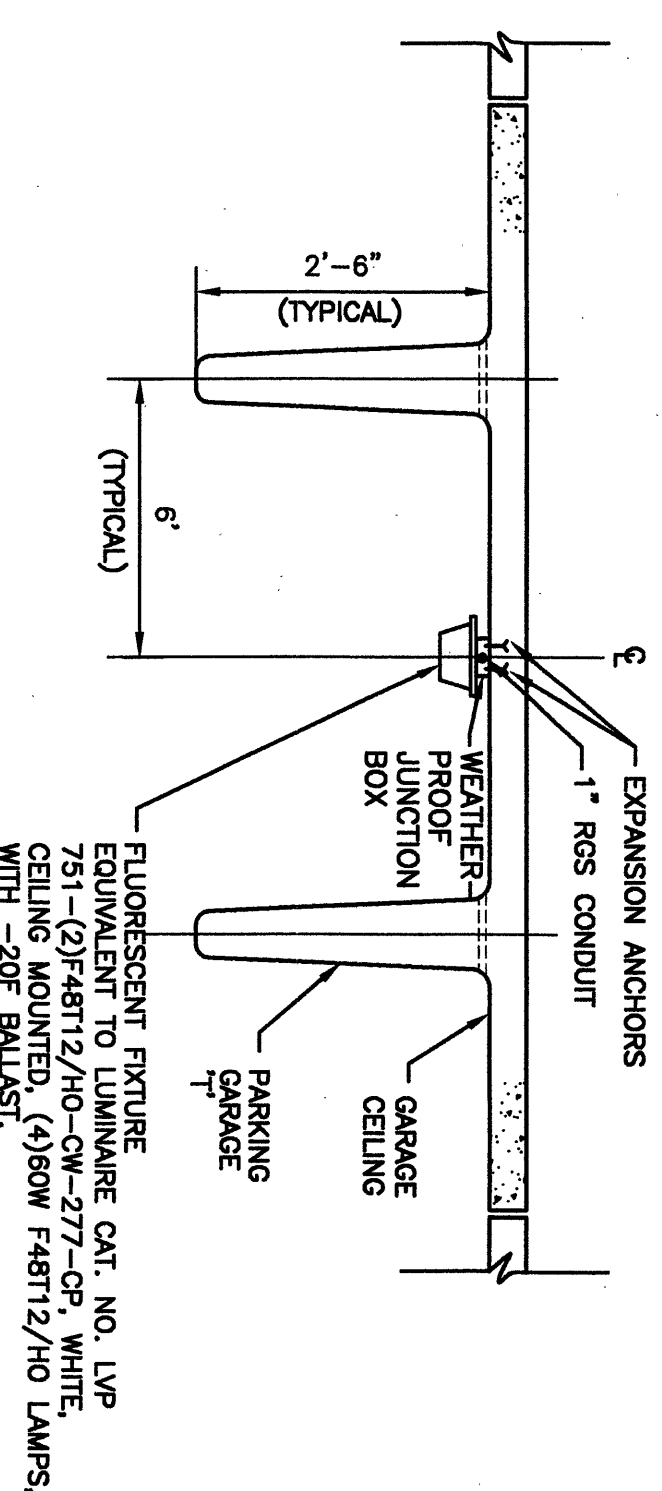


NOT TO SCALE

1. CONDUIT LAYOUTS SHOWN ARE DIAGRAMMATIC ONLY FOR CIRCUITING PURPOSES
2. CONDUIT RUNS SHALL BE PARALLEL OR PERPENDICULAR TO PRECAST CONCRETE TEES.
3. MOUNT FUTURE SECURELY TO GARAGE CEILING, MATCH EXISTING FLUORESCENT FIXTURE IN "NEW" GARAGE.

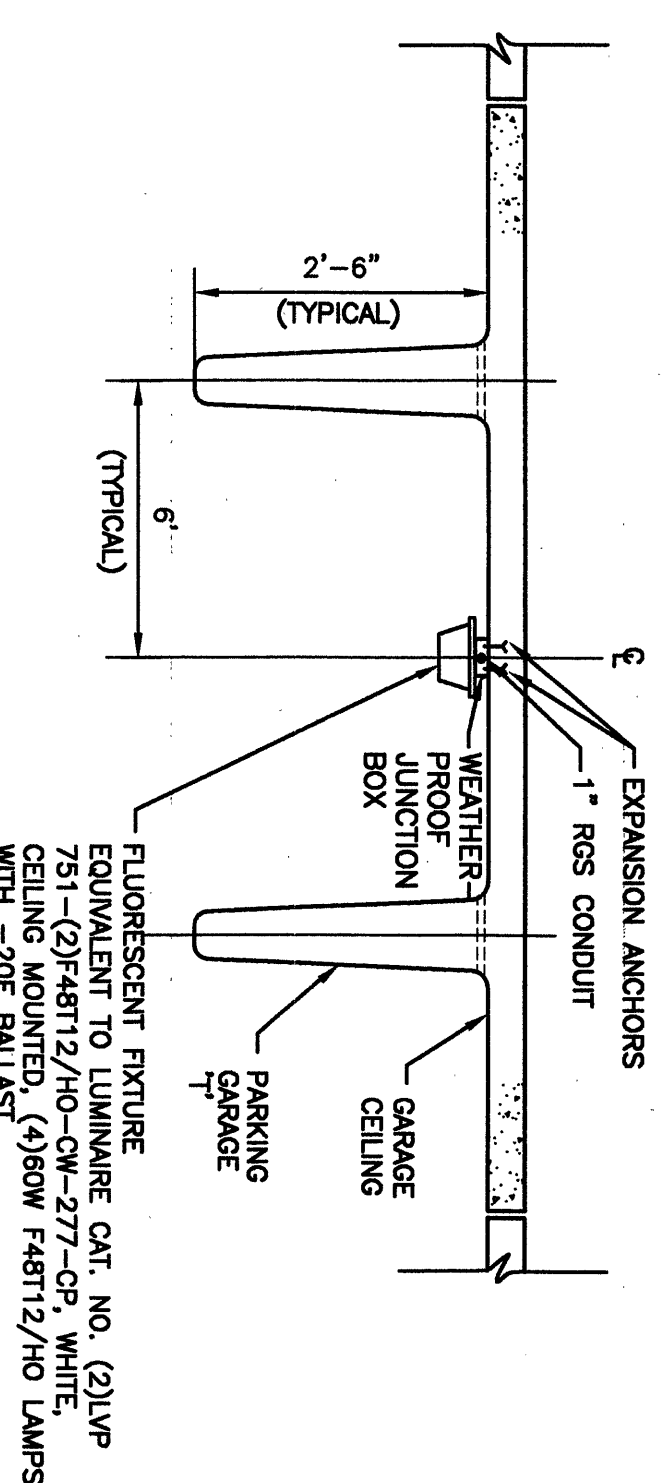


NOT TO SCALE

1. CONDUIT LAYOUTS SHOWN ARE DIAGRAMMATIC ONLY FOR CHICKNUTTING PURPOSES.
2. CONDUIT RUNS SHALL BE PARALLEL OR PERPENDICULAR TO PRECAST CONCRETE TEES.
3. MOUNT FUTURE SECURELY TO GARAGE CEILING, MATCH EXISTING FLUORESCENT FUTURE IN "NEW" GARAGE.

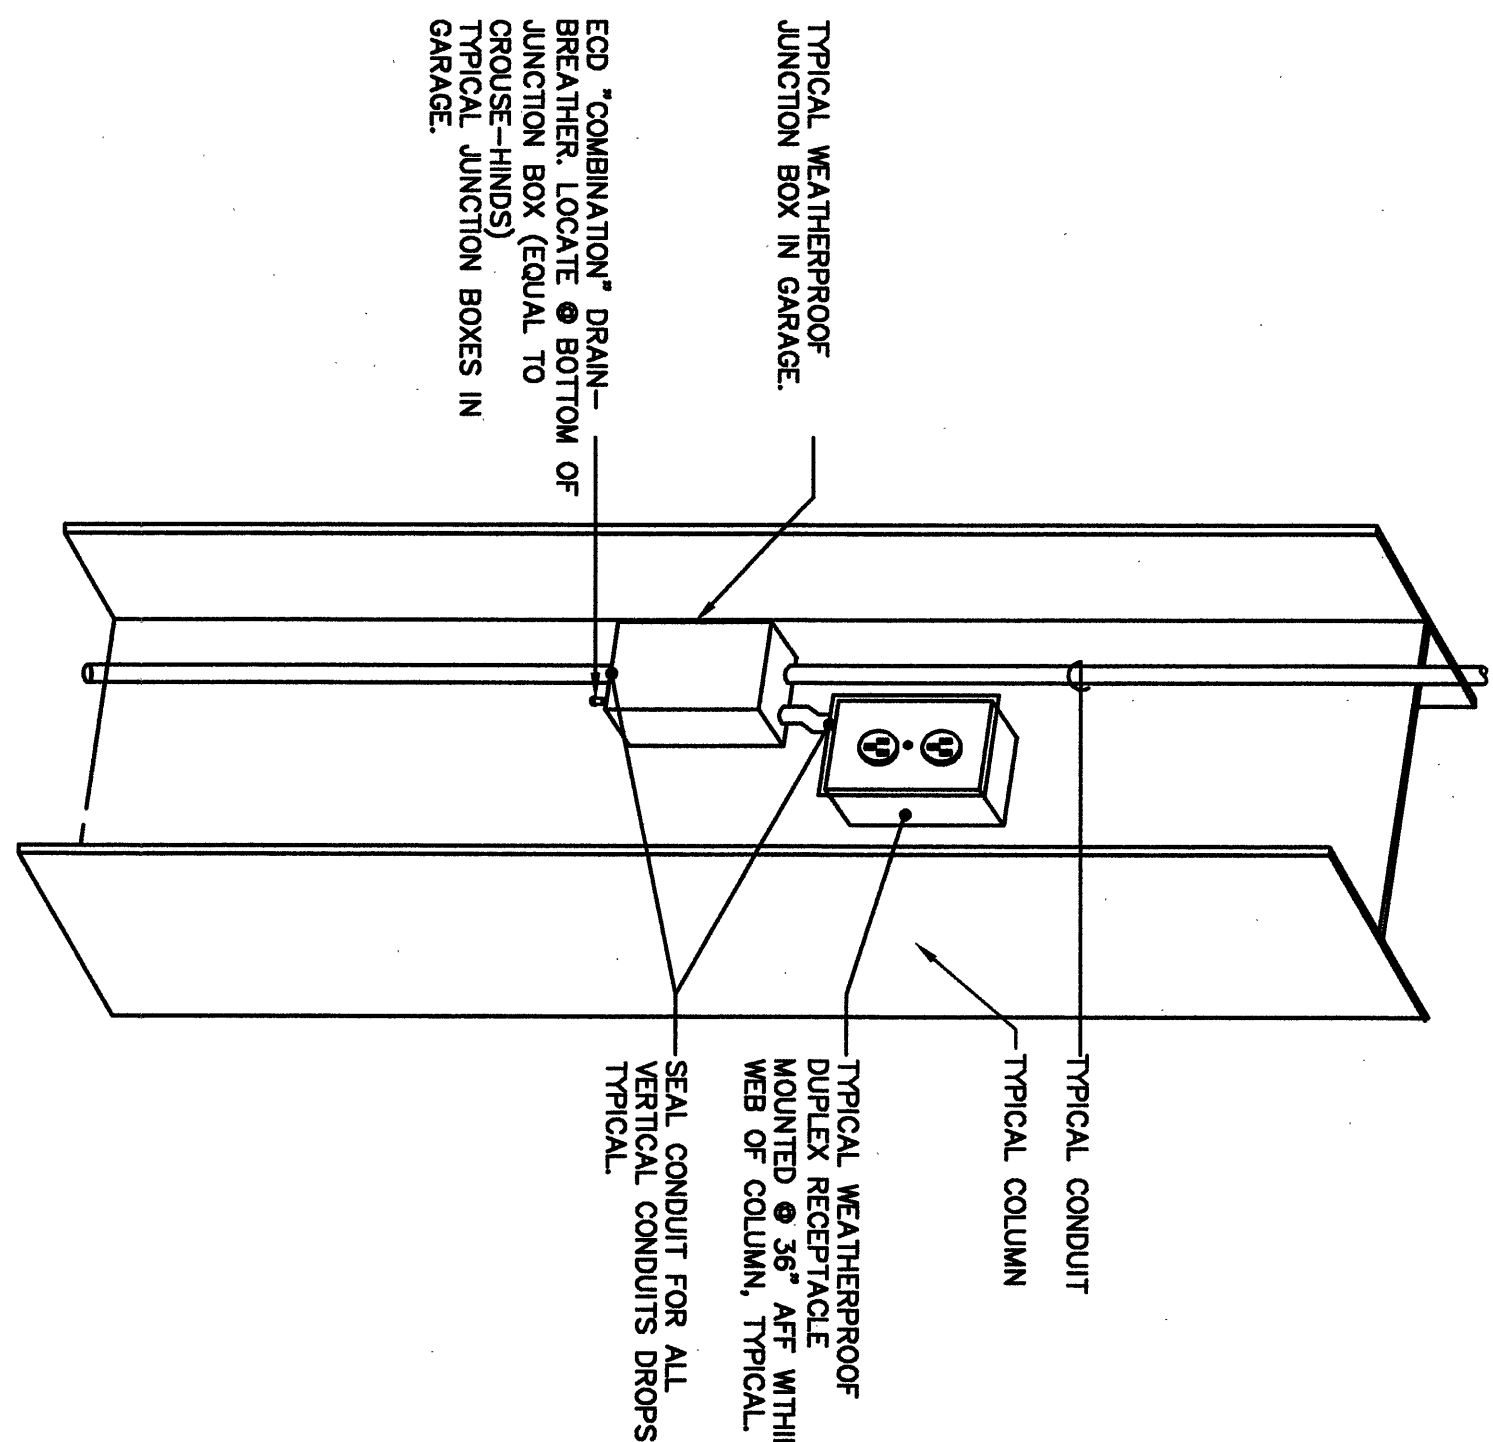


NOT TO SCALE

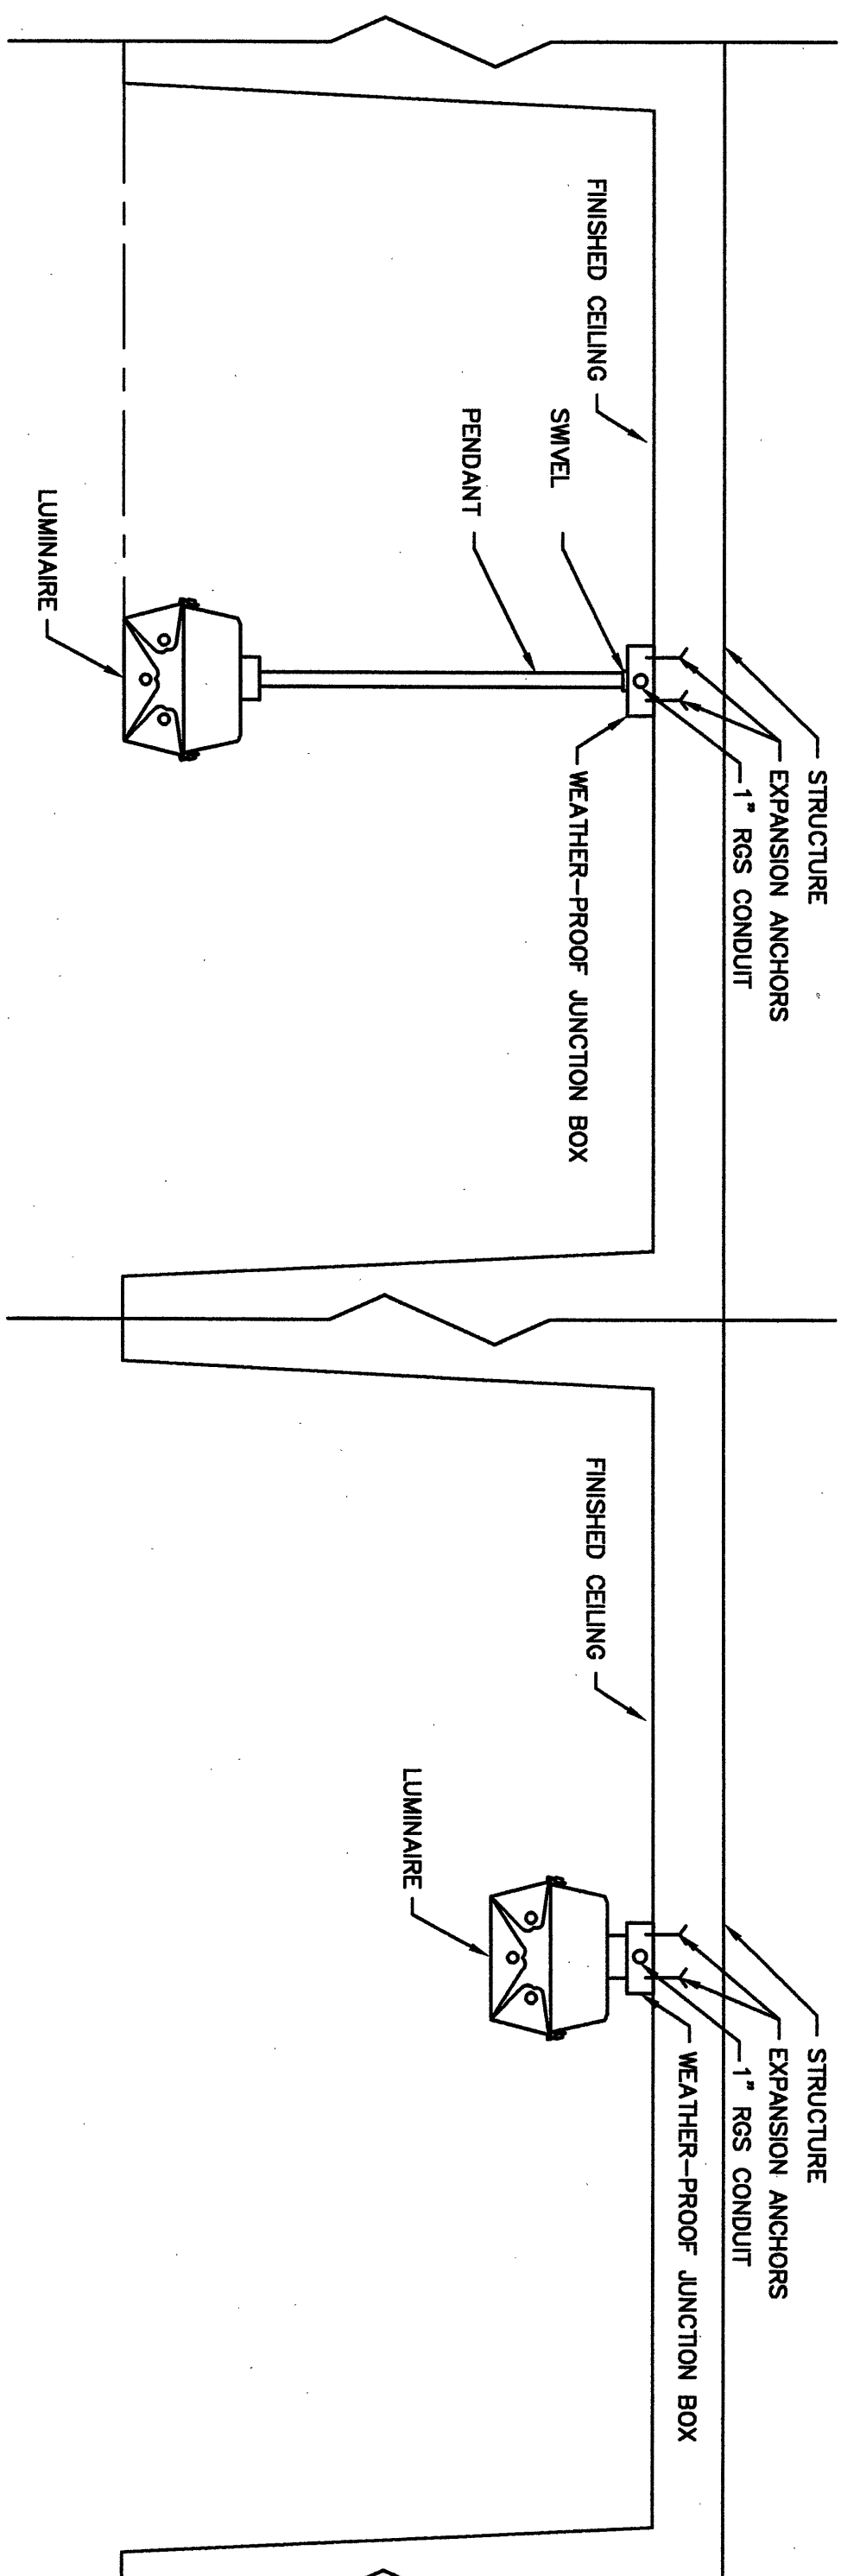

NOT TO SCALE


NOT TO SCALE

KROCKMALNIC
ARCHITECTS

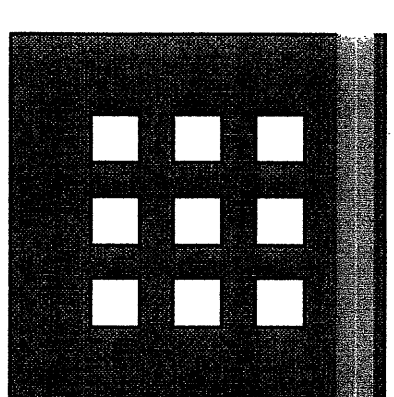

PARKING GARAGE

Scale
AS SHOWN

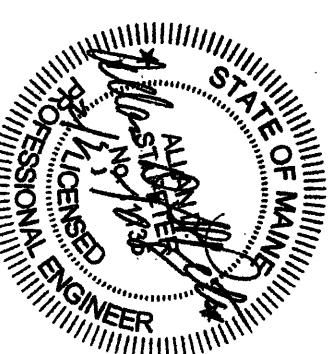

E3-C

CONFORMED SE
FOR FIELD USE