



PARTIAL FIRE PROTECTION PLAN - LEVEL 2  
(TYPICAL FOR SECOND, THIRD, FOURTH AND FIFTH LEVELS)  
SCALE: 1/8"=1'-0"

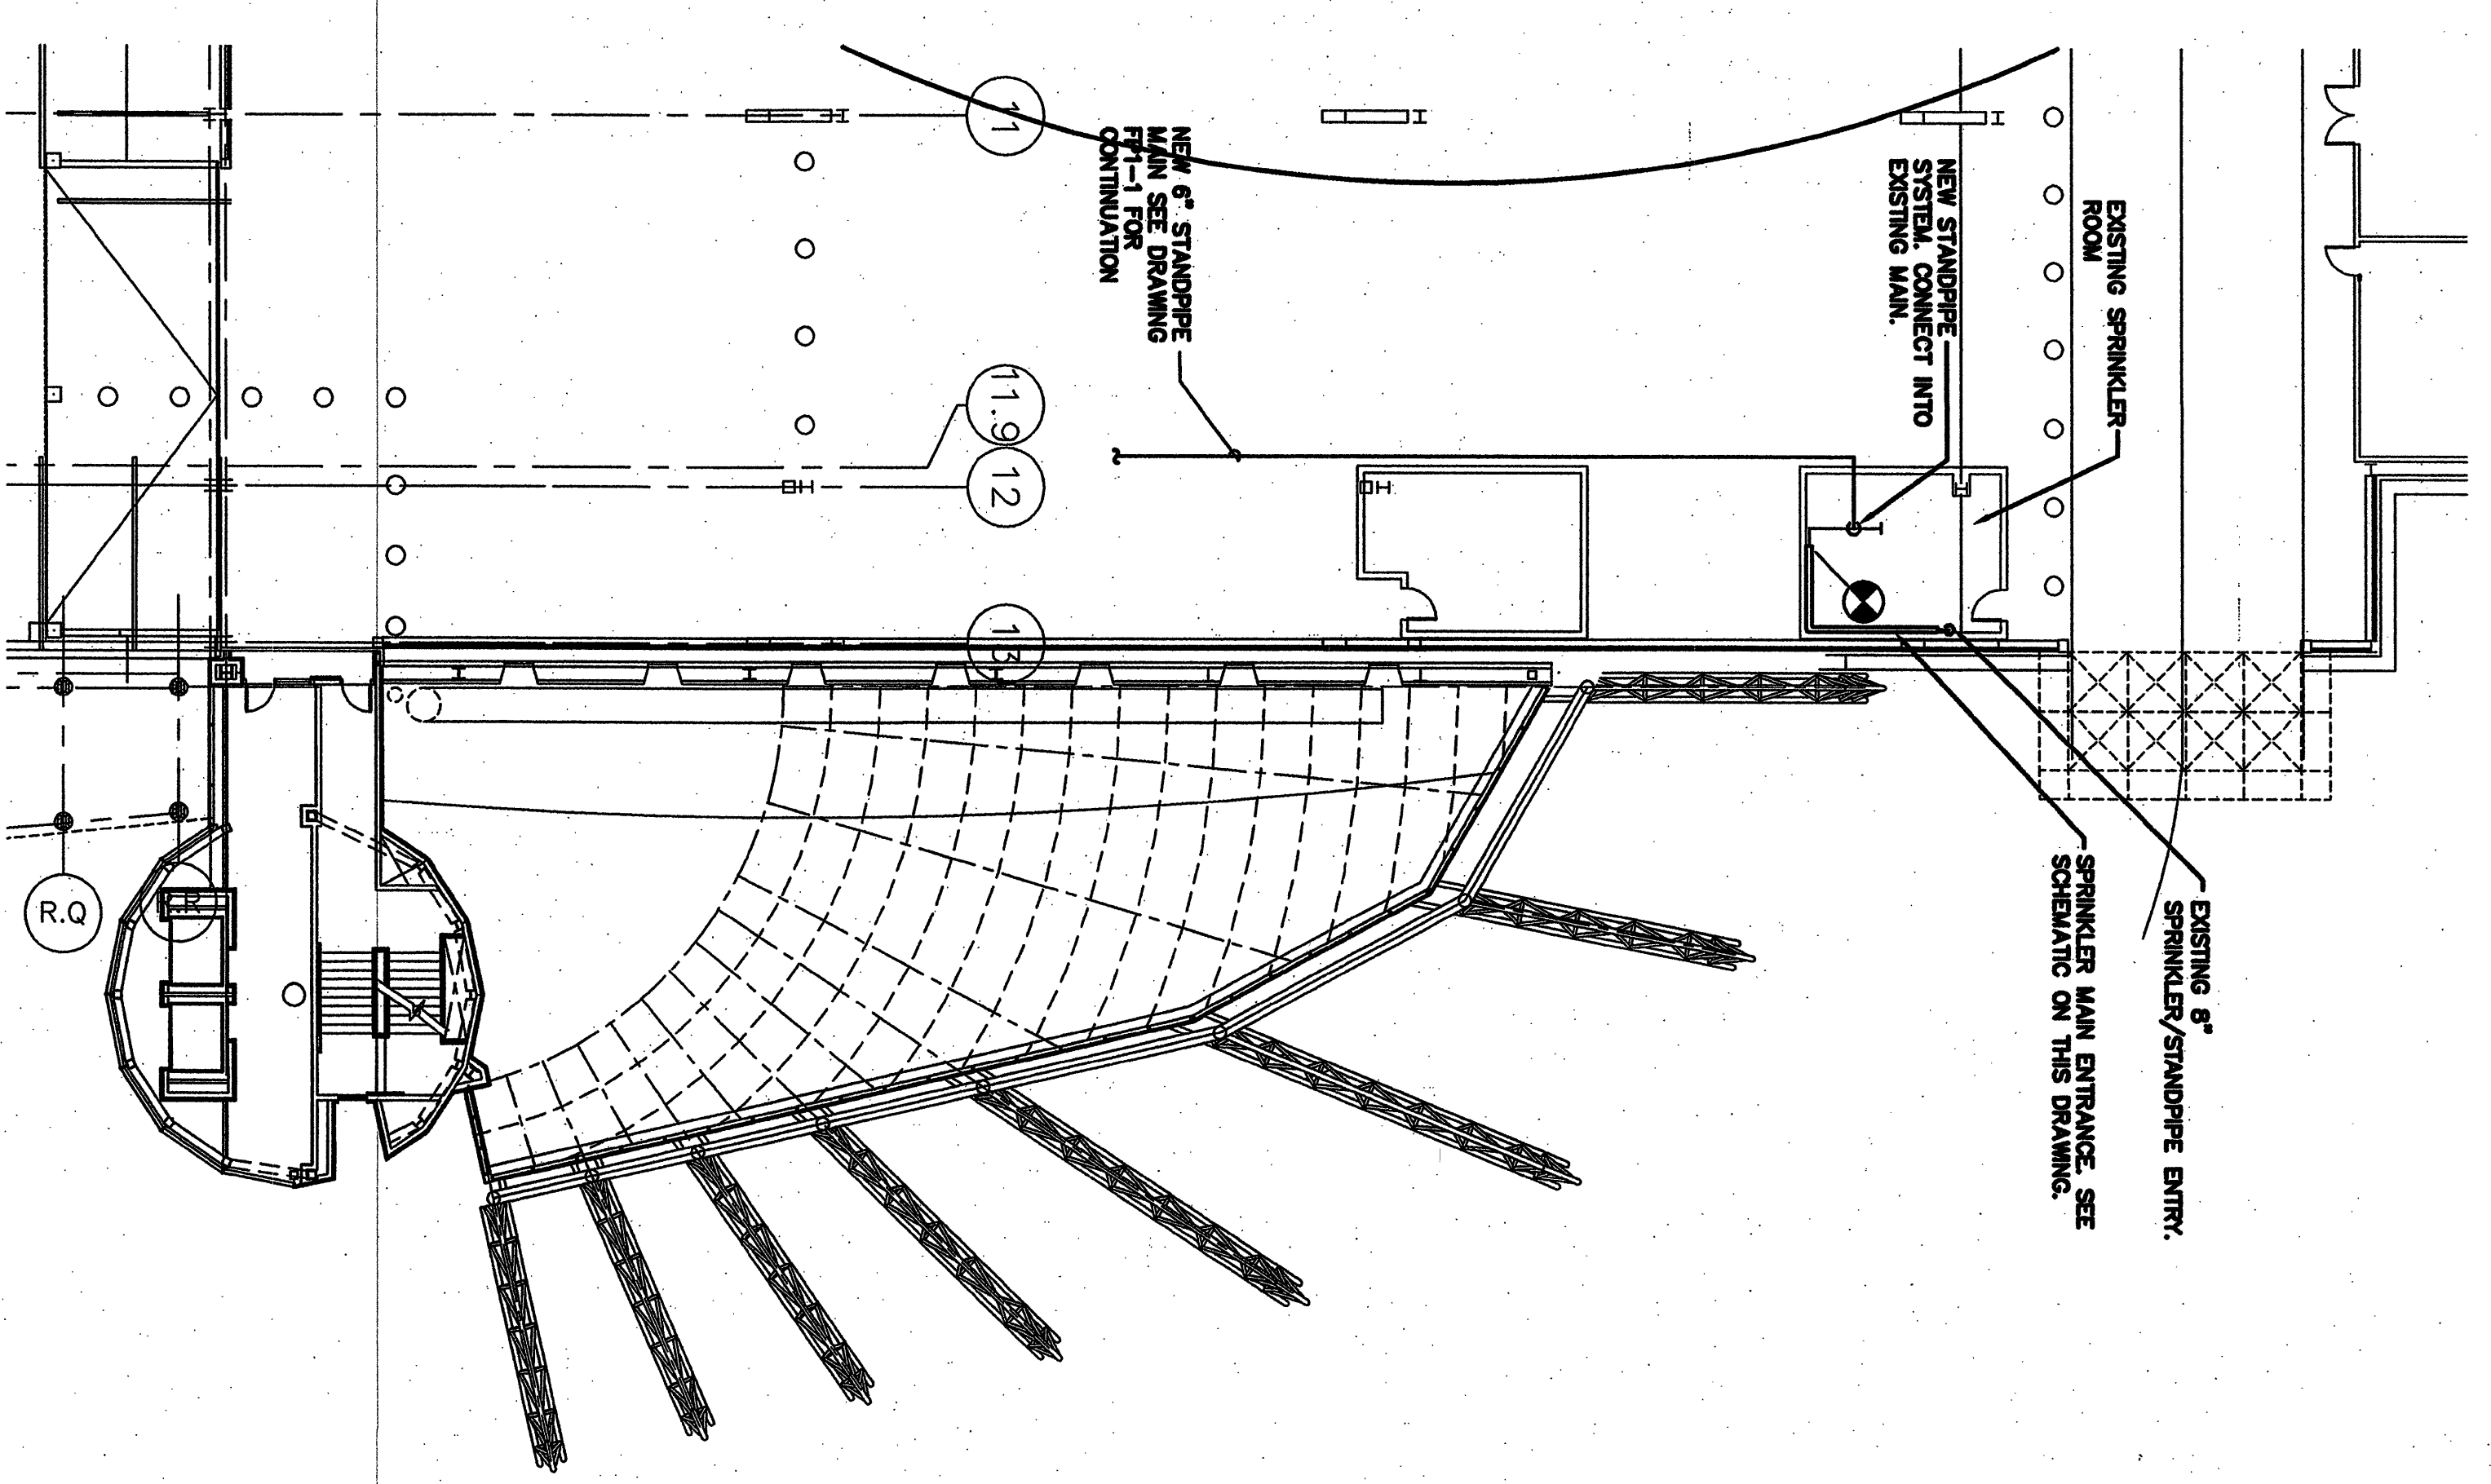


PARTIAL FIRE PROTECTION PLAN - LEVEL 2  
EXISTING PHASE I GARAGE  
SCALE: 1/8"=1'-0"

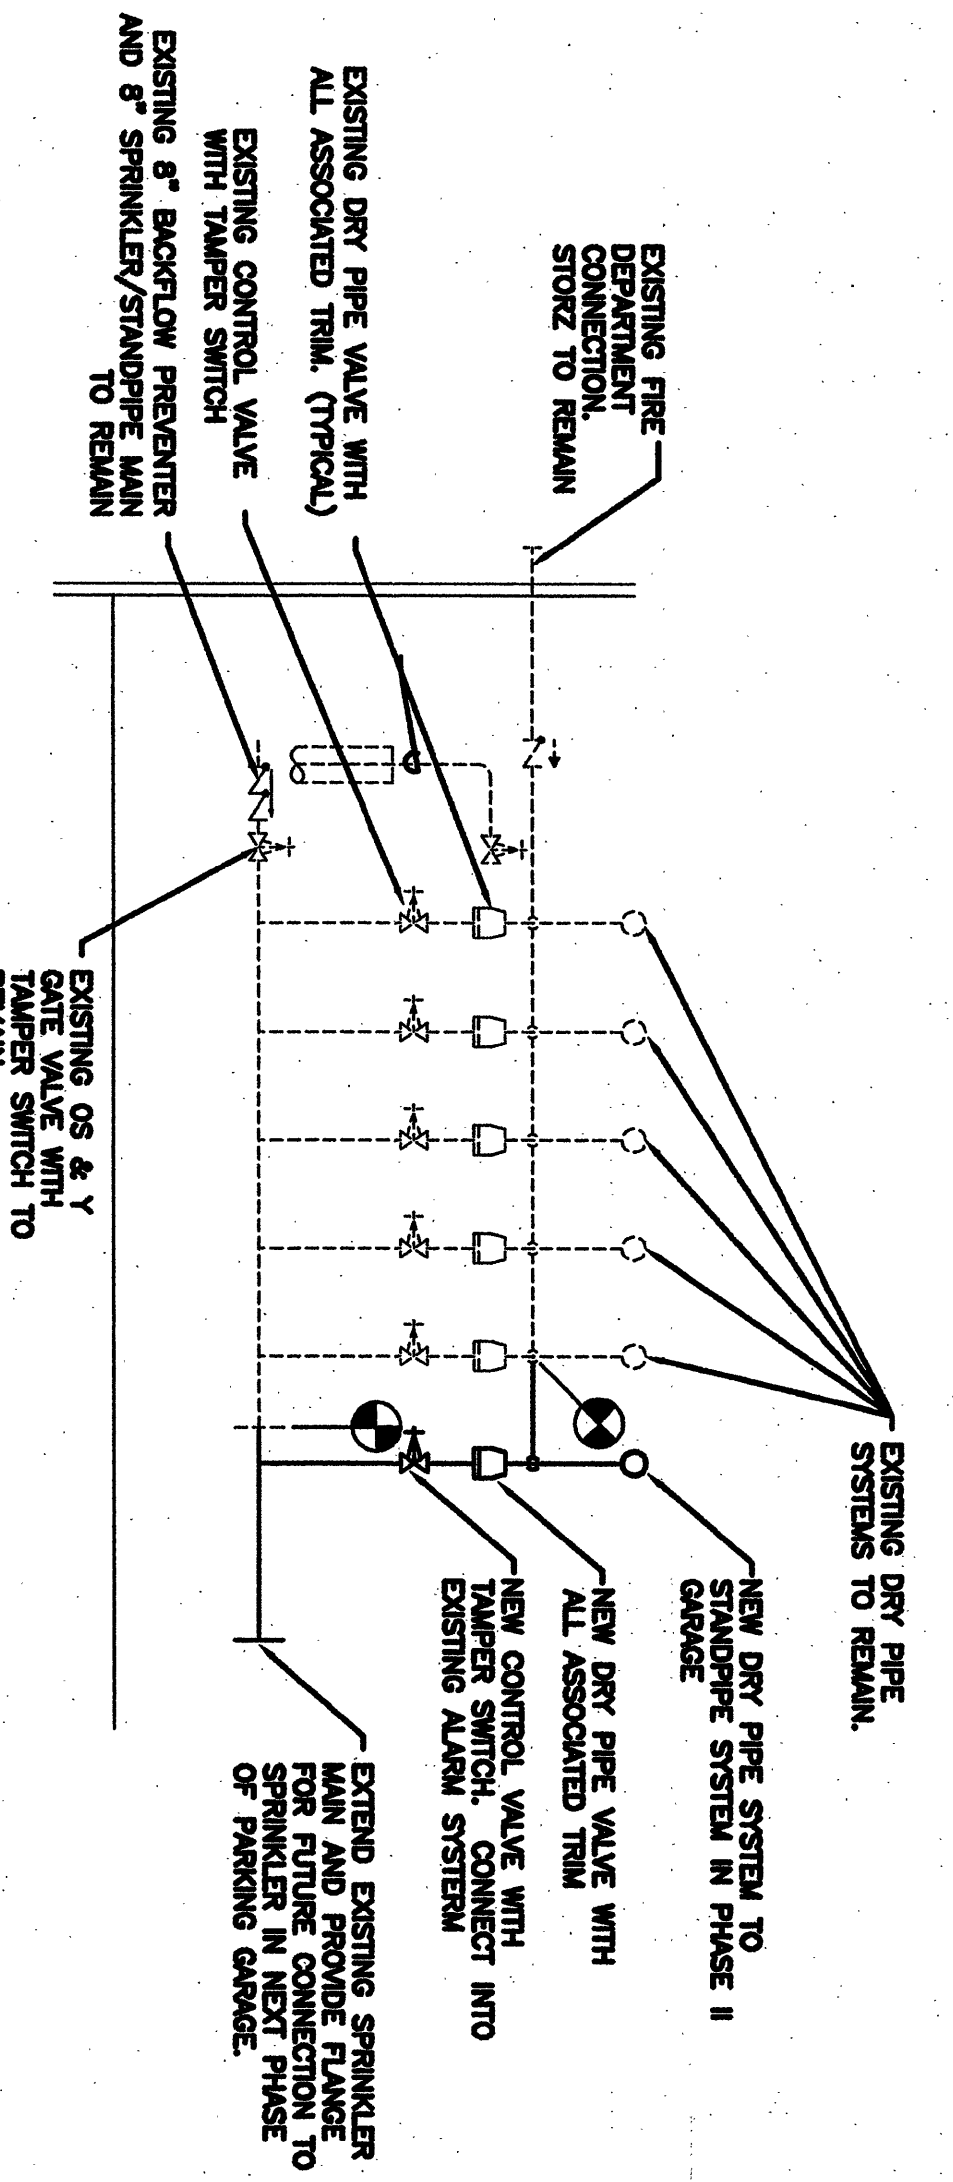

EXISTING SPRINKLER/STANDPIPE ENTRANCE RISER SCHEMATIC  
NOT TO SCALE

If this sheet is less than 30"x42" in size, it has been reduced. Graphic reproduction is not guaranteed.

**DOMENECH HICKS & KROCKMALNIC ARCHITECTS**  
155 Massachusetts Ave.  
Boston, MA 02115  
617-267-4408  
Fax: 617-267-1990



**StanTec**  
StanTec Consulting Services Inc.  
200 Park Street, 200  
Portland, ME, U.S.A.  
04101-3900  
Tel. 207.775.3211  
Fax. 207.775.5454  
www.stantec.com

CONFORMED SET  
FOR FIELD USE

CITY OF PORTLAND  
PORTLAND, MAINE  
DEPARTMENT OF  
WATERFRONT AND  
TRANSPORTATION




PORTLAND  
INTERNATIONAL  
JETPORT

PHASE II  
PARKING GARAGE  
1001 WESTBROOK ST.,  
PORTLAND, MAINE

NO.	DATE	DESCRIPTION	BY	CHKD.
1	11/22/22	DESIGN SUBMITTAL (R52)		

AS SHOWN

LEVELS 2, 3, 4 AND 5  
SPRINKLER/STANDPIPE PLAN-TYPICAL

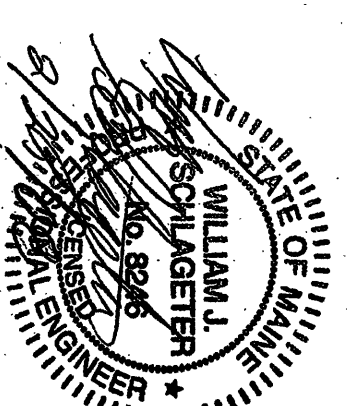

FP-1-2

Project No.	182410129
Date	02/29/20