April 13, 2004 - 12:57 pm
\\Msefps1\projects\0118\Post Bid\0118-M1-M2.dwg

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND SHALL REMAIN THE PROPERTY OF PHILLIP J. DOUGHTY ASSOC. ARCHITECTS. IT SHALL NOT BE REPRODUCED COPIED, LOANED OR DISCLOSED WITHOUT WRITTEN PERMISSION AND SHALL NOT BE USED FOR OTHER THAN FOR WHICH IT IS SPECIFICALLY FURNISHED AND MUST BE RETURNED TO PHILLIP J. DOUGHTY ASSOC. ARCHITECTS ON COMPLETION OF WORK IF REQUESTED.

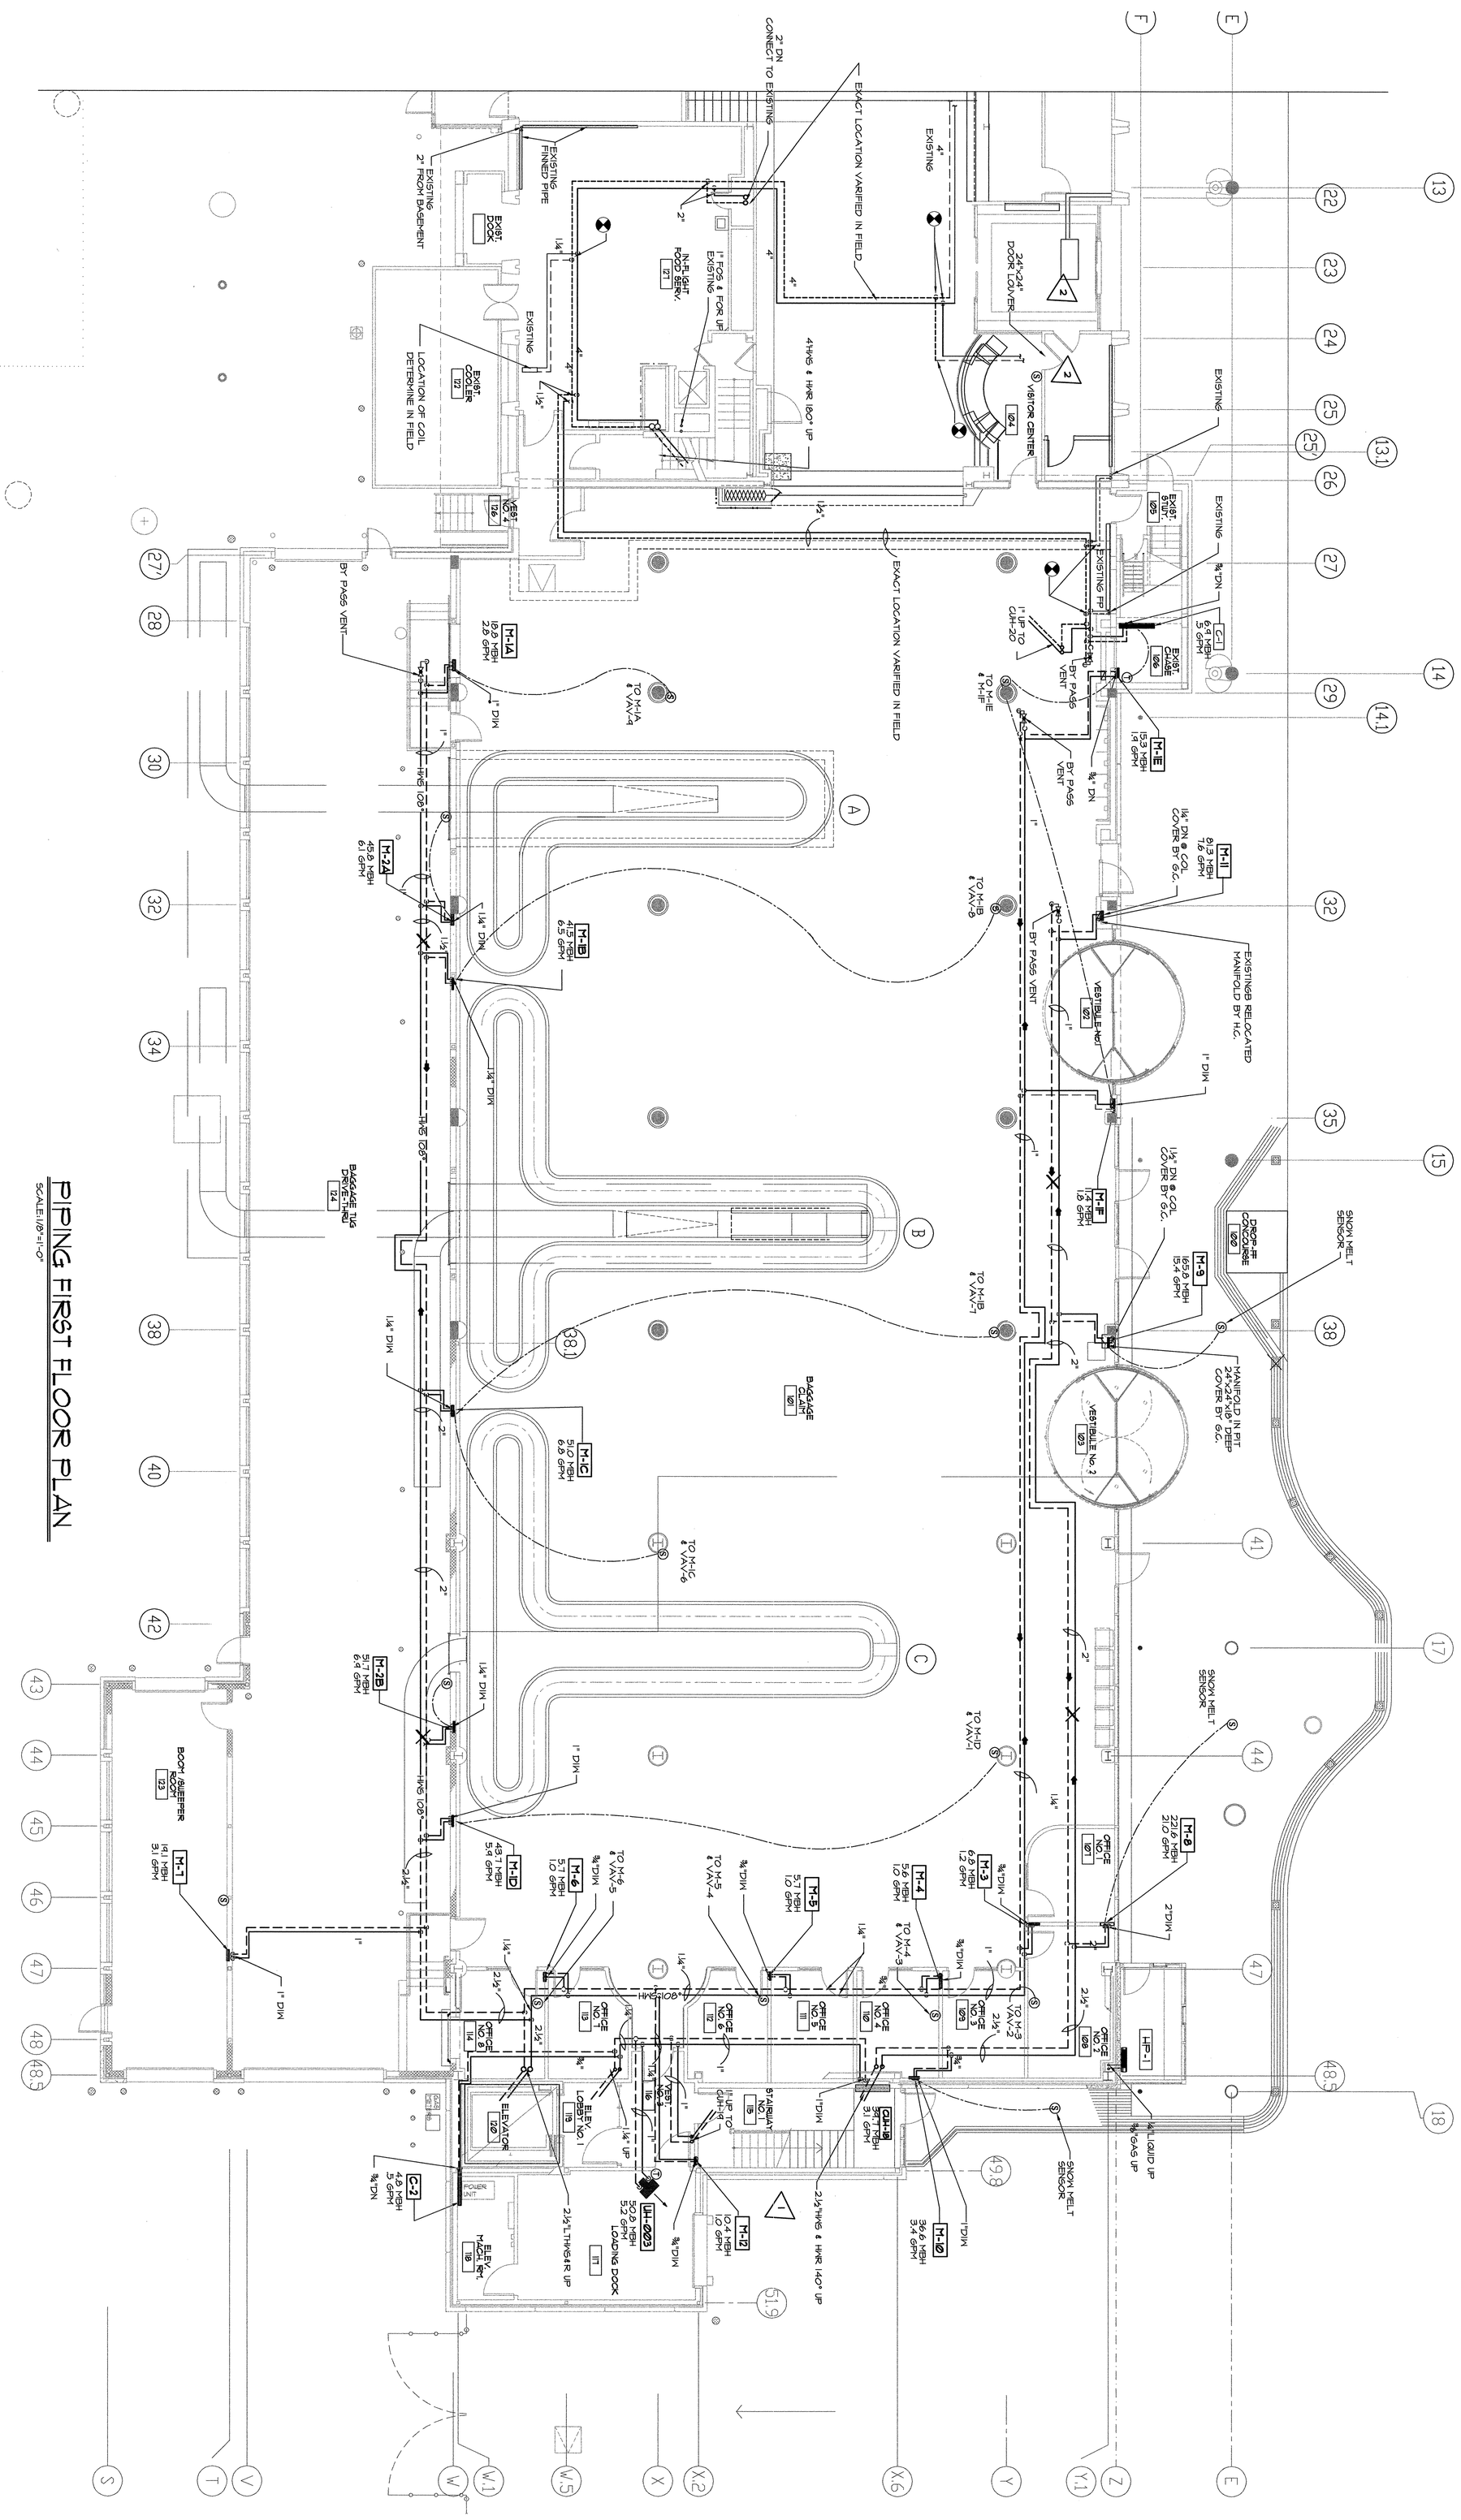
2" DN CONNECT TO EXISTING
EXACT LOCATION VARIFIED IN FIELD
4" EXISTING
EXISTING FINNED PIPE
EXISTING 2" FROM BASEMENT
EXIST. DOCK
1" FOS & FOR UP EXISTING
M-11 LIGHT FOUNTAIN EQUIP. 127
24"x24" DOOR LOUVER
VISITOR CENTER 124
4"HWS & HWR, 180° UP
EXISTING
LOCATION OF COIL DETERMINE IN FIELD
EXIST. COOLER 122
EXIST. CLOSET 126
EXIST. TOILET 125
EXISTING FP
EXACT LOCATION VARIFIED IN FIELD
1" UP TO CUH-20
C-1 6.4 MBH 0.3 GPM
EXIST. CASE 126
BY PASS VENT
M-1E 15.3 MBH 1.3 GPM
TO M-1E & M-1F
BY PASS VENT
M-1A 18.8 MBH 2.8 GPM
1" DIM
TO M-1A & VAV-4
HWS 108°
HWR 108°
M-2A 45.8 MBH 6.1 GPM
1¼" DIM
M-1B 41.5 MBH 6.5 GPM
1¼" DIM
BAGGAGE CLAIM DRIVE-THRU 124
M-1C 51.0 MBH 6.8 GPM
TO M-1C & VAV-6
2" DIM
M-2B 51.7 MBH 6.9 GPM
1¼" DIM
1" DIM
HWS 108°
43.7 MBH 5.9 GPM
M-1D
2½"
BOOM / SWEEPER ROOM 123
M-1 19.1 MBH 3.1 GPM
1" DIM
M-6 51.0 MBH 10.1 GPM
¾" DIM
TO M-6 & VAV-5
M-5 57.1 MBH 10.1 GPM
¾" DIM
TO M-5 & VAV-4
M-4 56.6 MBH 10.1 GPM
¾" DIM
TO M-4 & VAV-3
M-3 6.7 MBH 1.2 GPM
¾" DIM
TO M-3 & VAV-2
2½"
OFFICE NO. 1 113
OFFICE NO. 8 114
OFFICE NO. 6 112
OFFICE NO. 5 111
OFFICE NO. 4 110
OFFICE NO. 3 103
OFFICE NO. 2 108
HP-1
HWS 108°
ELEVATOR 120
ELEV. LOBBY NO. 1 119
TEST NO. 3 116
1" UP TO CUH-19
STAIRWAY NO. 1 115
CUH-19 38.7 MBH 3.1 GPM
1" DIM
2½"HWS & HWR 140° UP
M-12 10.4 MBH 1.0 GPM
M-10 36.6 MBH 3.4 GPM
1" DIM
ELEV. MACH. RM. 118
2½"L.T.HWS&R UP
POWER UNIT
C-2 4.8 MBH .5 GPM
¾" DN
UH-003 50.8 MBH 5.2 GPM LOADING DOCK 117
¾" DIM
M-1 10.4 MBH 1.0 GPM
TO M-1 & VAV-1
M-9 65.8 MBH 15.4 GPM
2" DIM
TO M-1B & VAV-1
2"
MANIFOLD IN PIT 24"x24"x18" DEEP COVER BY G.C.
VESTIBULE No. 2 103
SNOW MELT SENSOR
DROP-IN CONCOURSE 100
1¼" DN @ COL COVER BY G.C.
M-F 1.4 MBH 1.8 GPM
1¼" DN @ COL COVER BY G.C.
M-11 9.2 MBH 1.8 GPM
EXISTING/RELOCATED MANIFOLD BY H.C.
VESTIBULE No. 1 101
1" DIM
TO M-1B & VAV-3
M-8 22.6 MBH 2.10 GPM
2"DIM
SNOW MELT SENSOR
OFFICE NO. 7 107
1¼"
TO M-1D & VAV-1
SNOW MELT SENSOR
1¼" LIQUID UP
¾" GAS UP
EXISTING
EXISTING
EXISTING