

R. W. Gillespie & Associates, Inc.

86 Industrial Park Road, Suite 4, Saco, ME 04072 207-286-8008
200 International Drive, Suite 170, Portsmouth, NH 03801 603-427-0244

LETTER OF TRANSMITTAL

Doughty & Associates, Inc.

362 U.S. Route One

Falmouth, ME 04105

Date:	October 14, 2004	Project No.:	438-05
Attention:	Mr. Phillip Doughty (pdarch@maine.rr.com)		
Re:	Concrete Testing New Jetways & Addition to Baggage Claim Portland Jetport Portland, Maine		

We are sending you attached concrete cylinder test results.

Cylinder No. (s)	Age (Days)
48491	28
48492	28

Remarks:

Copy To: Roy Williams (rsw@ci.portland.me.us)

Todd Neal, Becker Structural Engineering (Todd@beckerstructural.com)

Signed: Bertha Dawn

If enclosures are not as noted, kindly notify us at once.

R. W. GILLESPIE & ASSOCIATES, INC.

86 Industrial Park Road, Suite 4, Saco, ME 04072 207-286-8008
 200 International Drive, Suite 170, Portsmouth, NH 03801 603-427-0244
CONCRETE TEST/PLACEMENT REPORT

Project Name:	New Jetways & Addition to Baggage Claim	Date Cylinders Cast:	16-Sep-04
Project No:	438-05	Concrete Supplier:	Auburn
Weather Conditions:	Sunny	General Contractor:	Ledgewood
Method of Placement:	Ready Mix Truck	Design Strength:	3,000
Admixtures:	Superplasticizer, ADVA	Max Agg. Size:	3/4
Placement Location:	Foundation Wall: Line 43/S to V & Line S/43 to 48.5		
Test Cylinder Location:	Line S/44		

Date Report Issued: OCT 15 2004

6x12 Cylinders	4	Cast by	Chad N. Gryskwicz	Time	
Load No.	1	Slump (in) ASTM C 143	6.25	Batched @	1:58
Ticket No.	71396	Air (°F)	81	Arrived @	2:05
Truck No.	96	Concrete (°F) ASTM C 1064	81	Total Time	45
Cubic Yds.	10	Air Content (%) ASTM C 231	3.6		


*Concrete sampled by ASTM C 172

Specimen Storage ASTM C 31: Field cure days: 1
 Date received: 17-Sep-04
 Condition of Cylinders: Good

Lab No.	Test Date	Avg Dia (in)	Area (in ²)	Age (Days)	Load (lbs)	Compressive Strength (psi)	Break type
48490	23-Sep-04	6.002	28.29	7	107,140	3790	4
48491	14-Oct-04	6.000	28.27	28	127,860	4520	4
48492	14-Oct-04	6.000	28.27	28	125,500	4440	4
48493	HOLD			HOLD			

*Concrete compressive strength by ASTM C 39

Types of Breaks

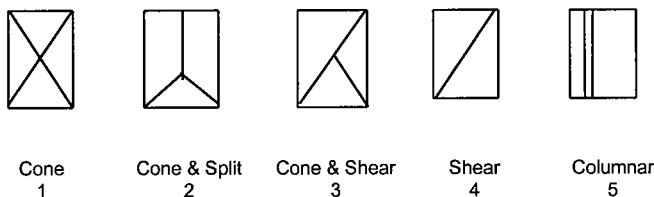

Load	Ticket Number	Truck Number	Cubic Yds	Slump (inches)	Air Temp (°F)	Conc Temp (°F)	(%) Air Content	Time (min.)
2	71399	63	1.50	--	--	--	--	23

Remarks:

Checked by: *Matthew P. Hilley*
 or George S. Morrell, Supervisor