

Silk

1187 Westbrook St


8125/115

mentation round. FOR THIS REASON, THE DISTANCES TO PROPERTY LINES ARE APPROXIMATE AND INTENDED FOR CITY USE ONLY.

Existing

Distance Between two barns approx. 22 inches.

(Answer)

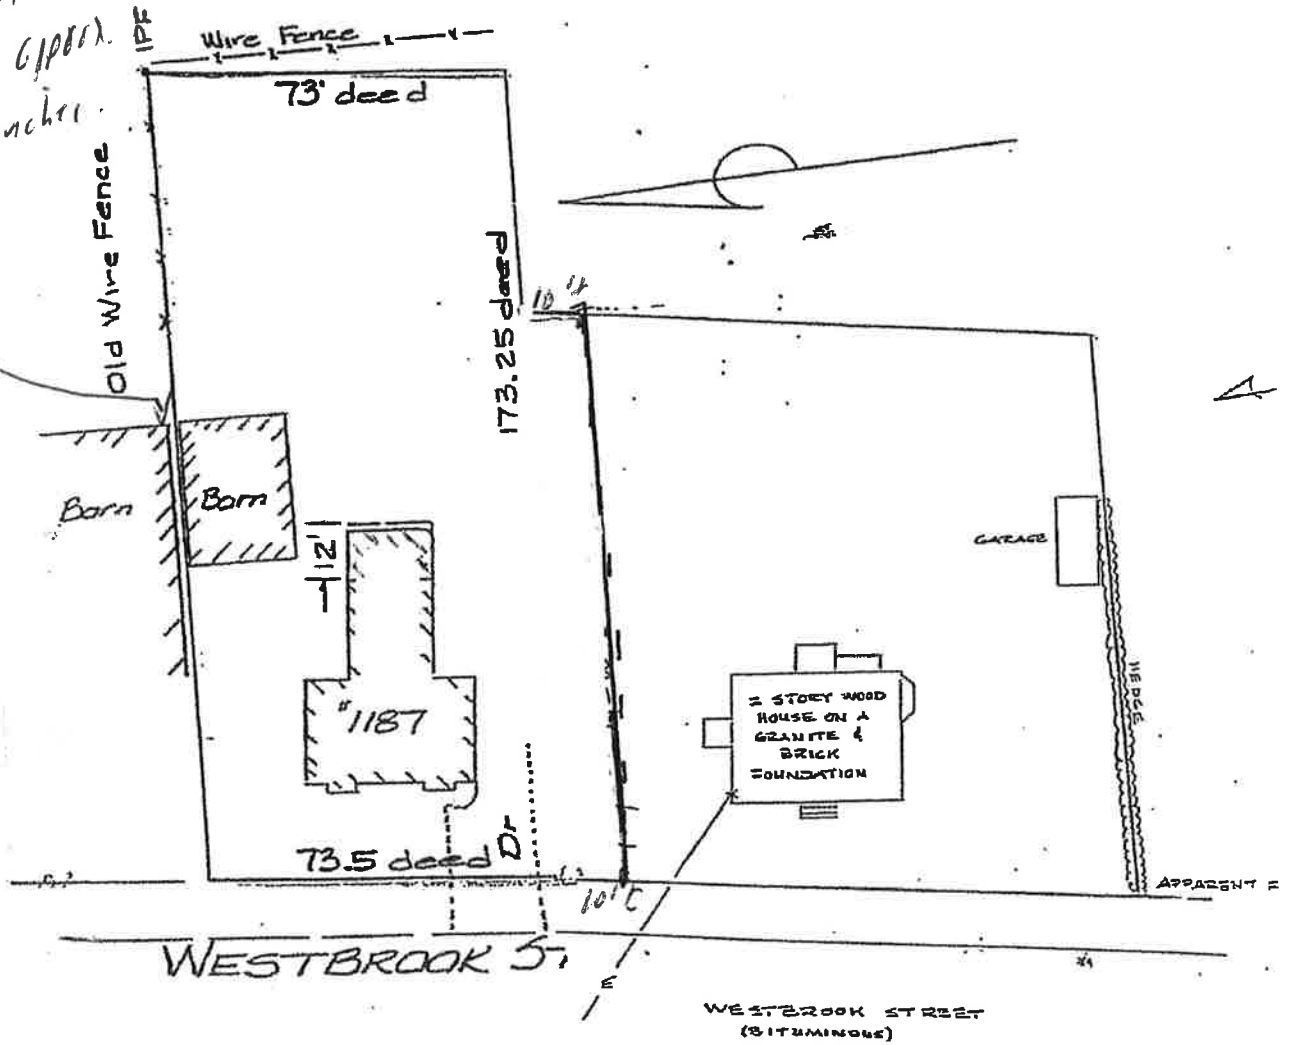

WESTBROOK ST

WESTBROOK STREET (BITUMINOUS)

1187 WESTBROOK STREET
PORTLAND MAINE

SCALE 1" = 40'

John P. Kuntz

HASKELL, INC.
Land Surveyor
Broadway
PORTLAND, MAINE 04106
799-5694

...days or Effective Date of this Contract. If the water supply test results are "Unsatisfactory" or "Satisfactory" with any qualification, the water test results must be acceptable to Purchaser. If the results are unacceptable to Purchaser, the Purchaser may, by notifying Seller in writing within 3 days after receiving the test results, declare this Contract null and void and the contract money shall be...