


Silk

1187 Westbrook St

8/25/11

mentation found. FOR THIS REASON, THE DISTANCES TO PROPERTY LINES ARE APPROXIMATE AND INTENDED FOR CITY USE ONLY.

Proposed

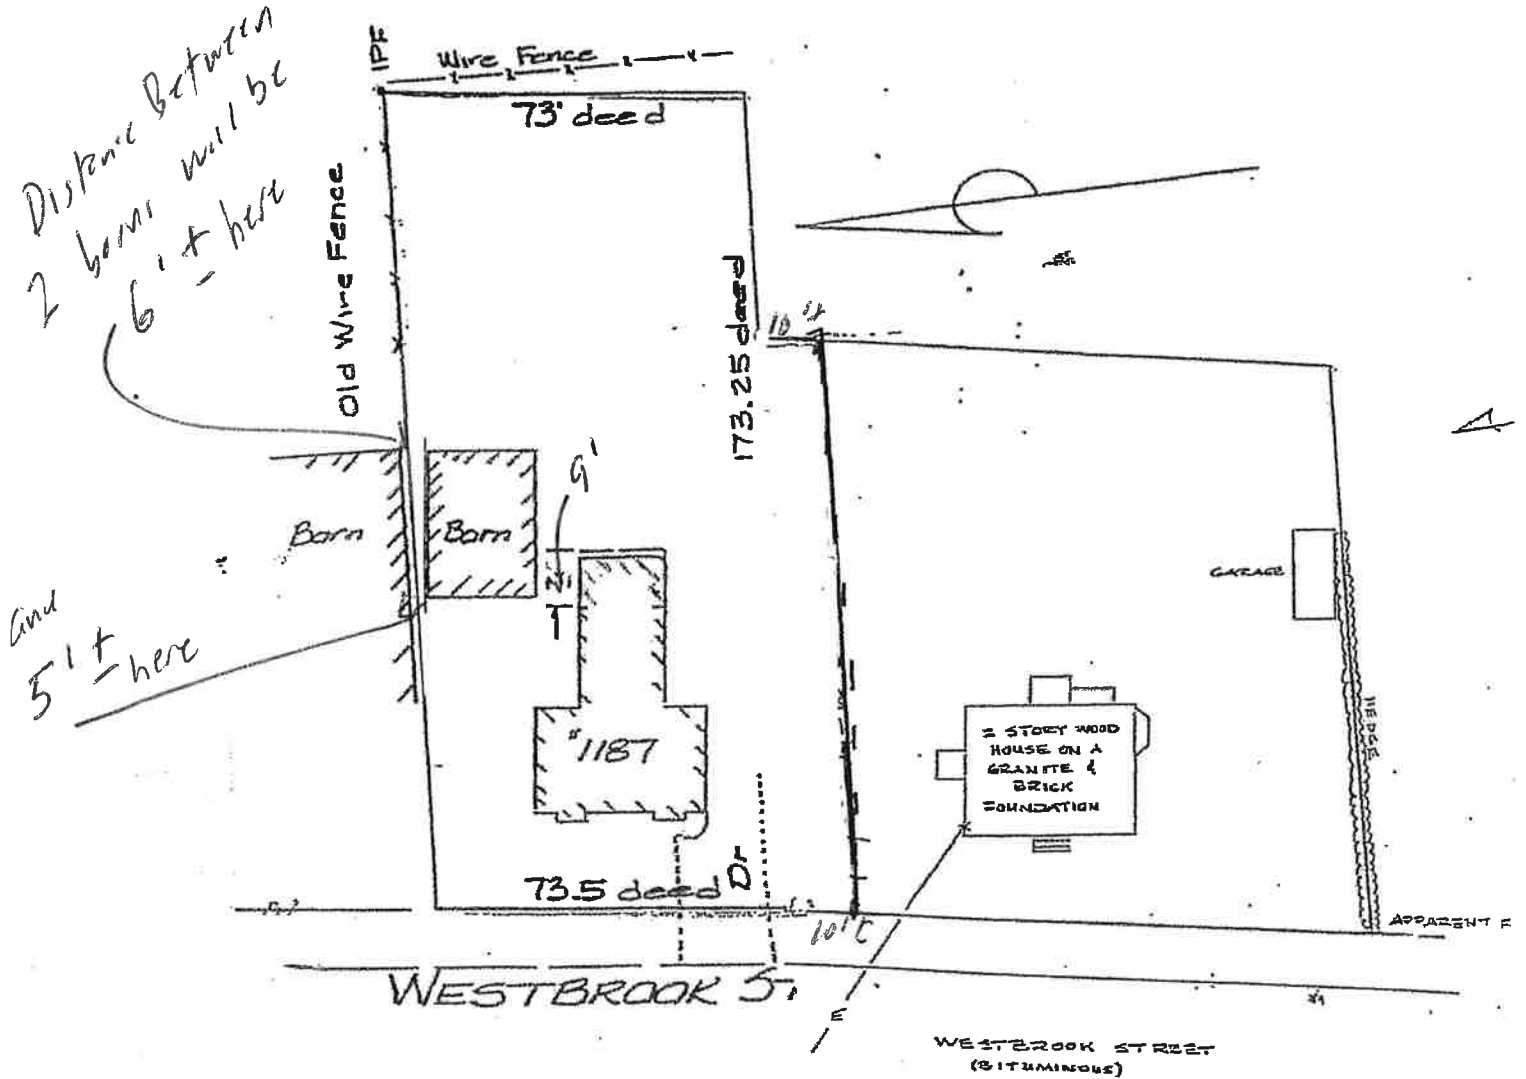

Alan P. [Signature]

1187 WESTBROOK STREET
PORTLAND MAINE

SCALE 1" = 40'

HASKELL, INC.
and Surveyor
Broadway
LAND, MAINE 04106
(799-5694)

...days of Effective Date of this Contract. If the water supply test results are "Unsatisfactory" or "Satisfactory" with any qualification, the water test results must be acceptable to Purchaser. If the results are unacceptable to Purchaser, the Purchaser may, by notifying Seller in writing within 3 days after receiving the test results, declare this Contract null and void and the