


SEE SHEET E.1.2 FOR CONTINUATION

UNDERGROUND CONDUIT SCHEDULE

- \* (A) (2) 5" PVC CDTs (CMP PRIMARY)
- (B) (2) 4" PVC CDTs (TELEPHONE)
- (C) (2) 4" PVC CDTs (SECONDARY SERVICE)
- (D) (4) 4" PVC CDTs (SECONDARY SERVICE)
- (E) (1) 1-1/4" PVC CDT (CMP METER)
- (F) (1) 1-1/4" PVC CDT (SITE LIGHTING)

\* CONCRETE ENCASE CONDUITS


1. DISCONNECT AND REMOVE EXISTING UNDERGROUND ELECTRICAL SERVICE ONLY AFTER NEW SERVICE IS INSTALLED AND IS FUNCTIONAL.
2. DISCONNECT AND REMOVE EXISTING OVERHEAD ELECTRICAL AND TELEPHONE UTILITY LINES ONLY AFTER NEW SERVICES ARE INSTALLED AND ARE FUNCTIONAL.
3. COORDINATE EXACT LOCATION OF NEW SERVICE ENTRANCE CONDUITS INTO ELECTRICAL ROOM WITH ARCHITECTURAL FLOOR PLANS.
4. WHERE INDICATED, PROVIDE REPLACEMENT ELECTRICAL SERVICE TO MATCH EXISTING SERVICE SIZE.
5. WHERE REPLACEMENT SERVICES ARE INDICATED AT EXISTING BUILDINGS, PROVIDE ALL NECESSARY CONNECTIONS TO EXISTING FACILITIES.
6. MINIMUM BURIAL DEPTH FOR CONDUITS SHALL BE 36-INCHES.

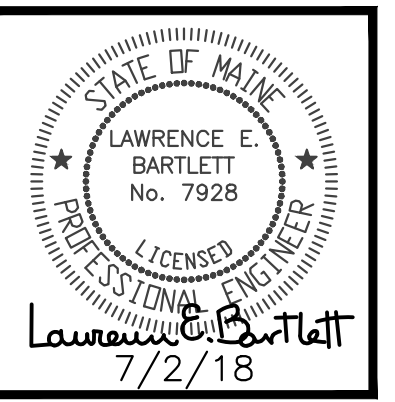

project no.	18-0018
revisions:	
Project	JOHNSON ROAD PROPERTY 90 JOHNSON ROAD PORTLAND, MAINE
Drawing title	SITE LIGHTING CALCULATION RESULTS

date drawn:	06/22/18
date issued:	07/02/18
drawn by:	LEB
scale:	AS NOTED

**Bartlett Design**  
LIGHTING & ELECTRICAL ENGINEERING  
5 PALMER STREET, BATH, ME 04530  
TEL: (207) 443-5447

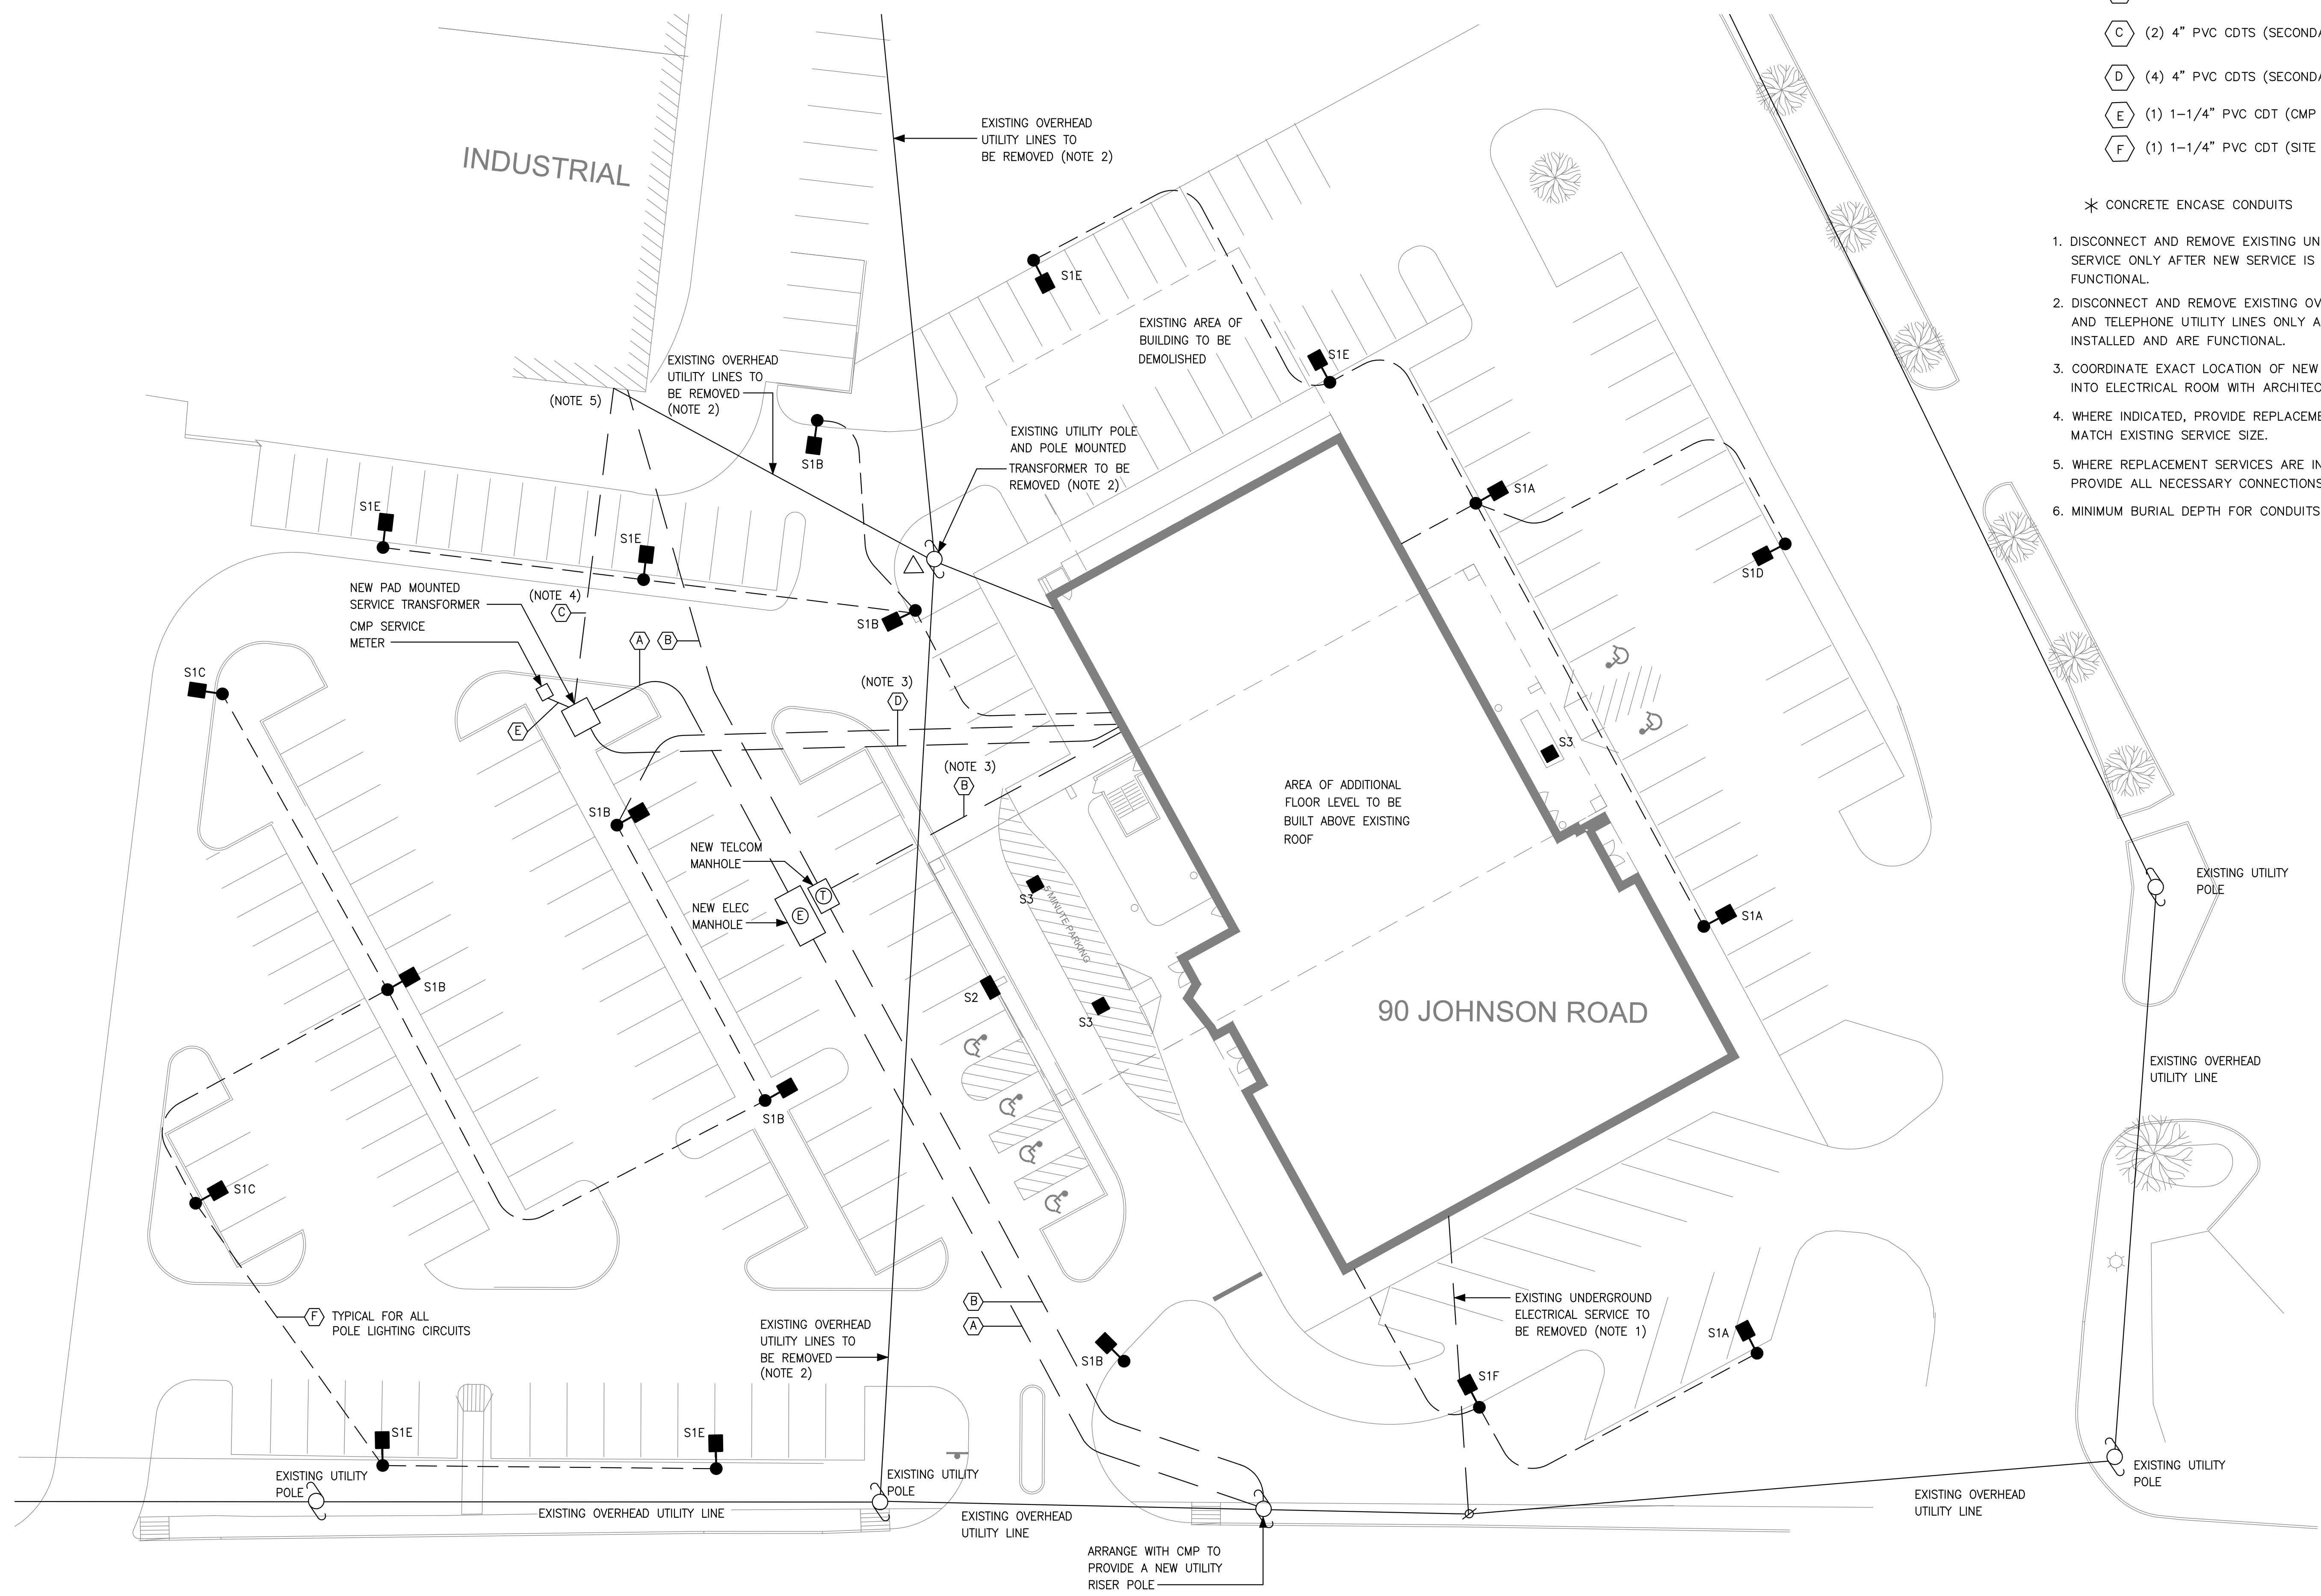

JOHNSON ROAD

SCALE: 1" = 20'-0"

ELECTRICAL SITE PLAN

1

E-1.1

sheet number