


**NOTES:**

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
2. REMOVAL OF EQUIPMENT & DEVICES TO INCLUDE REMOVAL OF ALL CONDUIT & WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE.
3. REMOVE SPEAKERS FOR WHITE NOISE SYSTEM TO ALLOW FOR CEILING GRID REPLACEMENT. RE-INSTALL AT LOCATIONS SHOWN ON EY102.
4. REMOVE PLENUM RATED CABLE FOR SMOKE DETECTORS AND SMOKE DETECTORS TO ALLOW CEILING GRID REPLACEMENT. RE-INSTALL AT LOCATIONS SHOWN ON EY102.

**KEYED NOTE:**

- ① RELOCATE CLOCK AND FIRE ALARM NOTIFICATION DEVICE AT LOCATIONS SHOWN ON EY102.

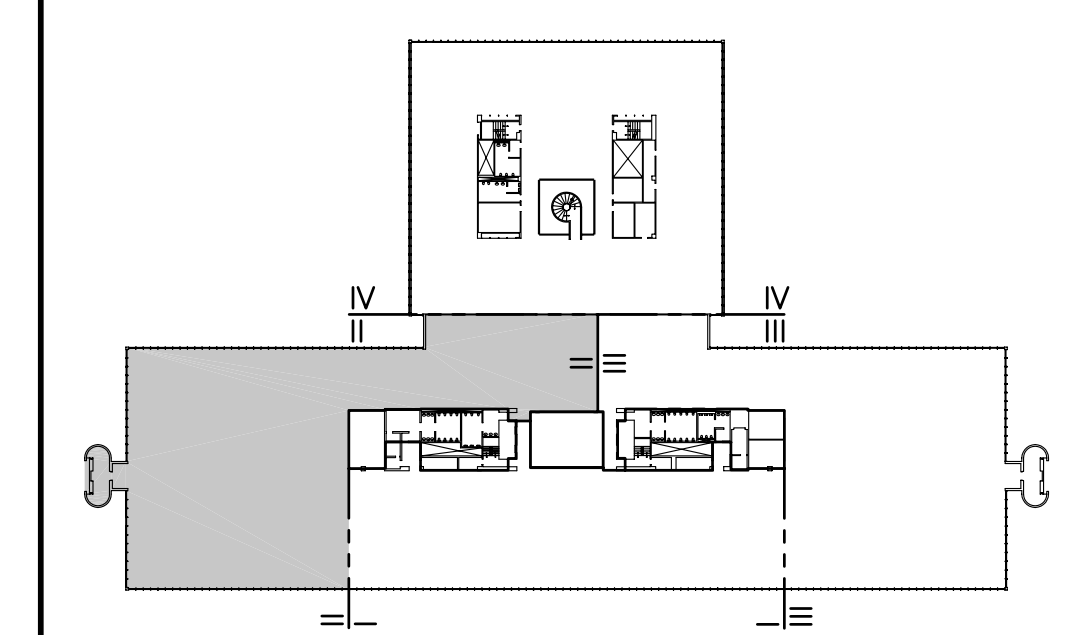

**F18 KEY PLAN**

NOT TO SCALE	
0	ISSUED FOR CONSTRUCTION
REV.	DESCRIPTION
	DATE

**ISSUED FOR CONSTRUCTION**  
1-28-04

CURRENT ISSUE STATUS:


**ARCHITECTURE ENGINEERING PLANNING**

SMRT  
144 Fore Street, P.O. Box 618  
Portland, Maine 04104  
tel. (207) 772-3846  
fax. (207) 772-1070

**UNUMPROVIDENT HO-1**  
**2nd FLOOR OFFICE RENOVATIONS**  
PORTLAND, ME.

**PHASE II**  
**ELECTRICAL DEMOLITION PLAN**

SHEET TITLE:	1-28-04
SCALE: 1/8"=1'-0"	DATE: 1-28-04
PROJECT MANAGER: JLH	GRAPHIC SCALE: 0" 1"
JOB CAP/DRAWN: CEB/BGG	
A/E OF RECORD: DJT	SHEET No.
SMRT CAD FILE: ED102-03100-01	<b>ED102</b>
PROJECT No. 03100-01	