


NOTES:

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
2. REMOVAL OF EQUIPMENT & DEVICES TO INCLUDE REMOVAL OF ALL CONDUIT & WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE.
3. REMOVE PLENUM RATED CABLE FOR SMOKE DETECTORS AND SMOKE DETECTORS TO ALLOW CEILING GRID REPLACEMENT. RE-INSTALL AT LOCATIONS SHOWN ON EY104.

KEYED NOTE:

- ① RELOCATE CLOCKS AND FIRE ALARM NOTIFICATION DEVICES AT LOCATIONS SHOWN ON EY104.

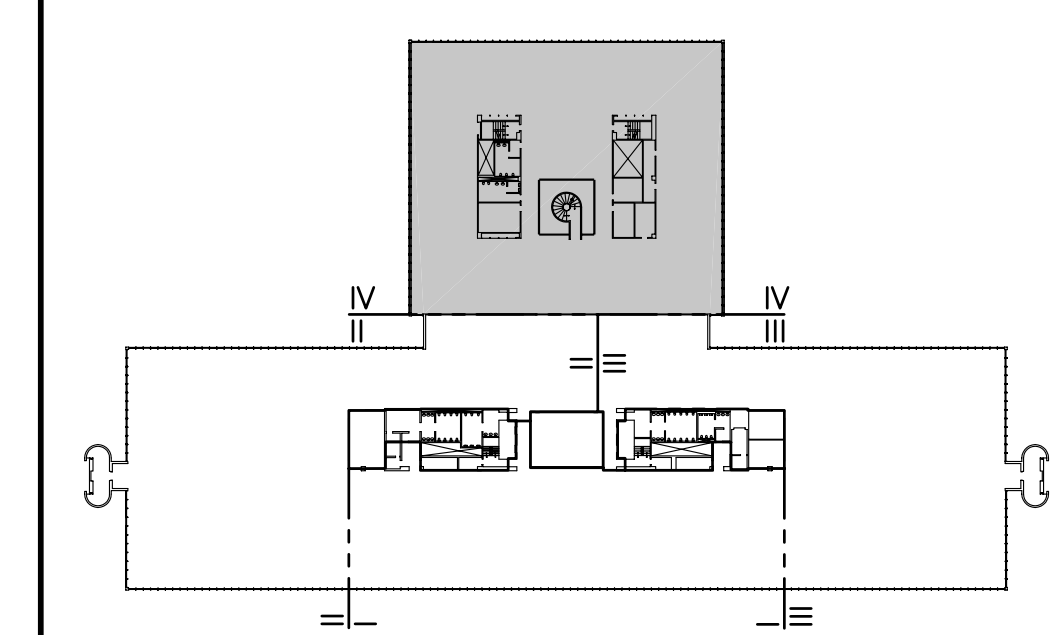

F18 KEY PLAN

NOT TO SCALE	
0	ISSUED FOR CONSTRUCTION
REV.	DESCRIPTION
	DATE

ISSUED FOR CONSTRUCTION
1-28-04

PROJECT NORTH

SMRT ARCHITECTURE ENGINEERING PLANNING
 144 Fore Street/P.O. Box 618
 Portland, Maine 04104
 tel. (207) 772-3846
 fax. (207) 772-1070

UNIMPROVIDENT HO-1
 2nd FLOOR OFFICE RENOVATIONS
 PORTLAND, ME.

PHASE IV ELECTRICAL DEMOLITION PLAN

SHEET TITLE:	1-28-04
SCALE:	1/8"=1'-0"
DATE:	1-28-04
PROJECT MANAGER:	JLH
GRAPHIC SCALE:	0" 1"
JOB CAP/DRAWN:	CEB/BGG
A/E OF RECORD:	DJT
SHEET No.	ED104
SMRT CAD FILE:	ED104-03100-01
PROJECT No.	03100-01