


NOTES:



- SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
- REMOVE SMOKE DETECTORS, SOUND SYSTEM SPEAKERS, WHITE NOISE SPEAKERS AND OCCUPANCY SENSORS TO ALLOW CEILING TILE REPLACEMENT. RE-INSTALL AT LOCATIONS SHOWN ON SHEETS EL102 & EY102. SMOKE DETECTORS TO BE REWIRED USING UL LISTED FIRE ALARM MC CABLE.

KEYED NOTE:

① EXISTING FIRE ALARM NOTIFICATION DEVICES TO REMAIN. REMOVE EXISTING WIRING AND RE-WIRE DEVICES WITH UL LISTED FIRE ALARM MC CABLE.

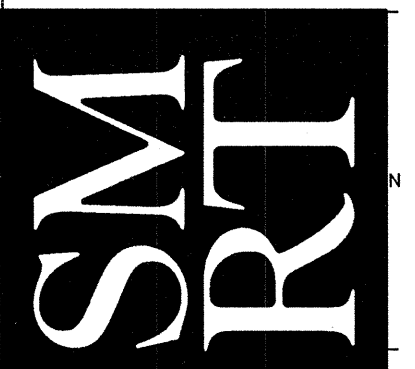


ARCHITECTURE ENGINEERING PLANNING
SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070

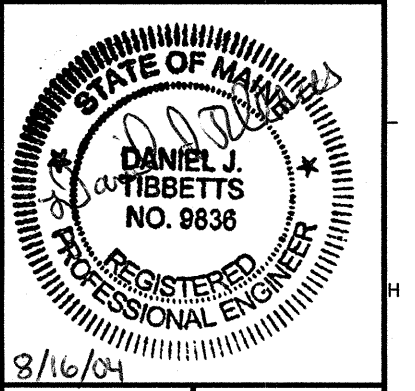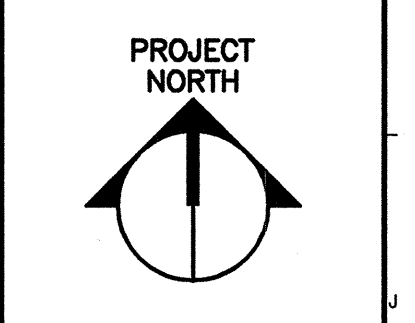

PROJECT TITLE:
**UNIMPROVIDENT CORPORATION
HO-1 BEACON PHASE II**
PORTLAND, MAINE

CURRENT ISSUE STATUS:
**ISSUED FOR CONSTRUCTION
8-16-2004**

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	8-16-04

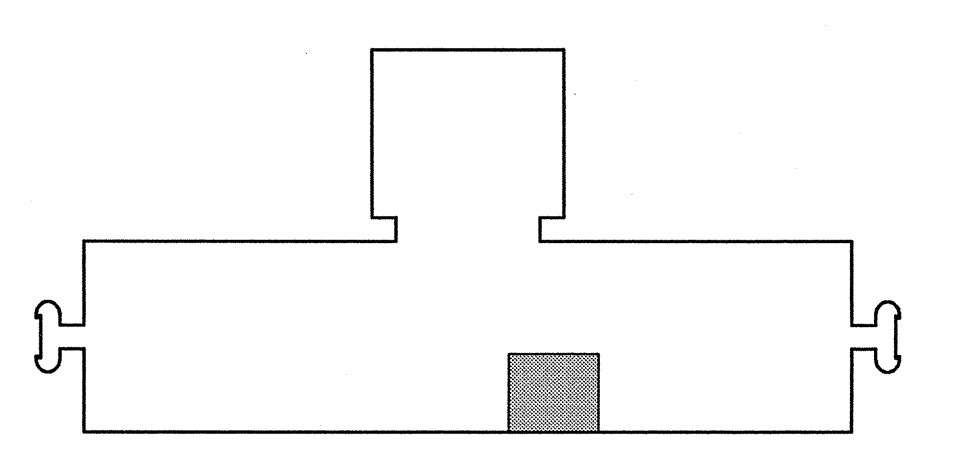

GRAPHIC SCALE:
0" 1"
SCALE: 1/4"=1'-0"
PROJECT MANAGER: JLH
JC/DRAWN BY: BHG
A/E OF RECORD: DJT
CAD FILE: ED102-04054
PROJECT NO: 04054-00
DATE:

A1 I-ROOMS DEMOLITION PLAN (ALTERNATE BID)
1/4"=1'-0" *

A14 KEYPLAN
NOT TO SCALE

SHEET TITLE:
**DEMOLITION PLAN
I-ROOMS**
SHEET No.
ED102
© COPYRIGHT 2004 SMRT INC