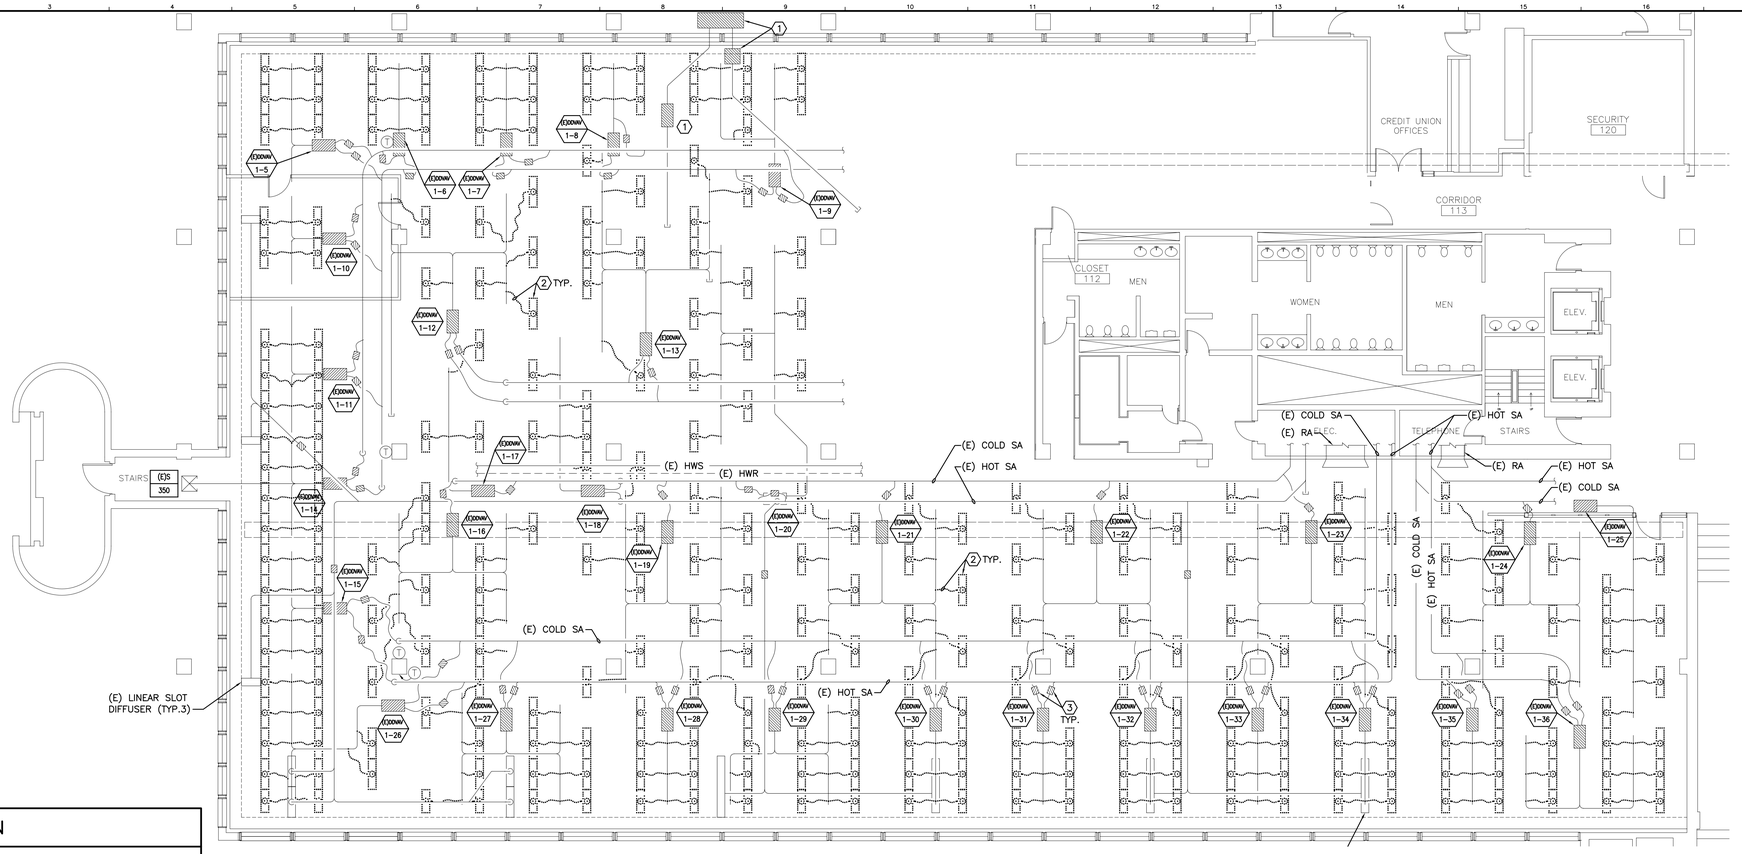

J1	DEMOLITION PLAN
1/8"=1'-0"	*

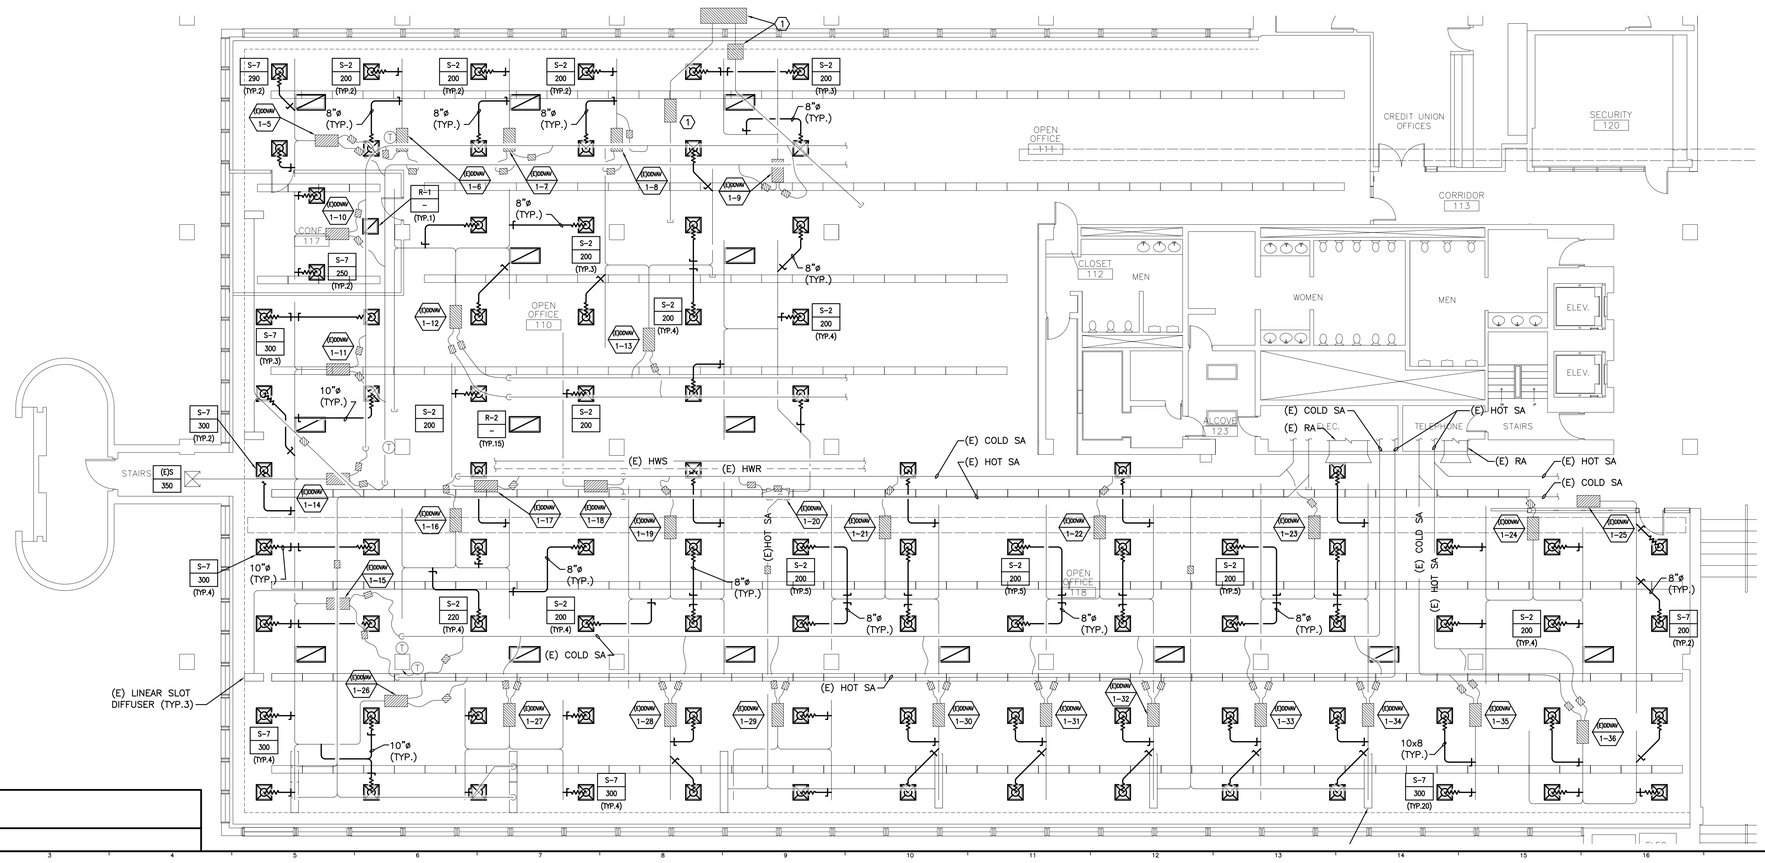

A1	FLOOR PLAN
1/8"=1'-0"	*

NOTES:

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.
2. CONTRACTOR TO LOOK/LISTEN FOR LEAKS IN EXISTING DUCTWORK. REPAIR AND SEAL AS REQUIRED. INSPECT AND REPAIR DUCT INSULATION ON COLD AIR SUPPLY BRANCH DUCTWORK ON INLET AND DOWNSTREAM OF VAV BOXES.

KEYED NOTES:

1. ABANDONED EXHAUST SYSTEM.
2. REMOVE LIGHT TROFFER DIFFUSERS AND BRANCH DUCTWORK. CAP AND SEAL SUPPLY DUCT OPENINGS.
3. MITCO VALVE. CLEAN, ADJUST, VERIFY PROPER OPERATION, AND BALANCE.

REV.	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION - PHASE 3	6-9-03

ISSUE FOR CONSTRUCTION PHASE 3 6-9-03

CURRENT ISSUE STATUS:

SMRT

ARCHITECTURE ENGINEERING PLANNING

SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104

tel. (207) 772-3846
fax. (207) 772-1070

PROJECT: UNUMPROVIDENT HO1 OPEN OFFICE RENOVATIONS PORTLAND, ME.

SHEET TITLE: PHASE 3- MECHANICAL PLAN

SCALE: 1/8"=1'-0"	DATE: 6-9-03
PROJECT MANAGER: JLH	GRAPHIC SCALE: 0" 1"
JOB CAP/DRAWN: RJL/BGG	
A/E OF RECORD: LPA	SHEET No. M-103
SMRT CAD FILE: M-103-03051	
PROJECT No. 03051	

© COPYRIGHT 2003 SMRT INC.