

**City of Portland, Maine - Building or Use Permit Application**  
 389 Congress Street, 04101 Tel: (207) 874-8703, Fax: (207) 874-8716

Permit No: 03-1095	Issue Date: SEP 30 2003	CBL: 215 B002001
-----------------------	----------------------------	---------------------

Location of Construction: 2211 Congress St <i>per Tremblay</i>	Owner Name: Unum Corp <i>Contact:</i>	Owner Address: 2211 Congress St <i>CITY OF PORTLAND</i>	Phone: 207-575-1837
Business Name: n/a	Contractor Name: The Macmillin Company, Inc. <i>Ken</i>	Contractor Address: 17 Elm Street, P.O. Box 626 Keene	Phone: 6033523070
Lessee/Buyer's Name: n/a	Phone: n/a	Permit Type: Alterations - Commercial	Zone: <i>OP</i>

Past Use: Commercial / Unum Provident Corporation	Proposed Use: Unum Provident Corporation / Boiler & Chiller plant upgrade, underground piping, electrical upgrades and related work.	Permit Fee: \$20,145.00	Cost of Work: \$2,235,190.00	CEO District: 3
--	---	----------------------------	---------------------------------	--------------------

Proposed Project Description: Boiler & Chiller plant upgrade, underground piping, electrical upgrades, and related work.	FIRE DEPT: <input checked="" type="checkbox"/> Approved <input type="checkbox"/> Denied	INSPECTION: Use Group: <i>B</i> Type: <i>NA</i>
	Signature: <i>[Signature]</i>	Signature: <i>[Signature]</i>

PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)	
Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved w/Conditions <input type="checkbox"/> Denied	Signature: _____ Date: _____

Permit Taken By: <i>gg</i>	Date Applied For: 09/08/2003	<b>Zoning Approval</b>	
-------------------------------	---------------------------------	------------------------	--

1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal Rules.  2. Building permits do not include plumbing, septic or electrical work.  3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..	Special Zone or Reviews <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan Maj <input type="checkbox"/> Minor <input type="checkbox"/> MM <input type="checkbox"/> Date: <i>09/15/03</i>	Zoning Appeal <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied Date: _____	Historic Preservation <input checked="" type="checkbox"/> Not in District or Landmark <input type="checkbox"/> Does Not Require Review <input type="checkbox"/> Requires Review <input type="checkbox"/> Approved <input type="checkbox"/> Approved w/Conditions <input type="checkbox"/> Denied Date: <i>[Signature]</i>
--	--	--	--

**CERTIFICATION**

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provision of the code(s) applicable to such permit.

\_\_\_\_\_  
 SIGNATURE OF APPLICANT ADDRESS DATE PHONE

\_\_\_\_\_  
 RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE DATE PHONE

# DISPLAY THIS CARD ON PRINCIPAL FRONTAGE OF WORK CITY OF PORTLAND

## BUILDING INSPECTION PERMIT

Permit Number: 031095

**PERMIT ISSUED**

Please Read Application And Notes, if Any, Attached

This is to certify that Unum Corp/The Macmillin Company, Inc.  
has permission to Boiler & Chiller plant upgrade, underground electrical upgrades, and related work. **SEP 30 2003**  
AT 2211 Congress St 215 B002001

provided that the person or persons, firm or corporation accepting this permit shall comply with all of the provisions of the Statutes of the State and of the Ordinances of the City of Portland regulating the construction, maintenance and use of buildings and structures, and of the application on file in this department.

CITY OF PORTLAND

Apply to Public Works for street line and grade if nature of work requires such information.

Notification inspection must be given and written permission procured before this building or part thereof is occupied or services used-in. HOUR NOTIFICATION REQUIRED.

A certificate of occupancy must be procured by owner before this building or part thereof is occupied.

**OTHER REQUIRED APPROVALS**

Fire Dept. [Signature]  
Health Dept. \_\_\_\_\_  
Appeal Board \_\_\_\_\_  
Other \_\_\_\_\_  
Department Name \_\_\_\_\_

[Signature] 9/30/03  
Director - Building & Inspection Services

**PENALTY FOR REMOVING THIS CARD**



**STATEMENT OF SPECIAL INSPECTIONS**

PROJECT: 2003 Centralized Mechanical Plant

LOCATION: Building HO3 – Unum-Provident Campus, Portland, ME

PERMIT APPLICANT:

APPLICANT'S ADDRESS:

STRUCTURAL ENGINEER OF RECORD: William P. Faucher, P.E. allied engineering, inc  
Name Firm


ARCHITECT OF RECORD: Guy Labreque, RA CWS Architects  
Name Firm


This Statement of Special Inspections is submitted in accordance with Section 1705.1.1 of the 1999 BOCA National Building Code. It includes a listing of special inspections applicable to this project as well as the name of the Special Inspector, and the names of other agencies intended to be retained for conducting these inspections.

The Special Inspector shall keep records of all inspections listed herein, and shall furnish inspection reports to the Code Official and to the Registered Design Professional of Record. All discrepancies shall be brought to the immediate attention of the Contractor for correction. If the discrepancies are not corrected, the discrepancies shall be brought to the attention of the Code Official and to the Registered Design Professional of Record. Interim reports shall be submitted to the Code Official and to the Registered Design Professional of Record monthly, unless more frequent submissions are requested by the Code Official.


Job site safety is solely the responsibility of the Contractor. Materials and activities to be inspected are not to include the Contractor's equipment and methods used to erect or install the materials listed.

Prepared By:

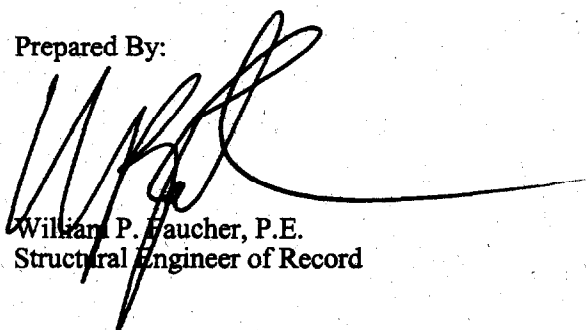  
William P. Faucher, P.E.  
Structural Engineer of Record

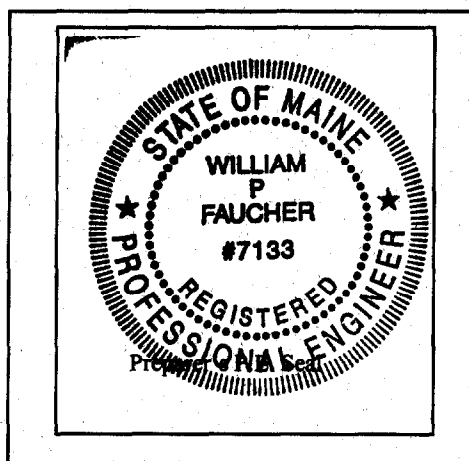

Applicant's Authorization:

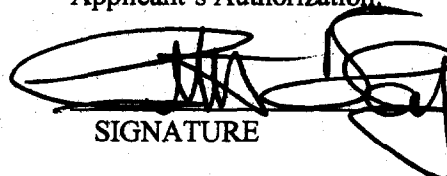 9/30/03  
SIGNATURE DATE



**LIST OF AGENTS**

**PROJECT:** 2003 Centralized Mechanical Plant  
Building HO3 – Unum-Provident Campus, Portland, ME

**STRUCTURAL ENGINEER OF RECORD:** William P. Faucher, P.E. allied engineering, inc  
One Westbrook Common  
Westbrook, Maine 04092  
(Tel) 207-854-8126 X107; (Fax) 207-854-0603  
<mailto:wfaucher@allied-eng.com>

**ARCHITECT OF RECORD:** Guy Labreque, R.A., CWS Architects  
434 Cumberland Ave.  
Portland, ME 04101  
(Tel) 207-774-4441; (Fax) 207-774-4016  
<mailto:glabreque@cwsarch.com>

Following is the List of Agents selected for performance of Special Inspections for this project:

	Name	Firm
1. Special Inspector	William P. Faucher, P.E.	allied engineering, inc.
2. Testing Laboratory (Soils & Concrete)	Roger E. Domingo, P.E.	S. W. Cole Engineering, Inc.
3. Testing Laboratory (Steel Connections)	Unknown	Elite Inspection Services
4.		
5.		
6.		
7.		
8.		
9.		
10.		

**SCHEDULE OF SPECIAL INSPECTION SERVICES**

Project: \_\_\_\_\_ Page    of   

MATERIAL/ACTIVITY	ITEM	SERVICE	APPLICABLE TO THIS PROJECT					
			Y/N	EXTENT (All, Sample, Other, None)	COMMENTS	AGENT No.	DATE COMPLETED	REV. No.
<b>1705 STEEL CONSTRUCTION</b>	<b>1.00</b>							
1705.2 Steel Fabrication		In-plant review						
		Part A-Fabrication procedures	Yes	Review for AISC Certifications		1		
		Review material certificates of compliance (Bolts, nuts, washers, structural steel, & weld filler mat.)	Yes	Shop Drawing Submittal Review		1		
		Review connections	Yes	Shop Drawing Submittal Review		1		
		Review welder certification	Yes	Shop Drawing Submittal Review		1		
1705.3 Steel Erection		Review material certificates of compliance (bolts, nuts, washers, & weld filler material)	Yes	Shop Drawing Submittal Review		1		
		Review primary steel connections						
		Moment connections	Yes	Elite Inspection Services		3		
		Shear connections	Yes	Elite Inspection Services		3		
		Bracing connections	Yes	Elite Inspection Services		3		
		Review welded column splices	Yes	Elite Inspection Services		3		
		Review secondary steel connect.						
		Girts	N/A					
		Steel Deck	N/A					
		Lintels	N/A					
		Review installation of shear studs	N/A					
		Review details/Steel Frame	N/A					

All Steel Construction Special Inspections have been completed in accordance with BOCA 1999, Section 1705.2 and 1705.3

Inspector \_\_\_\_\_ Date \_\_\_\_\_

**SCHEDULE OF SPECIAL INSPECTION SERVICES**

Project: \_\_\_\_\_

Page    of   

MATERIAL/ACTIVITY	ITEM	SERVICE						
			Y/N	EXTENT (All, Sample, Other, None)	COMMENTS	AGENT No.	DATE COMPLETED	REV. No.
<b>1705.4 CONCRETE CONSTRUCTION</b>	<b>2.00</b>							
Concrete Materials		Review materials (ACI Chapt. 3)	Yes	Shop Drawing Submittal Review		1		
		Review mix design (ACI Chapt. 4)	Yes	Shop Drawing Submittal Review		1		
		Review reinforcing certification & weldability (ASTM A706) if required	Yes	Shop Drawing Submittal Review		1		
Placing Reinforcement		Review condition & placement of reinforcing and prestressing steel (ACI 318 7.4-7.7)	Yes	S.W. Cole Engineering, Inc.		2		
Formwork		Review formwork (ACI 3188.1)	Yes	S.W. Cole Engineering, Inc.		2		
		Review form removal & reshoring (ACI 3188.2)	Yes	S.W. Cole Engineering, Inc.		2		
Concrete Operations		Review concrete strength tests (ACI 3185.8)	Yes	AEI & S.W. Cole Engineering, Inc.		1, 2		
		Review mix proportions and technique (ACI 3185.2, 5.3, 5.4, 5.8)	Yes	AEI & S.W. Cole Engineering, Inc.		1, 2		
		Review concrete placement (ACI 3185.9 & 5.10)	Yes	S.W. Cole Engineering, Inc.		2		
		Review curing technique & temperature (ACI 3185.11, 5.12 & 5.13)	Yes	S.W. Cole Engineering, Inc.		2		

All Steel Construction Special Inspections have been completed in accordance with BOCA 1999 Section 1705.4

Inspector \_\_\_\_\_ Date \_\_\_\_\_



2000 0090

# All Purpose Building Permit Application


If you or the property owner owes real estate or personal property taxes or user charges on any property within the City, payment arrangements must be made before permits of any kind are accepted.

Location/Address of Construction: <b>UNEMPLOYMENT CORPORATION, 221 CONGRESS ST. PORTLAND, ME</b>		
Total Square Footage of Proposed Structure <b>N/A</b>	Square Footage of Lot <b>04102</b>	
Tax Assessor's Chart, Block & Lot Chart# <b>215</b> Block# <b>B</b> Lot# <b>002</b>	Owner: <b>UNEMPLOYMENT CORPORATION</b> <b>NICK NATAFINIA</b>	Telephone: <b>(207) 575-1837</b>
Lessee/Buyer's Name (If Applicable) <b>CONSTRUCTION MANAGER</b> <b>MACMILLIN COMPANY</b> <b>40 SOUTH RIVER, UNIT #35</b> <b>BEDFORD, NH 03110</b>	Applicant name, address & telephone: <b>PETER TREMBLAY (MACMILLIN)</b> <b>(603) 656-9900 x121</b>	Cost Of Work: <b>\$ 2,235,190</b> Fee: <b>\$ 20,145</b>
Current use: <u>Commercial</u>		
If the location is currently vacant, what was prior use: _____		
Approximately how long has it been vacant: _____		
Proposed use: _____		
Project description: <u>Boilers &amp; chiller plant upgrade, underground piping, electrical upgrades, related work</u>		
Contractor's name, address & telephone: <u>THE MACMILLIN COMPANY - (603) 656-9900 x121</u>		
Who should we contact when the permit is ready: <u>PETER TREMBLAY</u>		
Mailing address: <u>MACMILLIN COMPANY</u> <u>40 SOUTH RIVER ROAD, UNIT #35 BEDFORD, NH 03110</u>		
We will contact you by phone when the permit is ready. You must come in and pick up the permit and review the requirements before starting any work, with a Plan Reviewer. A stop work order will be issued and a \$100.00 fee if any work starts before the permit is picked up. PHONE: _____		

IF THE REQUIRED INFORMATION IS NOT INCLUDED IN THE SUBMISSIONS THE PERMIT WILL BE AUTOMATICALLY DENIED AT THE DISCRETION OF THE BUILDING/PLANNING DEPARTMENT, WE MAY REQUIRE ADDITIONAL INFORMATION IN ORDER TO APPROVE THIS PERMIT.

I hereby certify that I am the Owner of record of the named property, or that the owner of record authorizes the proposed work and that I have been authorized by the owner to make this application as his/her authorized agent. I agree to accept the jurisdiction of the City of Portland, Maine, and its jurisdiction. In addition, if a permit for work described in this application is issued, I certify that the Code Enforcement Representative shall have the authority to enter all areas covered by this permit at any reasonable hour to enforce the provisions of the codes applicable to this permit.

Signature of applicant: 	Date: <b>SEP 8 2003</b> <b>10:103</b>
---	--

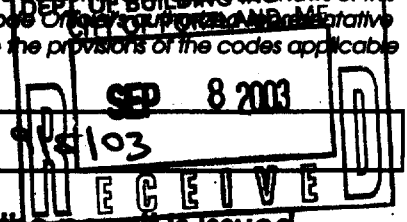

This is NOT a permit, you may not commence ANY work until the permit is issued. If you are in a Historic District you may be subject to additional permitting and fees with the Planning Department on the 4<sup>th</sup> floor of City Hall





allied engineering, inc.

Structural

Mechanical

Electrical

Technology

RECEIVED LETTER OF TRANSMITTAL

AUG 6 2003

To: Peter Tremblay
MacMillin Co.

MacMILLIN COMPANY
BEDFORD, NH

Date: July 30, 2003

Address: Bedford Place
40 South River Rd., Unit #35
Bedford, NH 03110

Sent Via: [ ] Courier [ ] FedEx
[ ] Picked Up [ ] UPS
[ ] Mail

AEI Project #: 03033

[ ] Fax: #
Hard copy to follow? [ ] Yes [ ] No

Project Name: UnumProvident 2003 Centralized Mechanical Plant


[ ] SHOPS [ ] PLANS /SPECS [ ] PRINTS [ ] QUALS PKG [ ] REPORT [ ] OTHER(see below)

[ ] For Review [ ] Please Comment [ ] Please Reply [ ] Please Recycle

Table with 3 columns: COPIES, AEI SUBMTL #, DESCRIPTION. Contains entries for building permit items, Building Code Certificate, and Building Criteria Form.

COPY: (1) File

SIGNED: Ian MacDonald



**CITY OF PORTLAND  
BUILDING CODE CERTIFICATE**  
389 Congress St., Rm 315  
Portland, ME 04101

**TO:** Inspector of Buildings City of Portland, Maine  
Department of Planning & Urban Development  
Division of Housing & Community Service

**FROM:** Ian A. MacDonald, P.E.

**RE:** Certificate of Design

**DATE:** July 24, 2003

These plans and/or specifications covering construction work on:

Unum Provident "2003 Centralized Mechanical Plant"

Have been designed and drawn up by the undersigned, a Maine registered architect/engineer according to the BOCA National Building Code/1999 Fourteenth Edition; and local amendments.



Signature [Handwritten Signature]


Title Principal

Firm Allied Engineering, Inc.

Address One Westbrook Common  
Westbrook, ME 04092

As per Maine State Law:

\$50,000.00 or more in new construction, repair, expansion, addition, or modification for Building or Structures, shall be prepared by a registered design Professional.



# CITY OF PORTLAND MAINE

389 Congress St., Rm 315

Portland, ME 04101

Tel. - 207-874-8704

Fax - 207-874-8716

TO: Inspector of Buildings City of Portland, Maine  
Planning & Urban Development  
Division of Housing & Community Services

FROM DESIGNER: Ian A. McDonald, P.E.

Allied Engineering, Inc. One Westbrook Common  
Westbrook, ME 04092

DATE: 7/24/03

Job Name: Unum Provident "2003 Centralized Mechanical Plant"

Address of Construction: \_\_\_\_\_

## THE BOCA NATIONAL BUILDING CODE/1999 Fourteenth EDITION

Construction project was designed according to the building code criteria listed below:

Building Code and Year Boca 99 <sup>14th Ed.</sup> Use Group Classification(s) B

Type of Construction 2 Bldg. Height 48' +/- Bldg. Sq. Footage NO CHANGE ± 151,000 EXISTING

Seismic Zone 2 Group Class I - Seismic Hazard Exposure Group

Roof Snow Load Per Sq. Ft. 42 PSF (adjusted) Dead Load Per Sq. Ft. 20 PSF

Basic Wind Speed (mph) 85 mph Effective Velocity Pressure Per Sq. Ft. 18.5 psf

Floor Live Load Per Sq. Ft. \_\_\_\_\_

Structure has full sprinkler system? Yes \_\_\_\_\_ No  Alarm System? Yes  No \_\_\_\_\_  
Sprinkler & Alarm systems must be installed according to BOCA and NFPA Standards with approval from the Portland Fire Department.


Is structure being considered unlimited area building: Yes \_\_\_\_\_ No N/A

If mixed use, what subsection of 313 is being considered \_\_\_\_\_

List Occupant loading for each room or space, designed into this Project.

PSH 6/07/2K

(Designers Stamp & Signature)

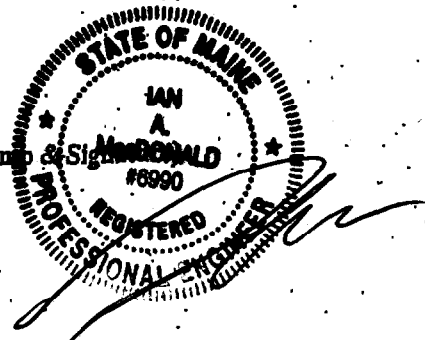



*1763  
- off premises  
- a permit  
- of special report*

**CITY OF PORTLAND  
ACCESSIBILITY CERTIFICATE**

**Designer:** \_\_\_\_\_

**Address of Project** \_\_\_\_\_

**Nature of Project** \_\_\_\_\_

**Date** \_\_\_\_\_

**The technical submissions covering the proposed construction work as described above have been designed in compliance with applicable referenced standards found in the Maine Human Rights Law and Federal Americans with Disability Act.**

**(SEAL)**


**Signature** \_\_\_\_\_

**Title** \_\_\_\_\_

**Firm** \_\_\_\_\_

**Address** \_\_\_\_\_

**Telephone** \_\_\_\_\_



40 South River Road, Unit #35  
 Bedford, NH 03110  
 T: 603656-9900/ F: 603656-9901

# LETTER OF TRANSMITTAL

TO: City of Portland, Maine  
389 Congress Street, Room 315  
Portland, ME 04101

DATE	September 5, 2003	JOB NO.	1402
ATTENTION	Michael Nugent		
RE:	UnumProvident Corporation		
	Centralized Mechanical Plant		

WE ARE SENDING YOU  Attached  Under separate cover via \_\_\_\_\_ the following items:

Shop Drawings     Prints     Plans     Submittals     Specifications  
 Copy of Letter     Change Order     Other \_\_\_\_\_

COPIES	DATE	NO.	DESCRIPTION
1			Building Permit Application (with \$20,145 check)
1			Plans and Specifications
1			Bld Notices & Addenda (1 through 3)

THESE ARE TRANSMITTED as checked below:

- |  |   |   |
|--|---|---|
| <input type="checkbox"/> For Approval                | <input type="checkbox"/> Approved As Submitted    | <input type="checkbox"/> Resubmit _____ copies for approval   |
| <input checked="" type="checkbox"/> For Your Use     | <input type="checkbox"/> Approved As Noted        | <input type="checkbox"/> Submit _____ copies for distribution |
| <input type="checkbox"/> As Requested                | <input type="checkbox"/> Returned For Corrections | <input type="checkbox"/> Return _____ corrected prints        |
| <input type="checkbox"/> For Review and Comment      | <input type="checkbox"/> _____                    |   |
| <input type="checkbox"/> FOR BIDS DUE _____ 20 _____ |   | <input type="checkbox"/> PRINTS RETURNED AFTER LOAN TO US     |

REMARKS: With expecting to start construction on 9/29/03, please advise if any additional information is required.

---



---



---



---



---

CC: PMT

SIGNED Peter Tremblay  
 Project Executive

July 18, 2003



Construction Services  
Since 1946

**BID NOTICE No. 3**

**TO:** INTERESTED BIDDERS


**FROM:** Peter Tremblay, Bruce Lyman

**RE:** UnumProvident Centralized Mechanical Plant, Portland, Maine  
MacMillin Project WO1402  
BID NOTICE No. 3

Along with information provided under previous notices, this notice is to be considered formal bid documentation and must be acknowledged on the bid form.

1. **The Bid Date remains Thursday, July 24, 2003, at 2:00 PM.** All bid documentation shall be faxed to MacMillin's Keene, NH office – Fax # (603) 352-3170. Please mail all originals.
2. Enclosed find a copy of Addendum No. 3 dated 7/17/03 that was provided to modify the set of bid / contract documents. Specifically, the following documents are provided herewith: Addendum No. 3 (1 page); and electrical sketches SKE 3, 4 & 5 (3 pages), all dated 7/17/03. Note: These sketches also affect the site work contractor's work scope.
3. Electrical utility structures shall be furnished by the electrical contractor and installed by the site work contractor. The electrical contractor shall furnish and install all underground conduit (the site work contractor shall carry concrete encasement work).
4. It is expected that MacMillin's office trailer will be located just east of the HO-2 staging area (reference Staging Area sketch, SK-1, dated 7/15/03). Electrical and telephone services will need to be extended from HO-2 accordingly.

Enclosures: (4 pages)  
END OF BID NOTICE No. 3

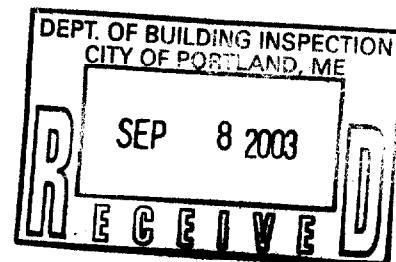



**FROM:** **allied engineering, inc.**  
One Westbrook Common  
Westbrook, Maine 04092  
Telephone: (207) 854-8126

**TO:** Prospective Bidders, Suppliers, and Other Parties

**RE:** **Addendum No. Three (3) to the Bidding Documents for:**  
**UnumProvident 2003 Centralized Mechanical Plant**

**DATE:** July 17, 2003

This Addendum forms a part of the Contract Documents and modifies the original Bidding Documents, "Issued for Construction", dated June 27, 2003. Acknowledge receipt of this Addendum in the space provided on the Bid Form. Failure to do so may subject Bidder to disqualification.

This Addendum consists of:

- ONE (1) page
- THREE (3) Sketches (SKE-3, SKE-4, SKE-5)

**Changes to the Drawings:**

**Drawing ES-100:**

Refer to attached sketch SKE-3 for revisions. The work indicated on the sketch is included in the Base Bid and shall be deleted under Alternate #1.

**Drawing ED-100:**

Refer to attached sketch SKE-4 for revisions. The work indicated on the sketch is included in the Base Bid and shall be deleted under Alternate #1.


**Drawing E-100:**

Refer to attached sketch SKE-5 for revisions. The work indicated on the sketch is included in the Base Bid and shall be deleted under Alternate #1.

--- END OF ADDENDUM # 3 ---

**UNUM PROVIDENT  
2003 CENTRALIZED MECHANICAL PLANT**

Page 1 of 1

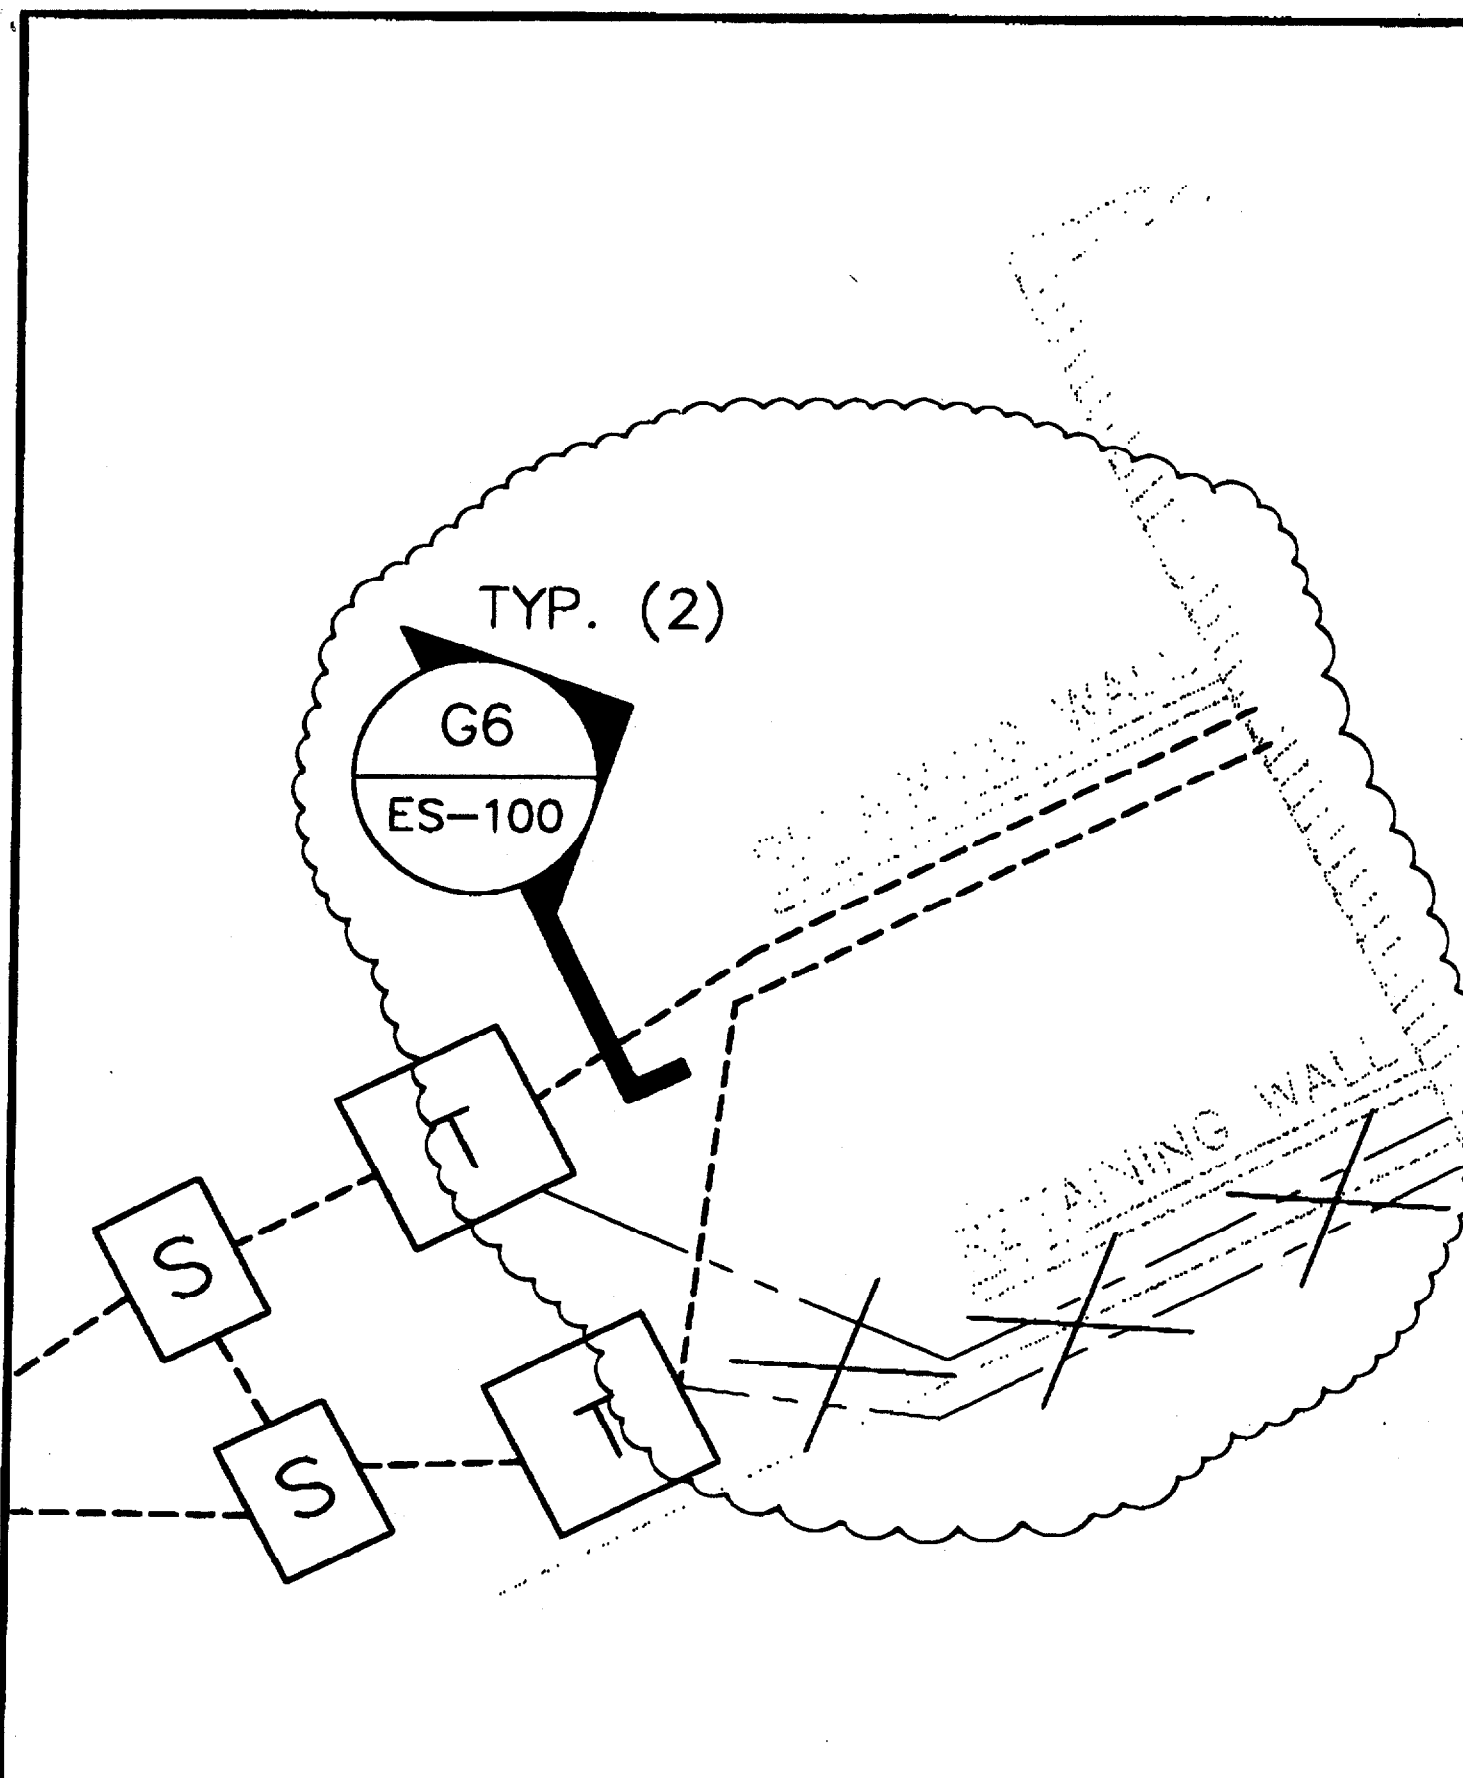

SKE-3

UPDATE TO SHEET ES-100  
ADDENDUM #3

UNUM PROVIDENT  
2003 CENTRALIZED MECHANICAL PLANT

Scale: 1" = 10'-0"


Project No: 03033

Date: JULY 17, 2003


CAD File: 03033ES.DWG


**allied**  
engineering, inc.

One Westbrook Common, Westbrook, Maine 04092-2204  
Telephone No: 207-854-8126 • Fax No: 207-854-0803  
E-Mail: info@allied-eng.com • www.allied-eng.com






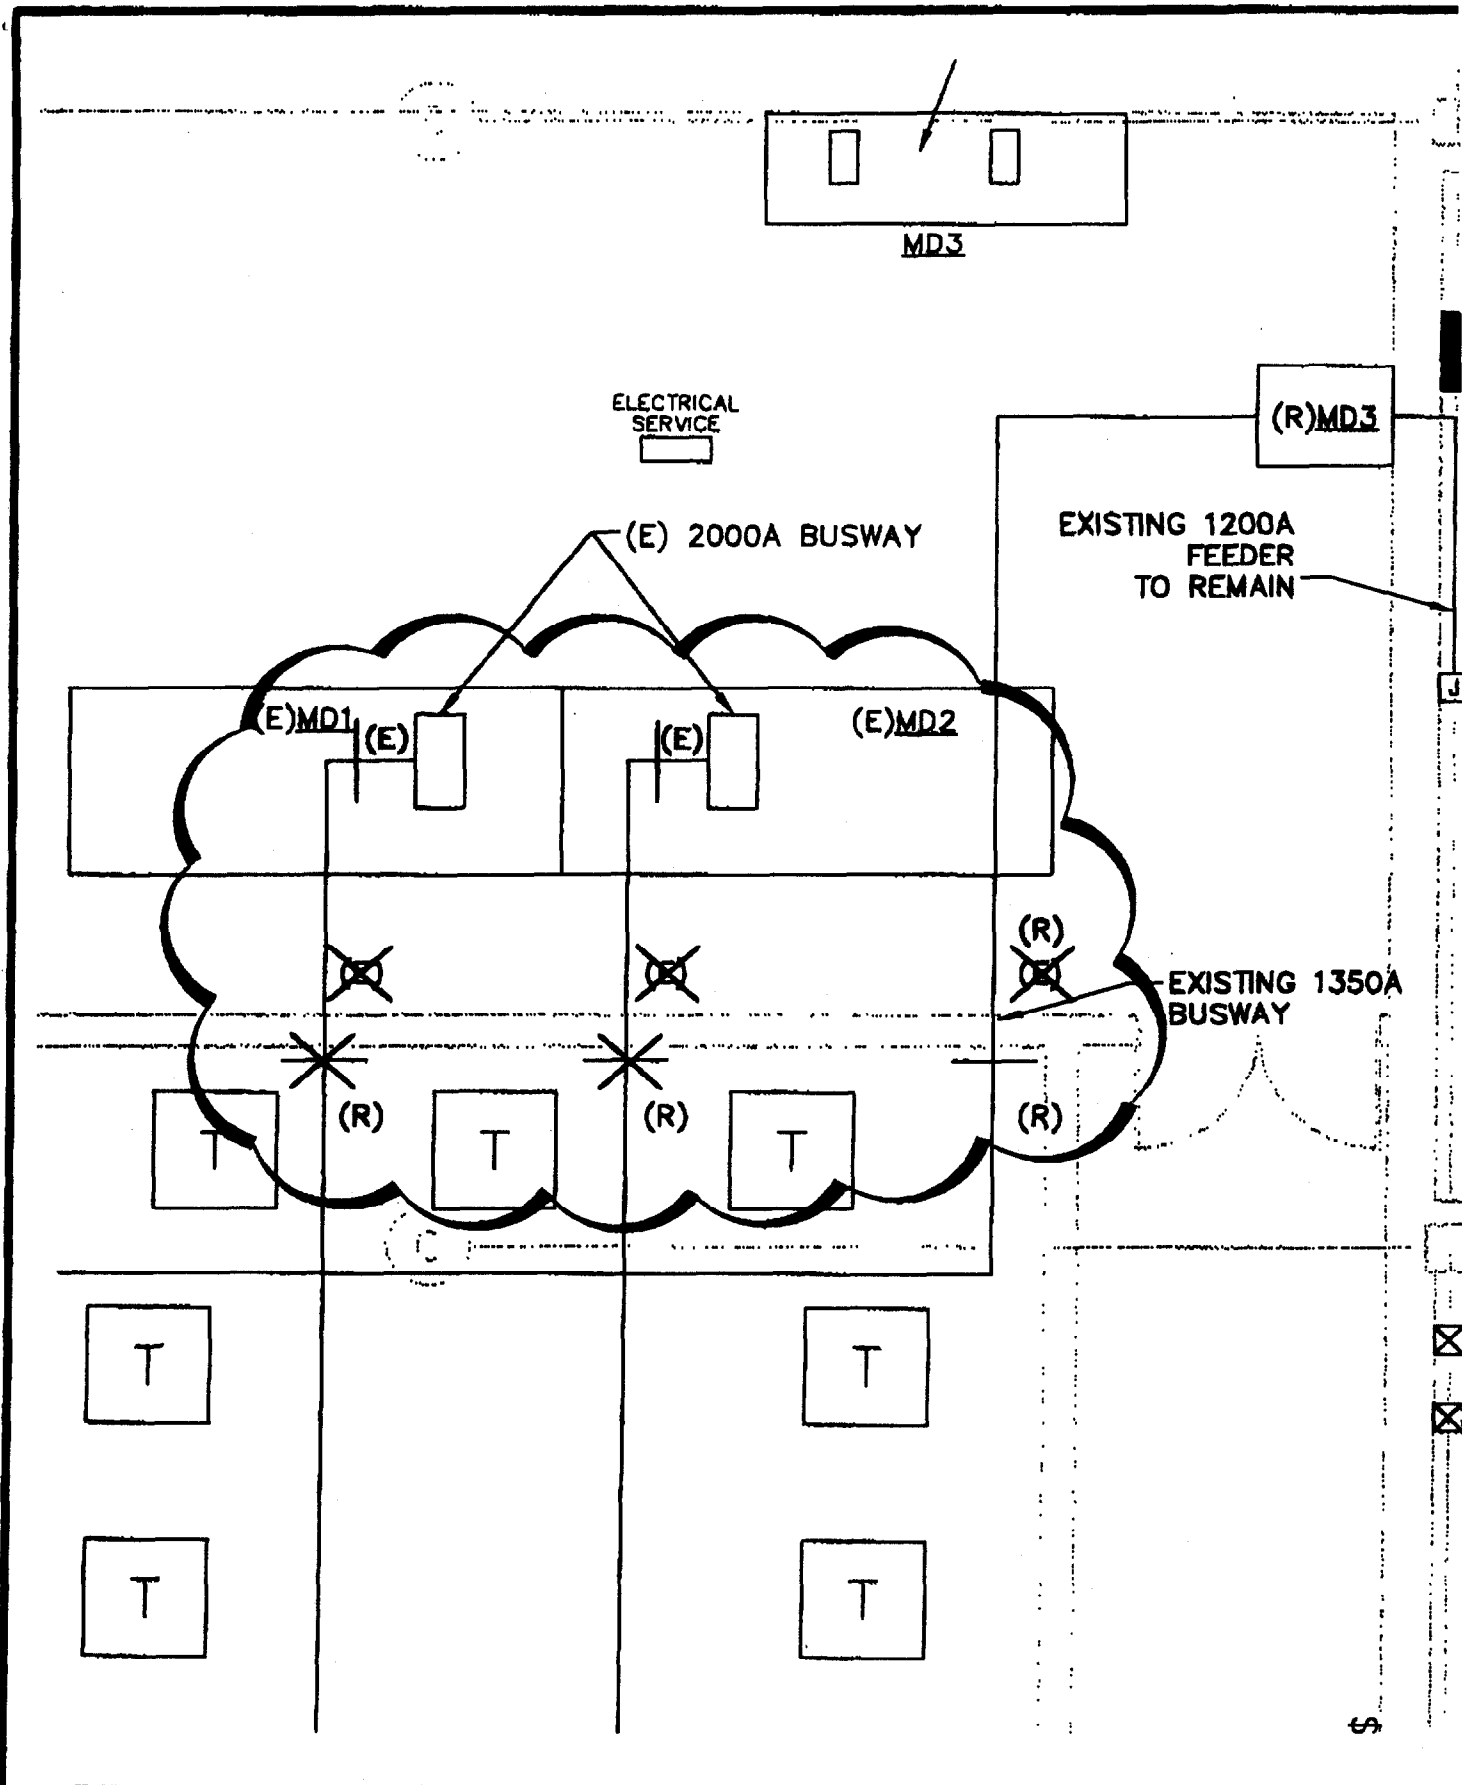

<b>SK E-4</b>	UPDATE TO SHEET ED-100 ADDENDUM #3		 One Westbrook Common, Westbrook, Maine 04093-2804 Telephone No: 207-854-8126 • Fax No: 207-854-0903 E-Mail: info@allied-eng.com • www.allied-eng.com
	UNUM PROVIDENT 2003 CENTRALIZED MECHANICAL PLANT		
	Scale: 1/4" = 1'-0"	Project No: 03033	
	Date: JULY 17, 2003	CAD File: 03033E.DWG	

PROVIDE BUSWAY AND FEEDER CONNECTION BOXES ~ CONNECT TO EXISTING BUSWAY AND NEW SERVICE ENTRANCE CONDUCTORS.

PROVIDE BUSWAY FEEDER CONNECTION BOXES AND 1350A BUSWAY TO MATCH EXISTING ~ CONNECT TO MD3 AND NEW SERVICE ENTRANCE CONDUCTORS.

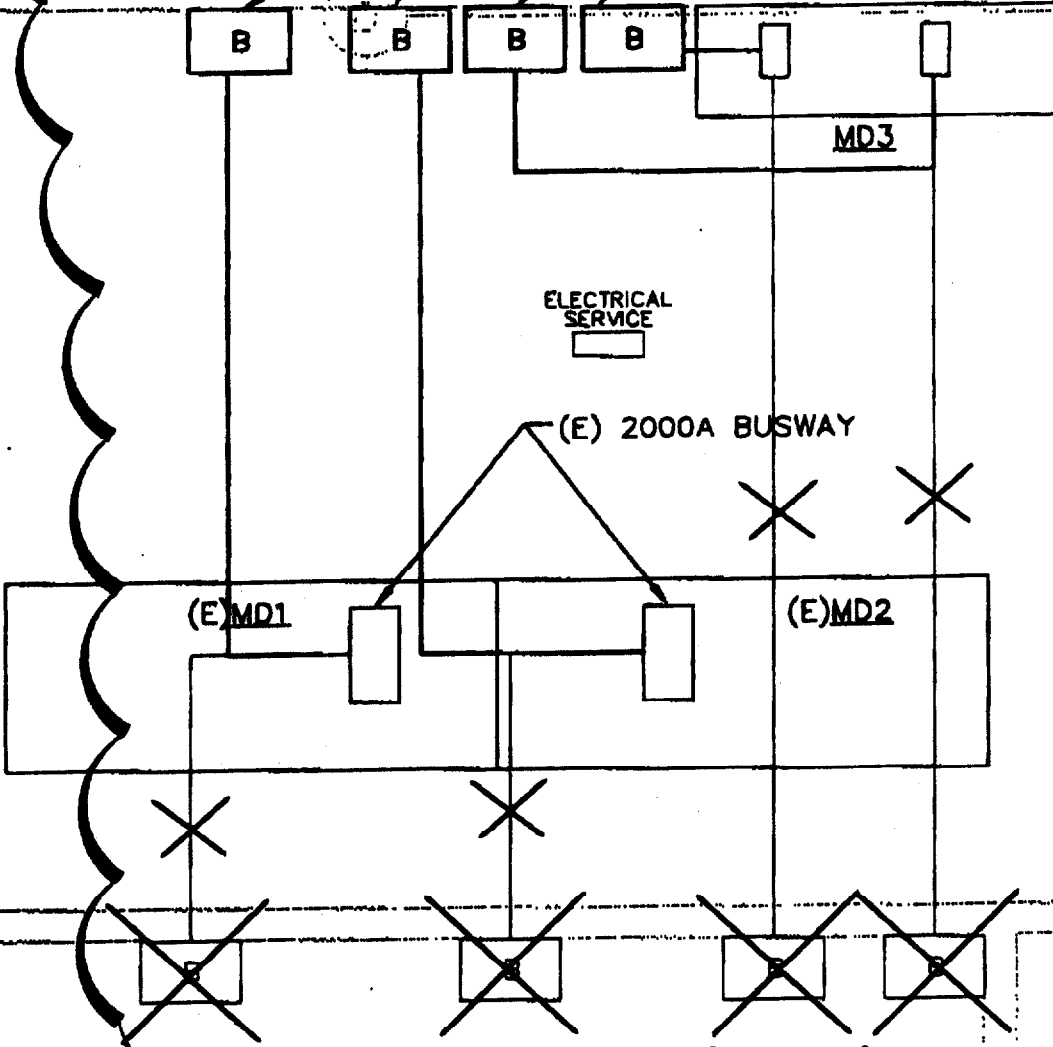

SKE-5

UPDATE TO SHEET E-100  
ADDENDUM #3

UNUM PROVIDENT  
2003 CENTRALIZED MECHANICAL PLANT

Scale: 1/4" = 1'-0"

Project No: 03033

Date: JULY 17, 2003

CAD File: 03033E.DWG

**allied**  
engineering, inc.

One Westbrook Common, Westbrook, Maine 04092-2804  
Telephone No: 207-854-8128 • Fax No: 207-854-0603  
E-Mail: info@allied-eng.com • www.allied-eng.com

