




NOTES:
 1. REPLACE SUPPLY DUCT INSULATION WITHIN WORK BOUNDARY.

LEGEND:

- ONE HOUR FIRE/SMOKE RATED PARTITION
- - - ONE HOUR FIRE RATED PARTITION
- TWO HOUR FIRE RATED PARTITION
- - - BOUNDARY OF ASBESTOS ABATEMENT

KEYED NOTES:

- 1 (E) DIFFUSER AND FLEX DUCT WILL BE REMOVED BACK TO MAIN DUCT BY ASBESTOS CONTRACTOR. DIFFUSERS WILL BE SET ASIDE FOR RE-INSTALLATION. CLEAN FOR FUTURE USE.
- 2 (E) DIFFUSER AND TRANSFER DUCT WILL BE REMOVED BACK TO MAIN DUCT BY ASBESTOS CONTRACTOR. DIFFUSERS WILL BE SET ASIDE FOR RE-INSTALLATION. CLEAN FOR FUTURE USE.
- 3 (E) DIFFUSER WILL BE REMOVED BY ASBESTOS CONTRACTOR AND SET ASIDE FOR RE-INSTALLATION. CLEAN FOR FUTURE USE.
- 4 REMOVE AND RELOCATE (E) TEMPERATURE SENSOR.
- 5 REMOVE (E) TEMPERATURE SENSOR.
- 6 (E) DIFFUSER WILL BE REMOVED AND SET ASIDE BY ASBESTOS CONTRACTOR FOR RE-INSTALLATION. CLEAN FOR FUTURE USE.

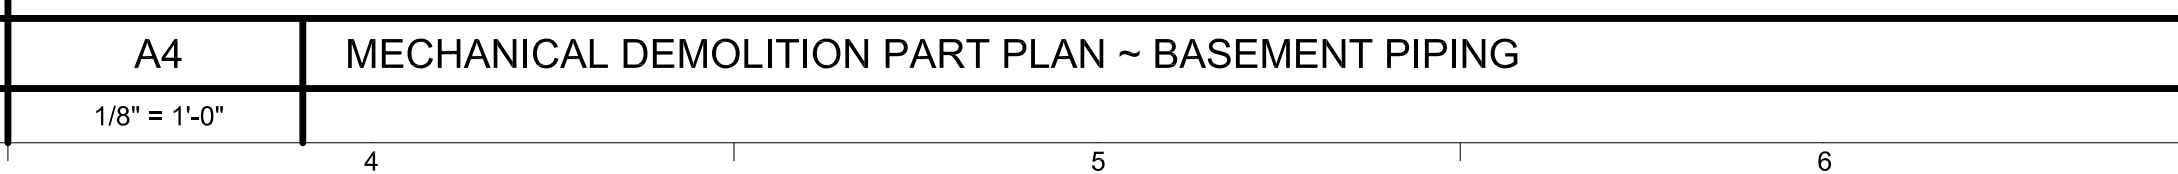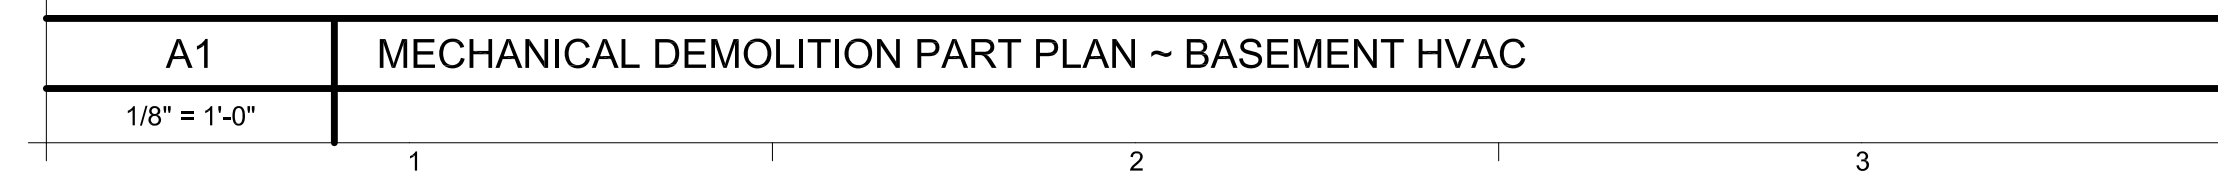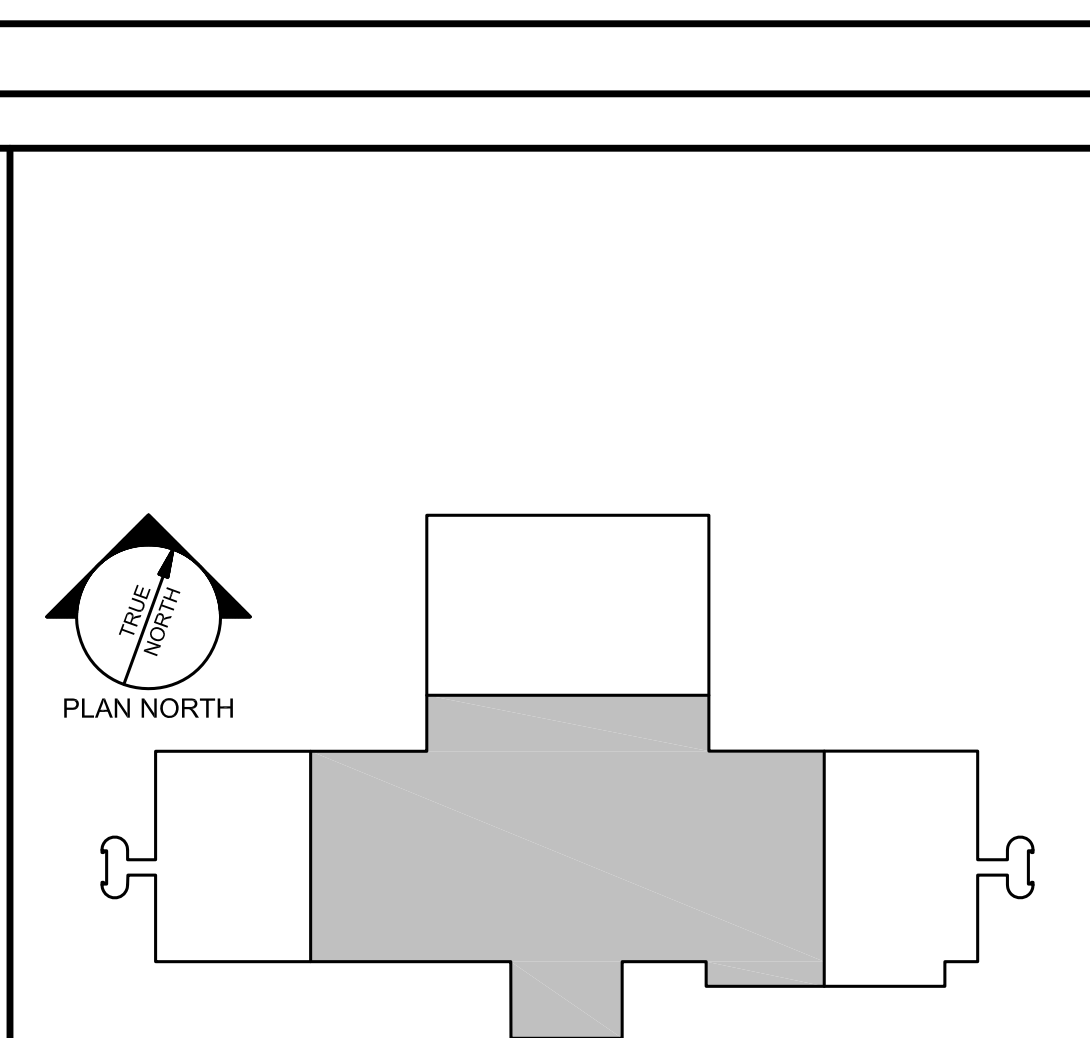

A7 NOTES & LEGEND
 NOT TO SCALE

A8 DEMO KEYED NOTES
 1/8" = 1'-0"

