

GENERAL NOTES

1. THE FOLLOWING NOTES ARE INTENDED TO BE USED AS OUTLINE SPECIFICATIONS FOR THIS PROJECT. THE REFERENCED STANDARDS ARE PART OF THIS WORK.
2. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATIONS AND ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR LOCATIONS AND DIMENSIONS OF OPENINGS, CHASES, INSERTS, REGLETS, SLEEVES, DEPRESSIONS, AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
3. ALL DIMENSIONS, EXISTING CONDITIONS, AND AS-BUILT CONDITIONS MUST BE VERIFIED IN THE FIELD. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER BEFORE PROCEEDING WITH THE AFFECTED PART OF THE WORK.
4. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE ONLY AFTER THE STRUCTURAL WORK CONTAINED IN THE 5- DRAWINGS IS COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCE TO ENSURE THE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE ADDITION OF NECESSARY SHORING, TEMPORARY BRACING, GUYS OR TIEDOWNS. SUCH MATERIAL SHALL REMAIN THE PROPERTY OF THE CONTRACTOR AFTER COMPLETION OF THE PROJECT.
5. SECTIONS AND DETAILS SHOWN ON ANY STRUCTURAL DRAWINGS SHALL BE CONSIDERED TYPICAL FOR SIMILAR CONDITIONS AS DETERMINED BY THE STRUCTURAL ENGINEER. THE STRUCTURAL ENGINEER RESERVES THE RIGHT TO INTERPRET DETAILS TO ADDRESS OTHER PROJECT CONDITIONS.
6. THE CONTRACTOR SHALL SUBMIT COMPLETE SHOP DRAWINGS FOR ALL PARTS OF THE WORK, INCLUDING DESCRIPTION OF SHORING, AND CONSTRUCTION METHODS AND SEQUENCING WHERE APPLICABLE. NO PERFORMANCE OF THE WORK INCLUDING, BUT NOT LIMITED TO, DEMOLITION OF EXISTING STRUCTURE, OR FABRICATION OR ERECTION OF NEW STRUCTURAL ELEMENTS, SHALL COMMENCE WITHOUT REVIEW OF THE SHOP DRAWINGS BY THE ARCHITECT AND ENGINEER. SUBMIT ONE COPY AND ONE SEPIA. COPY WILL BE REVIEWED AND SEPIA WILL BE RETURNED. FOR SHOP DRAWINGS AND SUBMITTALS REQUIRED, REFERENCE THE PROJECT SPECIFICATION.
7. ALL APPLICABLE FEDERAL, STATE, AND MUNICIPAL REGULATIONS SHALL BE FOLLOWED, INCLUDING THE FEDERAL DEPARTMENT OF LABOR OCCUPATIONAL SAFETY AND HEALTH ACT.
8. IN ACCORDANCE WITH THE MAINE UNIFORM BUILDING AND ENERGY CODE/INTERNATIONAL BUILDING CODE (2009 EDITION, SECTION 1704.1), A STATEMENT OF SPECIAL INSPECTIONS IS REQUIRED AS A CONDITION FOR PERMIT ISSUANCE BY THE LOCAL CODE OFFICIAL. THIS STATEMENT SHALL INCLUDE A COMPLETE LIST OF MATERIALS AND WORK REQUIRING SPECIAL INSPECTIONS, THE INSPECTIONS TO BE PERFORMED AND A LIST OF THE INDIVIDUALS, APPROVED AGENCIES AND FIRMS INTENDED TO BE RETAINED FOR CONDUCTING SUCH INSPECTIONS.
9. REFERENCE THE PROJECT SPECIFICATIONS FOR ALL TESTING REQUIREMENTS.

DESIGN LOADS

1. BUILDING CODE: MAINE UNIFORM BUILDING AND ENERGY CODE INTERNATIONAL BUILDING CODE, 2009 EDITION INTERNATIONAL EXISTING BUILDING CODE, 2009 EDITION ASCE 7-05 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES
2. DESIGN FLOOR LIVE LOADS: OFFICES: 50 PSF + 15 PSF PARTITION ALLOWANCE CORRIDORS ABOVE THE FIRST FLOOR: 80 PSF LOBBIES, STAIRS AND FIRST FLOOR CORRIDORS: 100 PSF

CONCRETE NOTES

1. CONCRETE WORK SHALL CONFORM TO "ACI MANUAL OF CONCRETE PRACTICE", LATEST EDITION. THIS PUBLICATION IS AVAILABLE THROUGH THE AMERICAN CONCRETE INSTITUTE (248) 848-3800.
2. CONCRETE FOUNDATIONS SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 3,000 PSI. CONCRETE SLABS SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 3,000 PSI. U.N.O. EXTERIOR SLAB-ON-GRADE SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 5,000 PSI. ADDITIONAL CONCRETE MIX PERFORMANCE DATA INCLUDING AIR CONTENT, WATER-CEMENT RATIO, AGGREGATE SIZE, SLUMP, ETC. HAS BEEN INCLUDED IN THE PROJECT SPECIFICATIONS. SEE THE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
3. CONCRETE MIX DESIGN: ELEVATED SLABS: A. STRENGTH: 3,000 PSI @ 28 DAYS B. AGGREGATE: 3/4" C. W/C RATIO: 0.55 MAX D. ENTRAPPED AIR ONLY: (NO ENTRAPMENT) E. SLUMP: 4" MAX
4. REINFORCING BARS SHALL CONFORM TO ASTM A615 GRADE 60 DEFORMED BARS AND SHALL BE DETAILED, FABRICATED AND PLACED IN ACCORDANCE WITH ACI 315, LATEST EDITION.
5. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A-185 AND BE PROVIDED IN FLAT SHEETS.
6. MINIMUM CONCRETE PROTECTIVE COVERING FOR REINFORCEMENT, UNLESS NOTED OTHERWISE, SHALL BE AS FOLLOWS: SURFACES NOT IN CONTACT WITH EARTH OR EXPOSED TO WEATHER SLABS, JOISTS #11 BARS AND SMALLER, 1.0"
9. WELDING OF REINFORCEMENT IS NOT PERMITTED
10. SLAB THICKNESSES INDICATED ON THE DRAWINGS ARE MINIMUMS. PROVIDE SUFFICIENT CONCRETE TO ACCOUNT FOR STRUCTURE DEFLECTION AND TO OBTAIN THE SPECIFIED SLAB ELEVATION INDICATED.
11. INSTALLATION OF REINFORCEMENT SHALL BE COMPLETED AT LEAST 24 HOURS PRIOR TO THE SCHEDULED CONCRETE PLACEMENT. NOTIFY ARCHITECT AND STRUCTURAL ENGINEER OF COMPLETION AT LEAST 24 HOURS PRIOR TO THE SCHEDULED COMPLETION OF THE INSTALLATION OF REINFORCEMENT.
12. ALL ITEMS TO BE EMBEDDED INTO CONCRETE SHALL BE INSTALLED PRIOR TO PLACEMENT OF CONCRETE. PROVIDE ADDITIONAL REINFORCEMENT AND/OR TEMPLATES AS REQUIRED TO ENSURE THE CORRECT POSITIONS OF EMBEDMENTS. "WET SETTING" OF EMBEDMENTS INTO CONCRETE IS STRICTLY PROHIBITED. EMBEDMENTS INCLUDE, BUT NOT BY LIMITATION, REINFORCEMENT, REINFORCING DOWELS, EMBEDDED PLATES, ANCHOR RODS, ANCHOR INSERTS AND SLEEVES.

STRUCTURAL STEEL NOTES

1. STRUCTURAL STEEL FABRICATION, ERECTION, AND CONNECTION DESIGN SHALL CONFORM TO AISC "SPECIFICATION FOR THE DESIGN FABRICATIONS, AND ERECTION OF STRUCTURAL STEEL" LATEST EDITION, AND THE "CODE OF STANDARD PRACTICE", LATEST EDITION.
2. STRUCTURAL STEEL: STEEL PLATES, SHAPES, AND BARS, CONFORM TO ASTM A36 UNLESS NOTED OTHERWISE (U.N.O.). STRUCTURAL STEEL SHAPES DESIGNATED ON THE DRAWINGS FOR WIDE-FLANGE SECTIONS: ASTM A992 (ASTM A572 GRADE 50 WITH SPECIAL REQUIREMENTS PER AISC TECHNICAL BULLETIN #3 DATED MARCH, 1997)
3. STRUCTURAL TUBING: CONFORM TO ASTM A500 GRADE B46 KSI.
4. FIELD CONNECTIONS SHALL BE BOLTED USING ASTM A325H HIGH STRENGTH BOLTS (U.N.O.) EXCEPT WHERE SLIP CRITICAL CONNECTIONS ARE REQUIRED AND NOTED BY A325 (SC) ON THE DRAWINGS. PROVIDE SLIP CRITICAL (SC) CONNECTIONS AT ALL MOMENT CONNECTIONS, BRACED FRAMES, RELIEVING ANGLES AND AS OTHERWISE NOTED. USE A490 BOLTS WHERE INDICATED.
5. WHERE WELDING IS INDICATED, ALL WELDING SHALL CONFORM TO AWS D1.1-LATEST EDITION. ELECTRODES SHALL CONFORM TO AWS A5.1 E70XX SERIES WITH PROPER ROD TO PRODUCE OPTIMUM WELD (LOW HYDROGEN).

METAL DECK

1. THE METAL FLOOR DECK SHALL BE FORMED OF STEEL SHEETS CONFORMING TO THE FOLLOWING STANDARDS: A. FLOOR DECKING: ASTM A1008, GRADE C, D OR ASTM A653, STRUCTURAL QUALITY, GRADE 40 OR HIGHER
2. FLOOR DECK SHALL BE AS NOTED ON THE DRAWINGS (OR EQUIVALENT).

MASONRY NOTES


1. ALL MASONRY CONSTRUCTION SHALL CONFORM TO ACI 530.1-LATEST.
2. ALL CONCRETE MASONRY UNITS SHALL BE ASTM C90 GRADE N, TYPE 1 STANDARD WEIGHT BLOCKS INCLUDING STRETCHERS AND CORNER BLOCKS. MINIMUM PRISM STRENGTH OF BLOCK SHALL BE $f_m = 1500$ PSI IN 28 DAYS.
3. MORTAR SHALL CONFORM TO ASTM SPECIFICATION C270, TYPE M OR S
4. GROUT SHALL CONFORM TO ASTM-C476
5. HORIZONTAL JOINT REINFORCING SHALL BE DUR-O-WAL TRUSS DESIGN, STANDARD GLASS MILL GALVANIZED WITH 3/16" DIAMETER SIDE RODS AND 9 GAUGE CROSS TIES. U.N.O. REINFORCING SHALL BE PLACED IN MASONRY WALLS AT EVERY SECOND BLOCK COURSE.
6. CONCRETE MASONRY UNITS SHALL BE LAID IN RUNNING BOND UNLESS OTHERWISE NOTED. PROVIDE FULL MORTAR COVERAGE ON ALL WEBS AND FACE SHELLS. PROVIDE CORNER BLOCKS AND END BLOCKS TO FINISH ALL 90 DEGREE CORNERS AND WALL OPENINGS.
7. CELLS TO BE GROUTED SHALL BE 2-CELL BLOCK. ALIGN CELLS TO MAINTAIN A CLEAR UNOBSTRUCTED, CONTINUOUS VERTICAL CHASE. CELLS MUST BE KEPT CLEAN OF PROTRUSIONS OR FINS OF MORTAR. FILL CELLS OF MASONRY UNITS AND WALL CAVITIES WHERE INDICATED WITH 2500 PSI GROUT. MAXIMUM GROUT LIFT WITHOUT CLEAN-OUTS SHALL BE 4'-0". HIGH LIFT GROUTING SHALL CONFORM TO CODE REQUIREMENTS WITH A MINIMUM CEMENT CONTENT OF 8 SACKS PER CUBIC YARD. SUPPORT ALL VERTICAL BARS IN CENTER OF GROUTED CELLS WITH VERTICAL BAR POSITIONER.
8. FIELD PENETRATIONS THROUGH BLOCK WALLS SHALL NOT BE MADE THROUGH BOND BEAMS, LINTELS OR GROUTED CELLS.

BAR SIZE	LAP LENGTH		
	3,000 PSI	3,500 PSI	5,000 PSI
#3	30"	28"	24"
#4	36"	34"	32"
#5	48"	45"	38"
#6	56"	52"	46"
#7	81"	78"	64"
#8	93"	88"	74"

SHEET NOTES

GENERAL NOTES

KEY PLAN

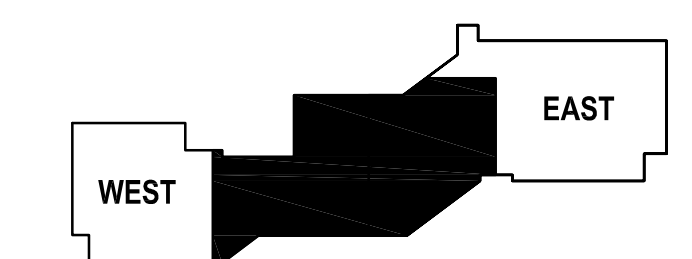


unum
 2211 Congress Street
 Portland, ME 04122

Gensler
 214 North Tryon Street
 Suite 2320
 Charlotte, NC 28202
 United States

Tel 704.377.2725
 Fax 704.377.2807

BECKER
 STRUCTURAL ENGINEERS
 75 York Street, Portland, Maine 04101
 207.879.1838 • beckerstructural.com

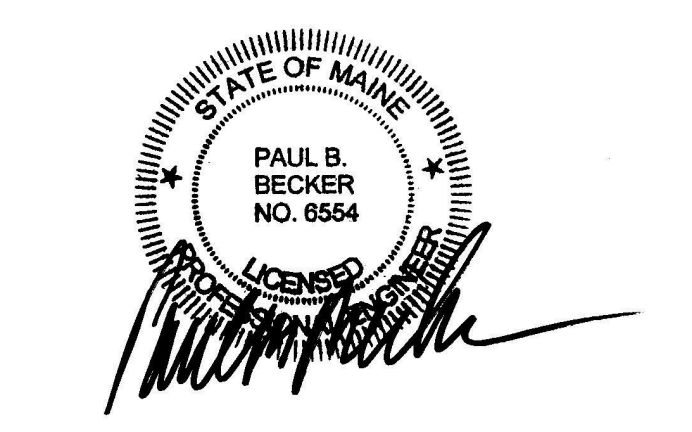

Date	Description
2 08/01/17	ADDENDUM #2
3 08/06/17	ADDENDUM #3

Seal / Signature

Project Name
Unum Workplace Transformation- Phase 1 (HO2)

Project Number
59.6481.003

Description
GENERAL NOTES

Scale
 As indicated

S02.000