


SECTION 22010 PLUMBING GENERAL	
1.0 GENERAL	2. Each starter for a three-phase motor shall be furnished with three (3) overload relays sized for the full motor running current of the motor actually provided. Provide an external "HAND-OFF-AUTO" selector switch with red "RUNNING" light. Provide a green pilot light to indicate motor "STOPPED". Each pilot light shall have a legend plate indicating reason for signal.
1.01 DESCRIPTION	3. Each overload relay shall have a normally open alarm contact which will close only when actuated by an overload (not to be confused with N.O. or N.C. auxiliary contacts). These contacts shall be properly wired to their respective blue pilot light provided on the starter front cover and having a "TRIPPED" legend plate.
A. This Division 22 and the accompanying drawings cover the provision of all labor, equipment, appliances, and materials and performing all operations in connection with the construction of the plumbing systems as specified herein and as shown.	4. Individually mounted motor starters shall be in a NEMA Type 1 general purpose enclosure in unfinished areas and shall be flush mounted in all finished areas. All starters mounted in exterior areas shall have a NEMA 3R enclosure. Each starter shall have a laminated nameplate to indicate equipment unit number, function and circuit number.
B. The General Provisions and Division 1, including the general, supplementary and other conditions and other Divisions, as appropriate, apply to work specified in this Division.	5. All motor starters, push buttons and pilot lights shall be of the same manufacturer as the switchboard and shall be General Electric, Square D, Siemens I.T.E., or Westinghouse.
1.02 EXISTING CONDITIONS	C. Motor starters for the following equipment shall be provided under this Division 15 by the manufacturer of the equipment: <ol style="list-style-type: none"> 1. Packaged booster pump systems 2. Other equipment hereinafter specified in other Sections to be provided with integral starters.
A. Attention is called to the fact that the work is to be performed within an existing, operational facility. Prior to the submission of bids, each bidder shall visit the project site, thoroughly investigate and be familiar with all existing conditions which will affect their work, especially the work to be performed above the existing ceilings.	D. Unless otherwise noted or specified in individual Sections, all 3-phase motors shall be standard NEMA continuous duty "B" type, with Class B insulation, open drip-proof frame for indoor use, TFC for outdoor service and a service factor of 1.15. All motors 5 HP and larger shall be U.S. Motors HI-Efficiency Model or Reliance XE HI-Efficiency Model.
B. Connect new work to existing work in a neat and workmanlike manner. Where an existing structure must be cut or existing utilities interfere, such obstructions shall be bypassed, removed, relocated, patched and repaired. Work disturbed or damaged shall be replaced or repaired to its prior condition.	E. All power wiring and final connections to equipment shall be provided under Division 26.
C. Prior to the start of any demolition or construction, secure the services of a qualified, EPA Certified asbestos abatement agency to check the existing insulation, etc. for asbestos. Should asbestos be found, do not proceed with demolition or construction; notify the Architect in any case in writing of the agency's findings.	F. Control components, all interlocks (motor-operated dampers, fire alarm motors, etc.) and control wiring (120 volt, single phase and less) shall be provided under this Division 22 as required to achieve the specified control sequences.
1.03 INTENT OF DRAWINGS AND SPECIFICATIONS	G. All control wiring over 30 volts shall be installed by a Licensed Electrician working under this Division 22.
A. The implied and stated intent of the drawings and specifications is to establish minimum acceptable standards for materials, equipment and workmanship, and to provide general mechanical systems complete in every respect.	1.08 SLEEVES, SEALS AND ESCUTCHEONS
B. The engineering drawings are diagrammatic, intended to show general arrangement and sizes of system components, and shall not be scaled. Dimensions, the architectural and structural drawings shall govern space constraints, dimensions and finishes. All offsets and fittings which will be necessary to accomplish the finished installation shall be provided at no additional cost or increase in the Contract.	A. Sleeves shall be provided through all pipe penetrations of concrete or masonry walls, elevated floors and roofs, except those plumbing piping penetrations for fixtures, vents, etc.
1.04 SPACE PRIORITY	B. Sleeves shall be fabricated from Schedule 40 steel pipe through 10" and Standard Wall steel pipe for sleeve sizes 12" and larger. All sleeves penetrating exterior walls, underground walls, pit or vault walls shall be provided with a 3" x 3/8" thick walerstop ring welded completely to the midpoint of the sleeve.
A. Ensure optimum use of available space for materials and equipment installed above ceilings. Allocate space in the order of priority as listed below except as otherwise detailed. Items are listed in the order of priority, with items of equal importance listed under a single priority number. <ol style="list-style-type: none"> 1. Gravity flow piping systems 2. Vent piping systems 3. Recessed lighting fixtures 4. Concealed HVAC terminals and equipment 5. Air duct systems 6. Sprinkler piping systems 7. Pressurized piping systems 8. Electrical conduit, wiring, control air tubing 	C. All sleeves penetrating exterior walls, underground walls, pit or vault walls and elevated floors shall be packed and sealed watertight.
B. Order of space priority does not dictate installation sequence. Installation sequence shall be as required to install all affected trades.	D. Sleeves through roofs shall extend above the roof surface and be flashed watertight.
C. The work of this Division 22 shall not obstruct access for installation, operation and maintenance of the work of any other Division.	E. Sleeves through walls shall be cut and finished flush with each surface of the wall in which they are installed.
D. All major items of equipment shall be arranged so as to provide a minimum of 28" clear aisle space. Additional space shall be provided between and around equipment for maintenance and proper operation as shown in the equipment manufacturer's literature.	F. Sleeves shall be sized to provide a minimum of 1/2" clearance between the inside surface of the sleeve and the outside finished surface of the pipe plus any insulation specified.
1.05 COORDINATION	G. Fire-stops shall be provided as specified herein. All annular spaces between piping and sleeves which do not require fire-stops shall be packed with mineral wool and caulked.
A. Coordinate all work under this Division 22 with work under all other Divisions, providing adjustment as necessary.	H. Provide round, chrome-plated escutcheons on all exposed piping penetrations passing through walls, floors, partitions and ceilings.
B. Coordination of space requirements with respect to Division 26 shall be performed such that: <ol style="list-style-type: none"> 1. No equipment, piping or ductwork, other than electrical, shall be installed within 42" of switchboards or panelboards. 2. No piping or ductwork which ever operates at a temperature in excess of 120 degrees F. shall be installed within 3" of any electrical conductor. 	1.09 FIRE-STOPS
C. All items mounted in or below the ceiling, and all items penetrating the ceiling, shall be coordinated with the architectural reflected ceiling plans. If any items are not shown on these plans, or any items need to be relocated for coordination purposes, prepare a reflected ceiling plan and submit it to the Architect for approval.	A. Where ductwork, piping, conduit, etc. pass through fire partitions, fire walls and floors, a fire-stop shall be provided that will ensure an effective barrier against the spread of fire, smoke and gases. Fire-stop material shall be packed tight and completely fill gaps between the ductwork, piping, conduit, etc. and the perimeter of their rough openings.
1.06 CODE COMPLIANCE	B. Fire-stopping material shall maintain its dimensions and integrity while preventing the passage of flame, smoke and gases under conditions of installation and use when exposed to the ASTM E119 time-temperature curve for a time period equivalent to the rating of the assembly penetrated. Fire-stopping material shall be noncombustible as defined by ASTM E136; and, for insulation materials, melt point shall be a minimum of 1700 degrees F. for 1-hour protection and 1850 degrees F. for 2-hour protection. Fire-stopping material shall be Dow-Corning RTV Foam or 3M Fire Barrier Products or Sohio Carborundum Fire Putty.
A. All workmanship and materials provided under this Division 22 shall comply with all laws, ordinances, codes and regulations of all Federal, State and Local Authorities having jurisdiction.	C. See Section 22400 for fire-stopping of PVC piping.
B. All fire suppression, plumbing, heating, ventilating, and air conditioning materials and workmanship shall comply with the following codes and standards as minimum requirements: <ol style="list-style-type: none"> 1. NEC - 2012 edition 2. Life Safety Code (NFPA 101) - 2012 edition. 3. All other NFPA Codes and Standards - 2012 edition. 4. International Building Code - 2009 edition. 5. International Energy Code - 2012 edition. 6. International Fire Prevention Code - 2009 edition. 7. International Mechanical Code - 2009 edition. 8. International Plumbing Code - 2009 edition. 9. American with Disabilities Act. 	1.10 CORE DRILLING
C. Secure and pay all fees associated with all permits and licenses required for execution of the Contract. Arrange for all inspections required by city, county, state and other authorities having jurisdiction, and deliver certificates of approval to the Architect.	A. Cutting of holes through concrete and masonry shall be by diamond core or concrete saw. Pneumatic hammer, impact electric and hand or manual hammer type drills will not be allowed, except as permitted by the Architect where required by limited working space. Locate holes such that they will not affect structural sections such as ribs or beams. Holes shall be laid out well in advance of the installation. These layout locations shall be approved by the Architect prior to drilling.
D. The code requirements are strictly a minimum and shall be met without incurring additions to the Contract. Where requirements of the drawings or specifications exceed the code requirements, the work shall be provided in accordance with these drawings or specifications. In the event of conflict or ambiguity between the various codes, the most stringent requirement shall govern.	1.11 FINISHES
1.07 ELECTRICAL REQUIREMENTS AND INTERFACE	A. All electrical equipment and wiring provided under this Division 22 shall comply with the electrical system characteristics indicated on the electrical drawings and specified in Division 26.
A. Electrical controls, contactors, starters, pilot lights, push buttons, etc., shall be provided complete as part of the motor, heater or other equipment which it operates. All electrical components shall be in conformance with the requirements of the National Electrical Code and Division 26. Reference Division 26 and the electrical engineering drawings for those motor starters provided under this Division 26. All starters not shown shall be provided under this Division 22. Unless specified otherwise under other individual equipment Sections, motor starters shall conform to the following minimum requirements: <ol style="list-style-type: none"> 1. Starters for motors 1/3 horsepower or smaller shall be manual unless remote or automatic starting is required, in which case the starters shall be magnetic, full voltage, non-reversing, single-speed, unless otherwise indicated. All other starters shall be magnetic. 	2.0 PRODUCTS
B. Each starter for a three-phase motor shall be furnished with three (3) overload relays sized for the full motor running current of the motor actually provided. Provide an external "HAND-OFF-AUTO" selector switch with red "RUNNING" light. Provide a green pilot light to indicate motor "STOPPED". Each pilot light shall have a legend plate indicating reason for signal.	2.01 BID BASIS AND SUBSTITUTION PROCEDURES
C. Each overload relay shall have a normally open alarm contact which will close only when actuated by an overload (not to be confused with N.O. or N.C. auxiliary contacts). These contacts shall be properly wired to their respective blue pilot light provided on the starter front cover and having a "TRIPPED" legend plate.	A. Manufacturers names, series and model numbers, as noted or specified, are for the purpose of describing type, capacity, and quality of equipment, materials and products to be used. Unless "or equal" is specifically stated, bids shall be based only on the specified "basis of design" manufacturer. The listing of a particular manufacturer as an "equal" or "acceptable substitute" manufacturer shall not be misconstrued as approving nor allowing the substitution of that manufacturer's standard product in place of the basis of design. No consideration will be given to a product which would require dimensional, spatial or aesthetic changes to the project. "Acceptable substitute" and "equal" manufacturers shall only bid those products which exactly match the size and other characteristics of the specified basis of design. Any changes to other disciplines and trades of work required by an "or equal" or "substitute" product shall be duly considered and priced accordingly prior to bidding or pricing. The decision as to whether or not a proposed substitute or "equal" product is actually equal to that specified shall rest solely with the Architect.
D. Individually mounted motor starters shall be in a NEMA Type 1 general purpose enclosure in unfinished areas and shall be flush mounted in all finished areas. All starters mounted in exterior areas shall have a NEMA 3R enclosure. Each starter shall have a laminated nameplate to indicate equipment unit number, function and circuit number.	B. Requests to provide "equal" products in lieu of those specified shall be submitted to the Architect in writing at least ten (10) days prior to final pricing and execution of the Contract. No consideration will be given to substitute products after final pricing and execution of the Contract.
E. All motor starters, push buttons and pilot lights shall be of the same manufacturer as the switchboard and shall be General Electric, Square D, Siemens I.T.E., or Westinghouse.	C. Any "or equal" product or proposed product substitution which will cause a change in the appearance, dimensions or design of any part of the building, its structure, electrical system or any other engineered systems shall be accompanied by a scaled drawing and written description of the required change(s) for approval by the Architect. If deemed necessary by the Architect, design changes shall be signed and sealed by a registered Professional Engineer, currently licensed in this State.
F. Connect new work to existing work in a neat and workmanlike manner. Where an existing structure must be cut or existing utilities interfere, such obstructions shall be bypassed, removed, relocated, patched and repaired. Work disturbed or damaged shall be replaced or repaired to its prior condition.	2.02 MINIMUM STANDARDS
G. Prior to the start of any demolition or construction, secure the services of a qualified, EPA Certified asbestos abatement agency to check the existing insulation, etc. for asbestos. Should asbestos be found, do not proceed with demolition or construction; notify the Architect in any case in writing of the agency's findings.	A. Every piece of energy consuming equipment, all fire suppression products and life safety equipment shall comply with the following standards as applicable; especially in regard to prevailing codes: <ol style="list-style-type: none"> 1. Factory Mutual Laboratories (FM) 2. Industrial Risk Insurers (IRI) 3. Underwriters Laboratories, Inc. (UL) 4. ADC: Air Diffusion Council 5. AGA: American Gas Association 6. AIA: Air Moving and Conditioning Association, Inc. 7. ANSI: American National Standards Institute
1.08 SLEEVES, SEALS AND ESCUTCHEONS	B. Requests to provide "equal" products in lieu of those specified shall be submitted to the Architect in writing at least ten (10) days prior to final pricing and execution of the Contract. No consideration will be given to substitute products after final pricing and execution of the Contract.
A. Sleeves shall be provided through all pipe penetrations of concrete or masonry walls, elevated floors and roofs, except those plumbing piping penetrations for fixtures, vents, etc.	C. Any "or equal" product or proposed product substitution which will cause a change in the appearance, dimensions or design of any part of the building, its structure, electrical system or any other engineered systems shall be accompanied by a scaled drawing and written description of the required change(s) for approval by the Architect. If deemed necessary by the Architect, design changes shall be signed and sealed by a registered Professional Engineer, currently licensed in this State.
B. Sleeves shall be fabricated from Schedule 40 steel pipe through 10" and Standard Wall steel pipe for sleeve sizes 12" and larger. All sleeves penetrating exterior walls, underground walls, pit or vault walls shall be provided with a 3" x 3/8" thick walerstop ring welded completely to the midpoint of the sleeve.	2.03 PAINTING
C. All sleeves penetrating exterior walls, underground walls, pit or vault walls and elevated floors shall be packed and sealed watertight.	A. All uncoated and uninsulated steel surfaces exposed to sight inside the building, such as piping, equipment hangers and supports which are not provided with factory prime coat or galvanizing, shall be cleaned and painted with one coat of rust inhibiting primer. In addition, all surfaces in finished spaces shall also be painted with two coats of finish paint in a color selected by the Architect.
D. Sleeves through roofs shall extend above the roof surface and be flashed watertight.	B. Each identification marker shall include the following: <ol style="list-style-type: none"> 1. Proper color-coded background. 2. Proper color of legend in relation to background color. 3. Proper legend letter size. 4. Proper marker length. 5. Direction of flow arrow shall be included on each marker.
E. Sleeves through walls shall be cut and finished flush with each surface of the wall in which they are installed.	C. All control equipment shall be adjusted to the settings required for the performance specified.
F. Sleeves shall be sized to provide a minimum of 1/2" clearance between the inside surface of the sleeve and the outside finished surface of the pipe plus any insulation specified.	D. All calls shall be thoroughly cleaned and combed prior to final inspection.
G. Fire-stops shall be provided as specified herein. All annular spaces between piping and sleeves which do not require fire-stops shall be packed with mineral wool and caulked.	2.04 PAINTING
H. Provide round, chrome-plated escutcheons on all exposed piping penetrations passing through walls, floors, partitions and ceilings.	A. All uncoated and uninsulated steel surfaces exposed to sight inside the building, such as piping, equipment hangers and supports which are not provided with factory prime coat or galvanizing, shall be cleaned and painted with one coat of rust inhibiting primer. In addition, all surfaces in finished spaces shall also be painted with two coats of finish paint in a color selected by the Architect.
1.09 FIRE-STOPS	B. Requests to provide "equal" products in lieu of those specified shall be submitted to the Architect in writing at least ten (10) days prior to final pricing and execution of the Contract. No consideration will be given to substitute products after final pricing and execution of the Contract.
A. Where ductwork, piping, conduit, etc. pass through fire partitions, fire walls and floors, a fire-stop shall be provided that will ensure an effective barrier against the spread of fire, smoke and gases. Fire-stop material shall be packed tight and completely fill gaps between the ductwork, piping, conduit, etc. and the perimeter of their rough openings.	C. Any "or equal" product or proposed product substitution which will cause a change in the appearance, dimensions or design of any part of the building, its structure, electrical system or any other engineered systems shall be accompanied by a scaled drawing and written description of the required change(s) for approval by the Architect. If deemed necessary by the Architect, design changes shall be signed and sealed by a registered Professional Engineer, currently licensed in this State.
B. Fire-stopping material shall maintain its dimensions and integrity while preventing the passage of flame, smoke and gases under conditions of installation and use when exposed to the ASTM E119 time-temperature curve for a time period equivalent to the rating of the assembly penetrated. Fire-stopping material shall be noncombustible as defined by ASTM E136; and, for insulation materials, melt point shall be a minimum of 1700 degrees F. for 1-hour protection and 1850 degrees F. for 2-hour protection. Fire-stopping material shall be Dow-Corning RTV Foam or 3M Fire Barrier Products or Sohio Carborundum Fire Putty.	2.05 IDENTIFICATION OF PIPING
C. See Section 22400 for fire-stopping of PVC piping.	A. All aboveground plumbing systems piping and valves sized 3/4" and larger which are installed in accessible locations (including piping above removable ceilings and behind access panels) shall be identified in strict conformance with the "Scheme for the Identification of Piping Systems" (ANSI A13.1 - 1981).
1.10 CORE DRILLING	B. Each identification marker shall include the following: <ol style="list-style-type: none"> 1. Proper color-coded background. 2. Proper color of legend in relation to background color. 3. Proper legend letter size. 4. Proper marker length. 5. Direction of flow arrow shall be included on each marker.
A. Cutting of holes through concrete and masonry shall be by diamond core or concrete saw. Pneumatic hammer, impact electric and hand or manual hammer type drills will not be allowed, except as permitted by the Architect where required by limited working space. Locate holes such that they will not affect structural sections such as ribs or beams. Holes shall be laid out well in advance of the installation. These layout locations shall be approved by the Architect prior to drilling.	C. All control equipment shall be adjusted to the settings required for the performance specified.
1.11 FINISHES	D. All calls shall be thoroughly cleaned and combed prior to final inspection.
A. All uncoated and uninsulated steel surfaces exposed to sight inside the building, such as piping, equipment hangers and supports which are not provided with factory prime coat or galvanizing, shall be cleaned and painted with one coat of rust inhibiting primer. In addition, all surfaces in finished spaces shall also be painted with two coats of finish paint in a color selected by the Architect.	2.06 PIPE HANGERS AND SUPPORTS
B. Each identification marker shall include the following: <ol style="list-style-type: none"> 1. Proper color-coded background. 2. Proper color of legend in relation to background color. 3. Proper legend letter size. 4. Proper marker length. 5. Direction of flow arrow shall be included on each marker. 	A. Pipe hangers, hanger rods, trapeze tie hangers, upper attachments and other supports shall be selected based on pipe size (plus insulation of pipes specified to be insulated) and the weight of the medium being transported or the medium used for testing, whichever is greater. Provide oil hangers and rods, turnbuckles, angles, channels, and other structural supports to support the piping systems. Rods for pipe hangers shall be full size of the hanger manufacturer's catalog listed rod size for each type hanger specified. Hangers and supports shall be Michigan, ITT Grinnell or B-Line.
C. All control equipment shall be adjusted to the settings required for the performance specified.	B. All material utilized for the hanging and support of the piping systems shall be manufactured products which are specifically intended for the purpose of hanging piping systems. The use of wire, steel straps, plastic ties, etc. is strictly prohibited.
D. All calls shall be thoroughly cleaned and combed prior to final inspection.	C. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
2.04 PAINTING	D. Blanket-type insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.
A. All uncoated and uninsulated steel surfaces exposed to sight inside the building, such as piping, equipment hangers and supports which are not provided with factory prime coat or galvanizing, shall be cleaned and painted with one coat of rust inhibiting primer. In addition, all surfaces in finished spaces shall also be painted with two coats of finish paint in a color selected by the Architect.	E. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
B. Each identification marker shall include the following: <ol style="list-style-type: none"> 1. Proper color-coded background. 2. Proper color of legend in relation to background color. 3. Proper legend letter size. 4. Proper marker length. 5. Direction of flow arrow shall be included on each marker. 	F. Insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.
C. All control equipment shall be adjusted to the settings required for the performance specified.	G. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
D. All calls shall be thoroughly cleaned and combed prior to final inspection.	H. All longitudinal joints shall be lapped and sealed with type III mastic joints, tears, etc. sealed with a matching white vapor barrier tape. Elbows shall be mitered or may be Zeston cones filled with equivalent fiberglass insulation. The maximum K value of the insulation shall be 0.23 at 70 degrees F. All piping in unconditioned areas shall be insulated with a minimum R value of 6.5 in accordance with NCSPC 2009 section 305.6.
2.05 IDENTIFICATION OF PIPING	I. All water hammer arresters (WHA) shall be PDI Certified, Size A, B, C, D, E or F, as indicated for the fixture units served; Josam, Jay R. Smith or Zurn.
A. All aboveground plumbing systems piping and valves sized 3/4" and larger which are installed in accessible locations (including piping above removable ceilings and behind access panels) shall be identified in strict conformance with the "Scheme for the Identification of Piping Systems" (ANSI A13.1 - 1981).	J. Soldered joints shall be made with tin-antimony/silver solder. Solder containing lead shall not be permitted.
B. Each identification marker shall include the following: <ol style="list-style-type: none"> 1. Proper color-coded background. 2. Proper color of legend in relation to background color. 3. Proper legend letter size. 4. Proper marker length. 5. Direction of flow arrow shall be included on each marker. 	2.05 PLUMBING INSULATION
C. All control equipment shall be adjusted to the settings required for the performance specified.	A. All pipe insulation products shall have a permanent composite insulation, jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
D. All calls shall be thoroughly cleaned and combed prior to final inspection.	B. Blanket-type insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.
2.06 PIPE HANGERS AND SUPPORTS	C. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
A. Pipe hangers, hanger rods, trapeze tie hangers, upper attachments and other supports shall be selected based on pipe size (plus insulation of pipes specified to be insulated) and the weight of the medium being transported or the medium used for testing, whichever is greater. Provide oil hangers and rods, turnbuckles, angles, channels, and other structural supports to support the piping systems. Rods for pipe hangers shall be full size of the hanger manufacturer's catalog listed rod size for each type hanger specified. Hangers and supports shall be Michigan, ITT Grinnell or B-Line.	D. Insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.
B. All material utilized for the hanging and support of the piping systems shall be manufactured products which are specifically intended for the purpose of hanging piping systems. The use of wire, steel straps, plastic ties, etc. is strictly prohibited.	E. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
C. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.	F. Insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.
D. Blanket-type insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.	G. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
E. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.	H. All longitudinal joints shall be lapped and sealed with type III mastic joints, tears, etc. sealed with a matching white vapor barrier tape. Elbows shall be mitered or may be Zeston cones filled with equivalent fiberglass insulation. The maximum K value of the insulation shall be 0.23 at 70 degrees F. All piping in unconditioned areas shall be insulated with a minimum R value of 6.5 in accordance with NCSPC 2009 section 305.6.
F. Insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.	I. All water hammer arresters (WHA) shall be PDI Certified, Size A, B, C, D, E or F, as indicated for the fixture units served; Josam, Jay R. Smith or Zurn.
G. Preformed insulation for all domestic hot and cold water piping shall be minimum 1" thick preformed fiberglass pipe insulation with white oil-service jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.	J. Soldered joints shall be made with tin-antimony/silver solder. Solder containing lead shall not be permitted.
H. All longitudinal joints shall be lapped and sealed with type III mastic joints, tears, etc. sealed with a matching white vapor barrier tape. Elbows shall be mitered or may be Zeston cones filled with equivalent fiberglass insulation. The maximum K value of the insulation shall be 0.23 at 70 degrees F. All piping in unconditioned areas shall be insulated with a minimum R value of 6.5 in accordance with NCSPC 2009 section 305.6.	2.06 PLUMBING INSULATION
I. All water hammer arresters (WHA) shall be PDI Certified, Size A, B, C, D, E or F, as indicated for the fixture units served; Josam, Jay R. Smith or Zurn.	A. All pipe insulation products shall have a permanent composite insulation, jacket and adhesive fire and smoke blocking rating as tested by procedure ASTM-84, NFPA 255 and UL 723 not exceeding Flame Spread 25 or Smoke Developed 50.
J. Soldered joints shall be made with tin-antimony/silver solder. Solder containing lead shall not be permitted.	B. Blanket-type insulation shall have an average thermal conductivity not to exceed 0.27 BTU-in. per sq. ft. per degree F. per hour at a mean temperature of 75 degrees F. Insulation shall have a minimum density of 1 lb./cu.ft. and shall be 2" thick.




2211 Congress Street
Portland, ME 04122

Gensler

214 North Tryon Street
Suite 2320
Charlotte, NC 28202
United States

Tel 704.377.2725
Fax 704.377.2807




Brad J. Rabinowitz, P.E.
420 Mueller Lane
Charlotte, NC 28217
Tel 704.357.9333
MRP-JOB# 170358

△ Date

12.15.2017 ISSUE FOR PERMIT AND CONSTRUCTION

Seal Signature

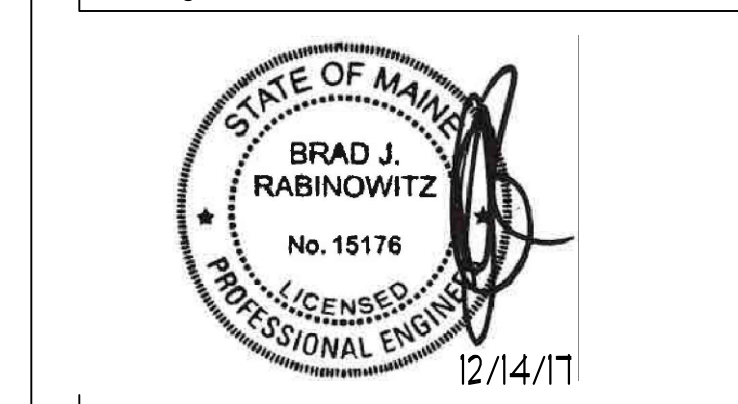

Project Name
Unum Workplace Transformation - Phase 2 & 3 (HO2 & HO3)

Project Number
59.6481.003

Description
SPECIFICATIONS - PLUMBING

Scale

P0.001

© 2017 Gensler