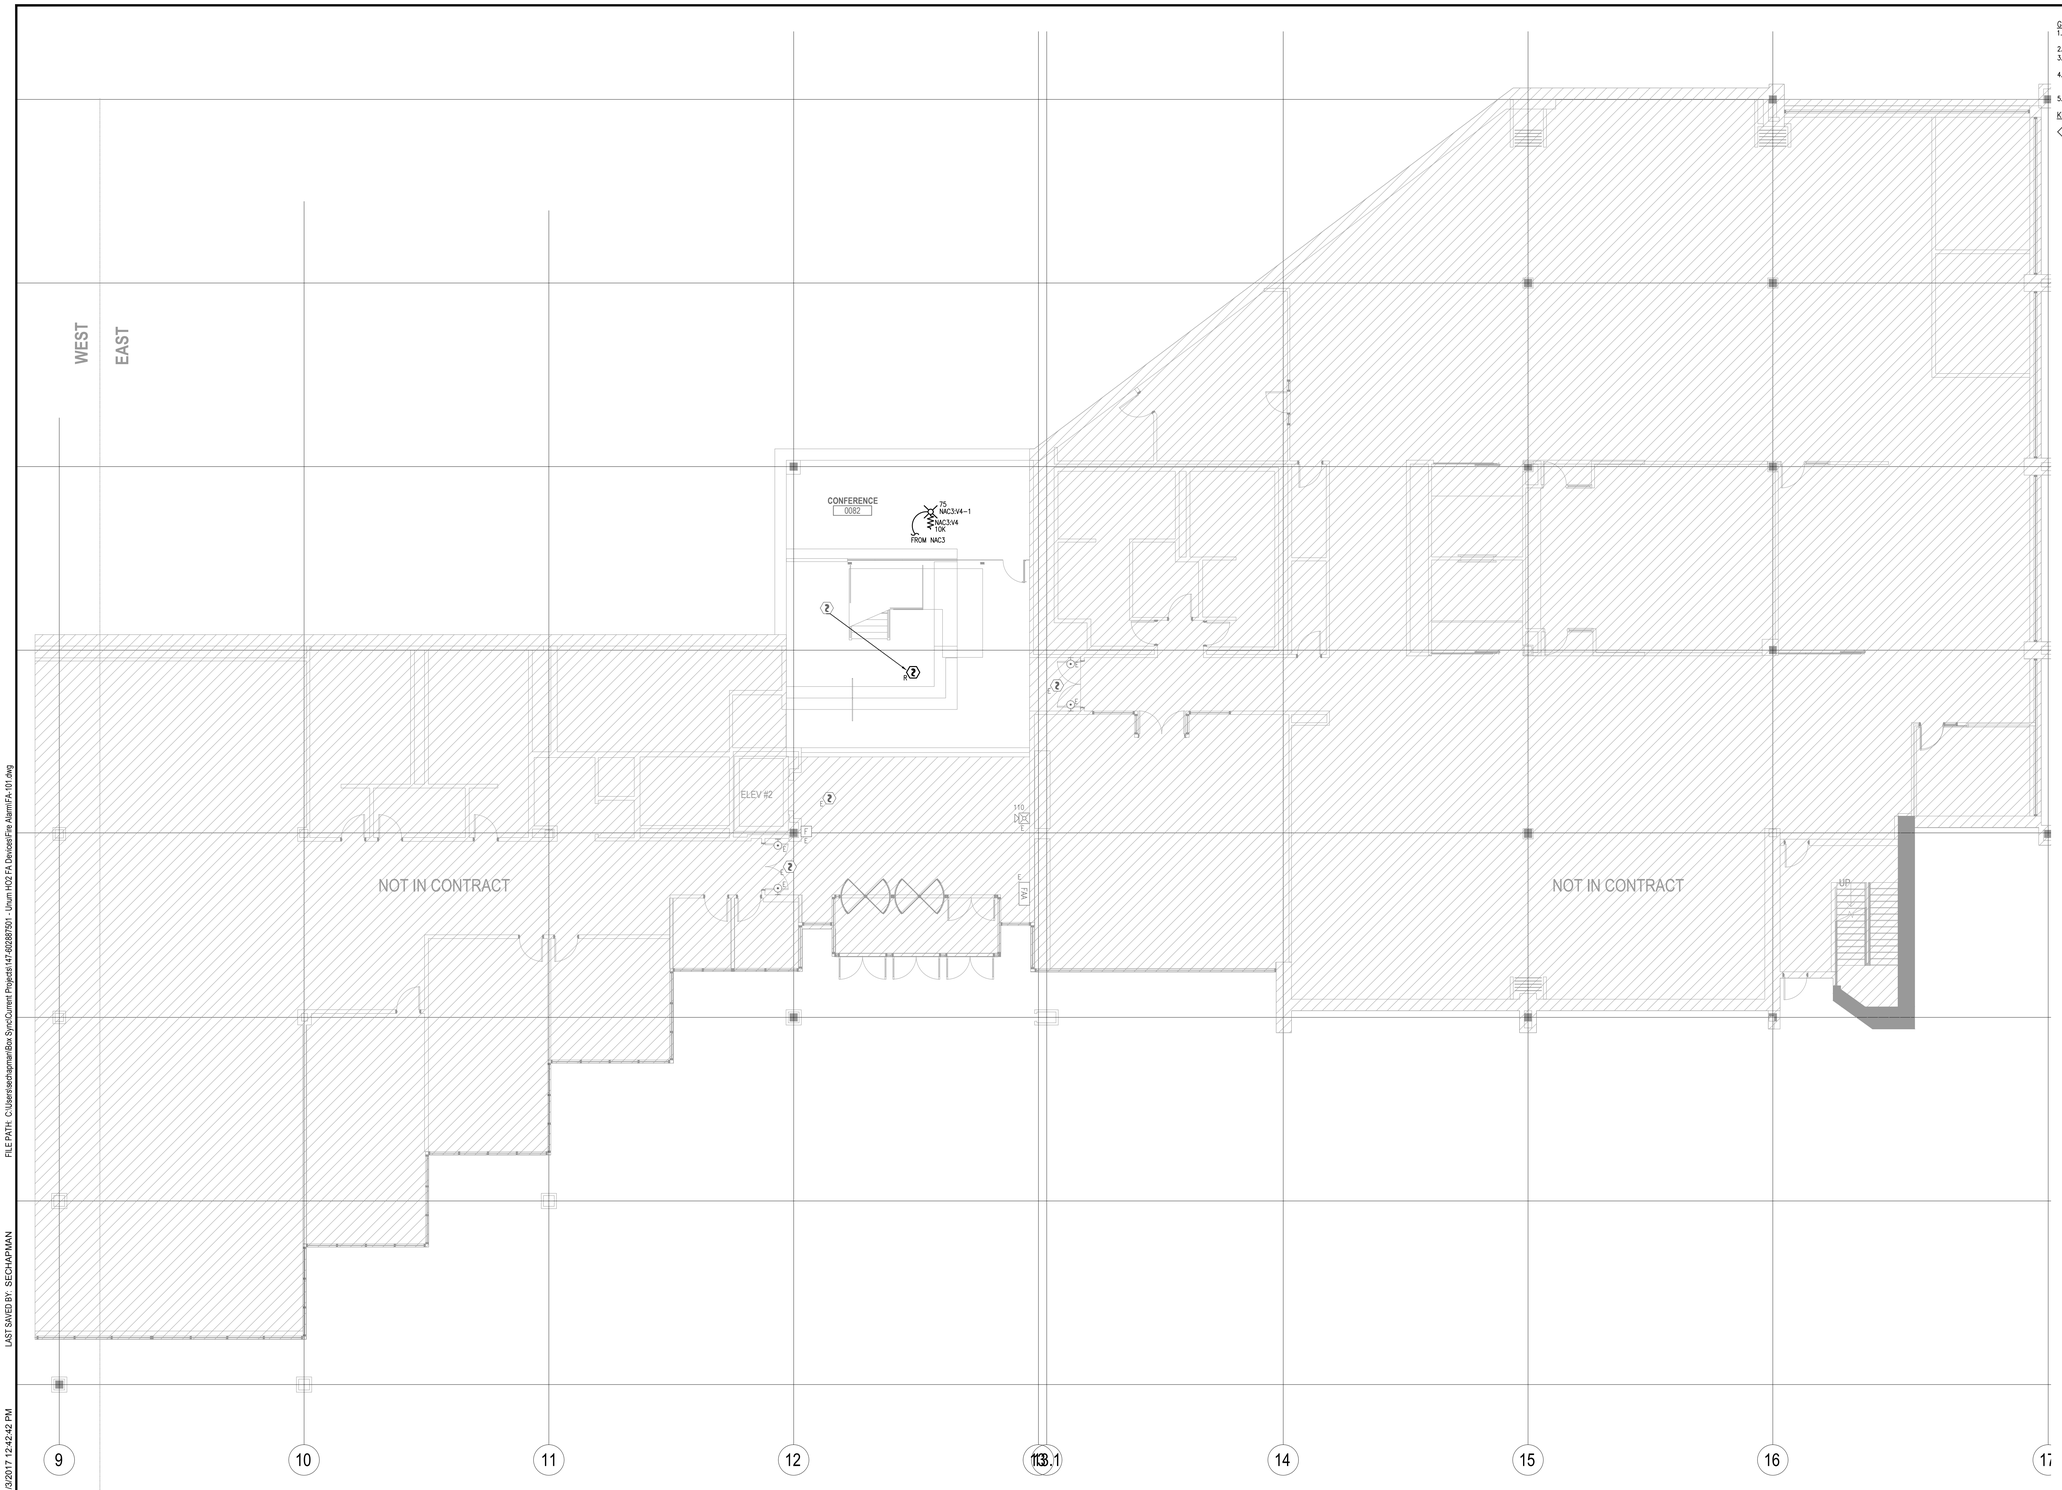

GENERAL NOTES:

1. COORDINATE ALL DEVICES LOCATION AND MOUNTING HEIGHTS WITH THE ARCHITECT & FURNITURE VENDOR PRIOR TO INSTALLATION.
2. HATCHED AREA NOT IN THIS SCOPE OF WORK
3. 'E' DENOTES EXISTING DEVICE TO REMAIN. 'R' DENOTES EXISTING DEVICES TO BE RELOCATED. 'D' DENOTES EXISTING ITEM TO BE REMOVED.
4. VERIFY PROPER FUNCTIONALITY OF ALL EXISTING AND RELOCATED FIRE ALARM DEVICES, INCLUDING THEIR HOUSING, LENSES, etc... OPERATING AS INTENDED OR HAVE ABOVE NORMAL WEAR OR DEFECTS.
5. ALL WIRING WITHIN AND THROUGH THE OPEN TO STRUCTURE AREAS SHALL BE IN EMT.

KEYNOTES:

1. EXISTING DEVICE TO BE RELOCATED INTO NEW CEILING. EXTEND ALL ASSOCIATED CONDUIT AND WIRING AS REQUIRED.

PLAN NORTH

GROUND FLOOR DEVICE PLACEMENT PLAN

SCALE: 1/8" = 1'-0"

0 4 8 16 (IN FEET)

tyco SimplexGrinnell
Safer. Smarter. Tyco.™
DISTRICT - 147
30 THOMAS DRIVE
WESTBROOK, ME 04092
SERVICE: 207-842-6440
PHONE: 207-842-6440
FAX: 207-842-6439

unum

UNUM WORKPLACE TRANSFORMATION - HO2

UNUM HO2
2211 CONGRESS ST, MAIL STOP B146
PORTLAND, ME 04102-1941

Revisions shown with symbol

ISSUE LOG:				
MARK	DATE	CAD	CHK	DESCRIPTION

DRAWN BY:	PRANESH
CHECKED BY:	AO
ISSUE DATE:	11/3/17
JOB #:	602887501
PROJECT #:	147:
SIMPLEXGRINNELL © 2017	

SYSTEM:
FIRE ALARM SYSTEM

SHEET:
GROUND FLOOR DEVICE PLACEMENT PLAN

FA-101

IMPORTANT NOTICE TO USER: By accepting or using this drawing and/or the information contained herein, the user agrees to the following terms and conditions: The electronic information in the drawing may be subject to intentional or unintentional alteration. Any use, reuse, copying modification or alteration of the information contained herein shall be at the sole risk of the user. This information may not be sold or transferred to any third party, used on other projects or additions to the project for which it was prepared, or used for completion of this project by any third party. SimplexGrinnell disclaims all liability for the use or reuse of altered files by the user or any third party and such use will be a user's sole risk. User shall, to the fullest extent permitted by law, defend, indemnify, and hold SimplexGrinnell harmless from any and all claims for loss, damage or injury arising directly or indirectly therefrom.

FILE PATH: C:\Users\sechapman\Box Sync\Current Projects\147-602887501 - Unum HO2 FA Devices\Fire Alarm\FA-101.dwg
LAST SAVED BY: SECHAPMAN
LAST PRINTED: 11/3/2017 12:42:42 PM
30" x 42" - Arch E1 Size