


FILE PATH: C:\Users\sechapan\Box Sync\Current Projects\147\_602887501 - Unum HO2 FA Devices\Fire Alarm\FA-201.dwg

LAST SAVED BY: SECHAPAN

LAST PRINTED: 11/3/2017 12:43:06 PM

30 x 42" Arch E1 Size

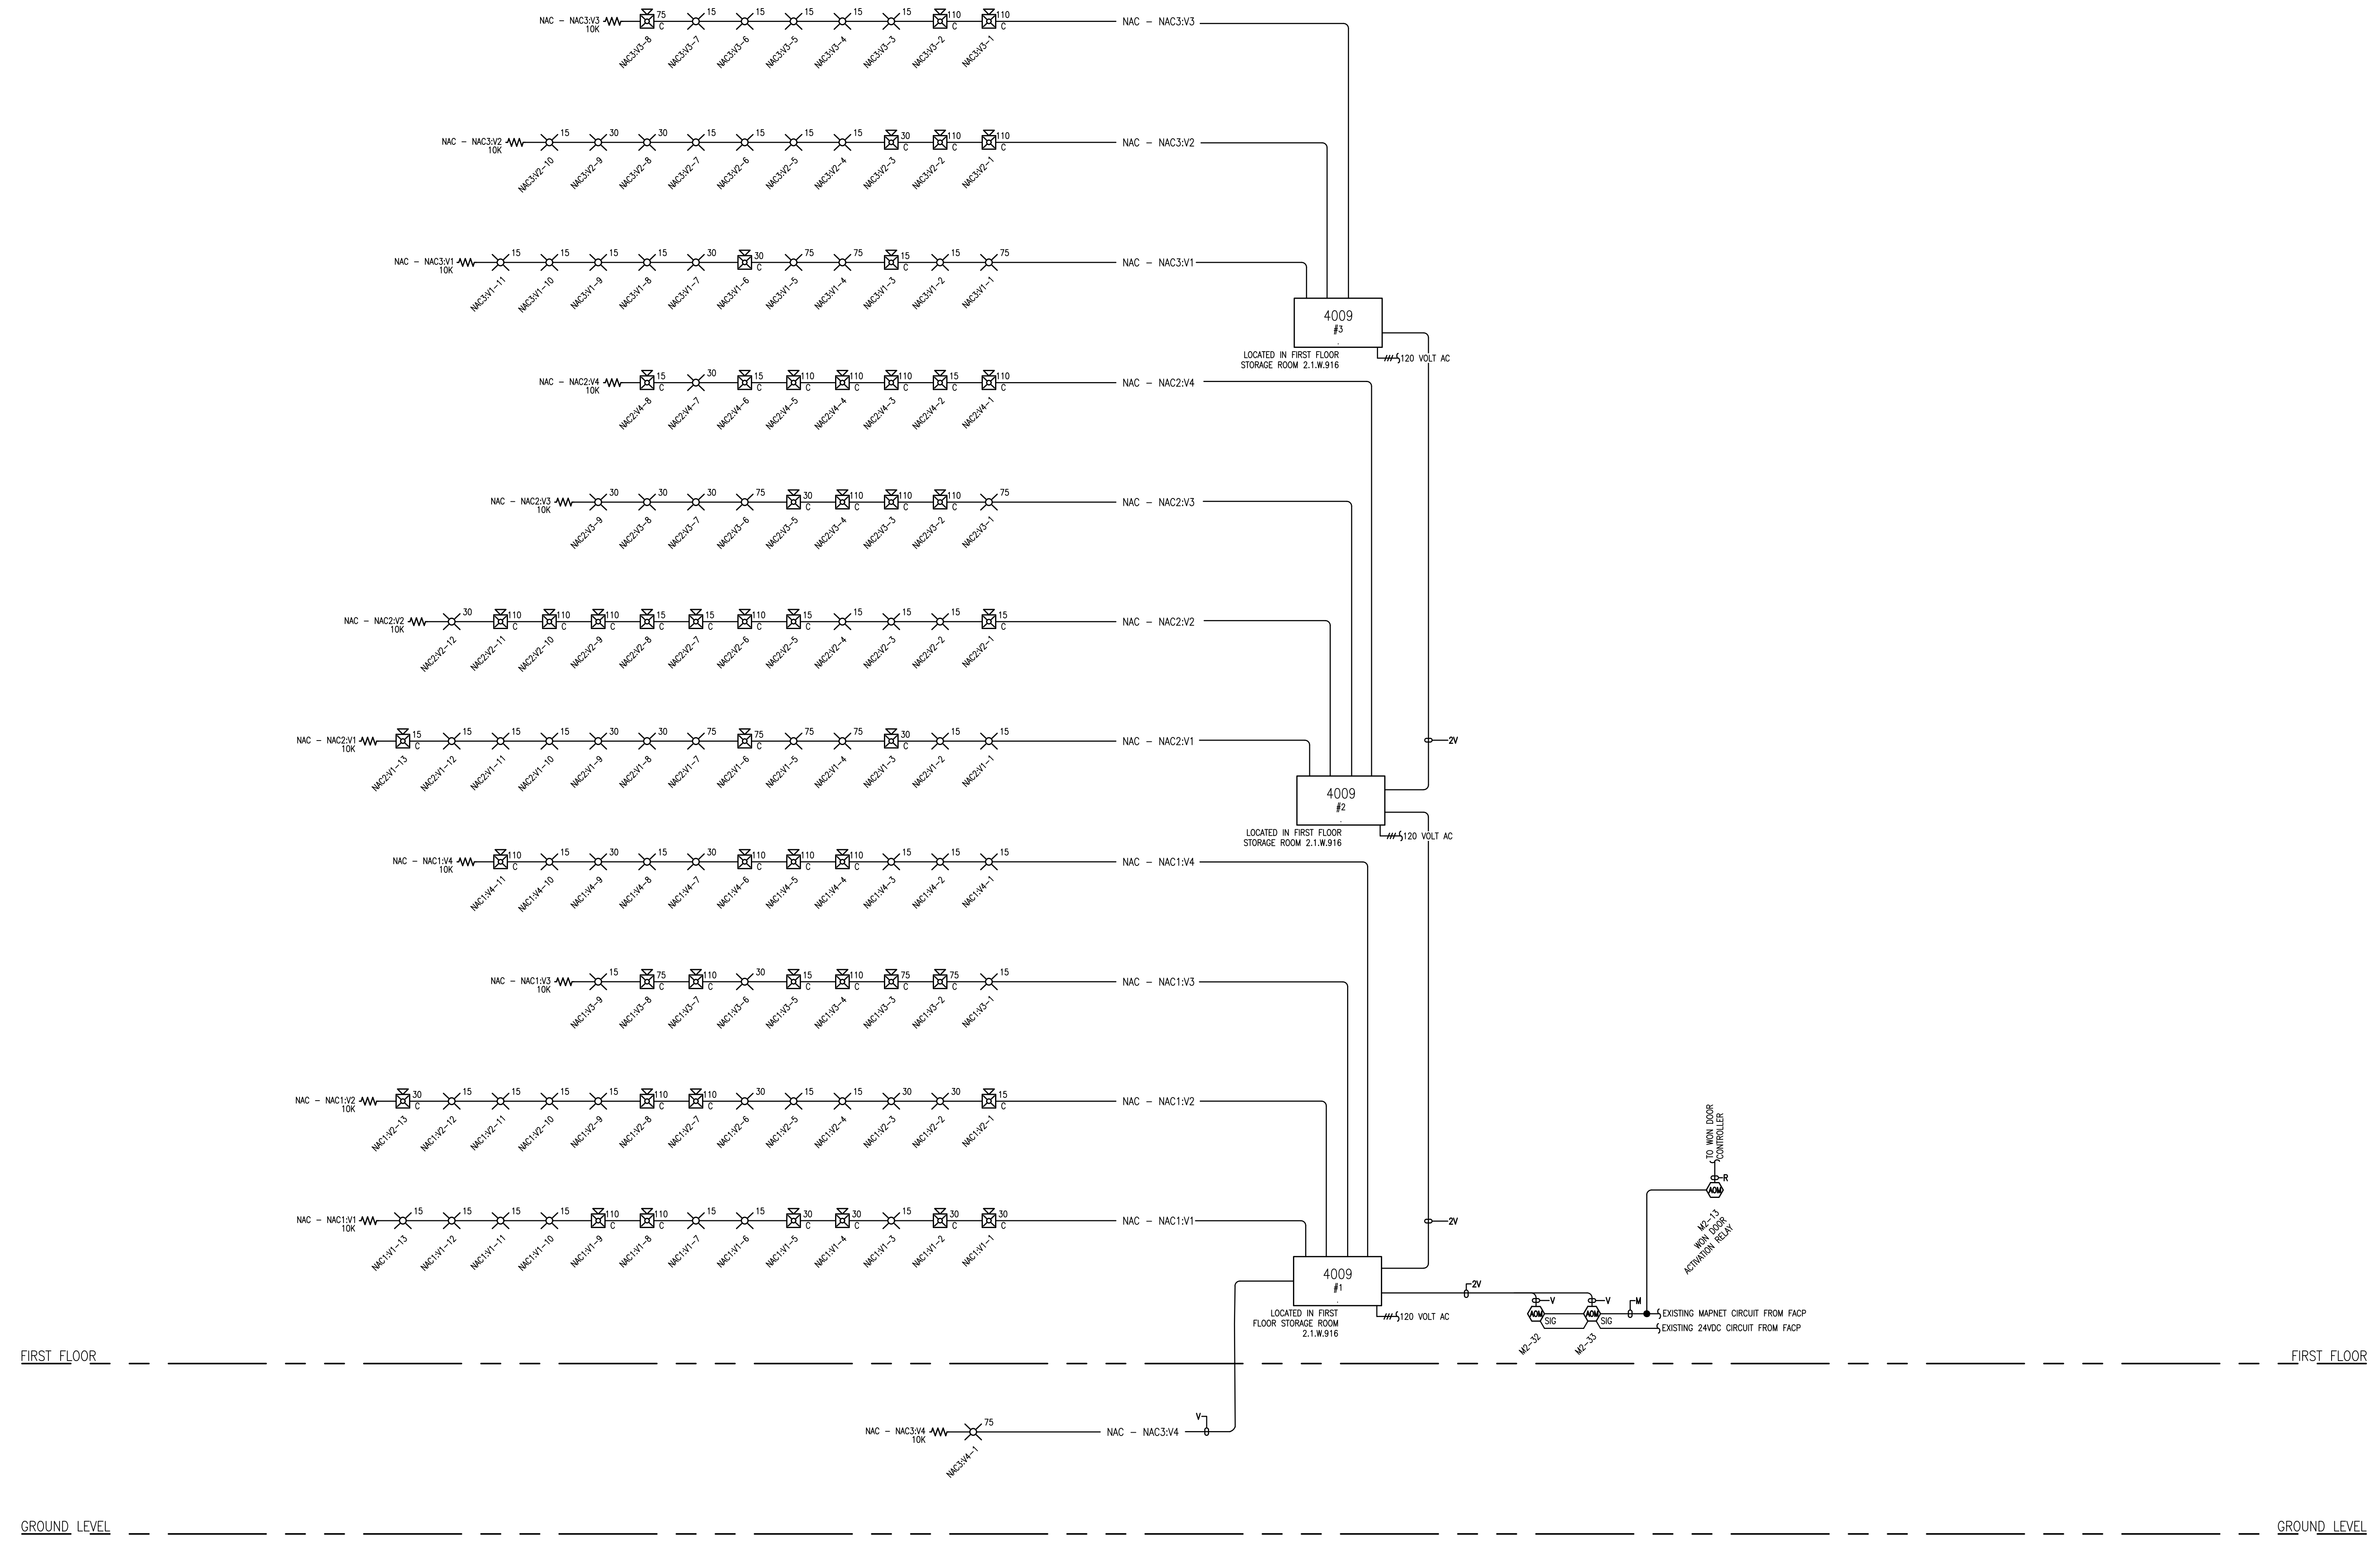


FIRST FLOOR

FIRST FLOOR

GROUND LEVEL

GROUND LEVEL

- RISER NOTES:**
- RISER IS A DIAGRAMMATICAL REPRESENTATION OF THE SYSTEM ARCHITECTURE; IT IS NOT INTENDED TO REPRESENT ACTUAL WIRE RUNS OR PANEL PENETRATIONS. REFER TO FLOOR PLANS AND PANEL DETAILS FOR CIRCUIT ROUTING INFORMATION.
  - ALL WIRING SHALL COMPLY WITH NFPA 70 ARTICLE 760 POWER LIMITED SYSTEMS. SEE FA-002 FOR WIRE SCHEDULE.

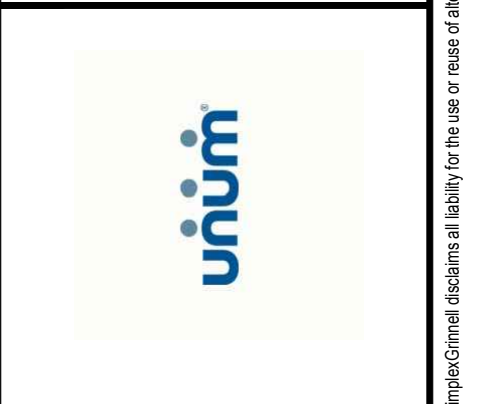

**UNUM WORKPLACE TRANSFORMATION - HO2**

UNUM HO2  
2211 CONGRESS ST., MAIL STOP B146  
PORTLAND, ME 04102-1941

ISSUE LOG	MARK	DATE	CHK	DESCRIPTION

DRAWN BY: PRANESH  
CHECKED BY: AO  
ISSUE DATE: 11/3/17  
JOB #: 602887501  
PROJECT #: 147  
PROJECT: SIMPLEXGRINNELL © 2017  
SYSTEM: FIRE ALARM SYSTEM

SHEET:  
RISER DIAGRAM - GROUND LEVEL AND FIRST FLOOR

REVISIONS TO WIRING: By reviewing or using the drawings under the conditions stated herein, the user agrees to the following terms and conditions. The electronic information in the drawings may be subject to electronic or mechanical alteration. Any use, reuse, copying, modification or alteration of the information contained herein shall be the sole risk of the user. This information may not be sold or transferred to any third party, used or other projects or additions to the project for which it was prepared or used for completion of the project by any third party. SimplexGrinnell disclaims all liability for the use or reuse of altered files by the user or any third party and shall not be held liable for any such use. User must obtain user consent from the user. © 2017 SimplexGrinnell