



- 2 ELECTRICAL SYMBOLS**
NOT TO SCALE
- FIRE ALARM CONTROL PANEL
 - FIRE ALARM ANNUNCIATOR PANEL
 - FIRE ALARM AUDIO/VISUAL, MOUNT 6'-8" AFF, NUMBER DENOTES CANDELA RATING. "MH" DENOTES MINIHOORN, "V" DENOTES VOICE EVACUATION. NO DESIGNATION EQUALS 15cd
 - FIRE ALARM PULL STATION, MOUNT 48" AFF
 - FIRE ALARM VISUAL STROBE ONLY, FLUSH MOUNT 6'-8" AFF, NUMBER DENOTES CANDELA RATINGS. "CL" DENOTES CEILING MOUNTED
 - SYSTEM CONNECTED SMOKE / CARBON MONOXIDE DETECTOR, PHOTOELECTRIC TYPE
 - SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR
 - SMOKE DETECTOR, PHOTOELECTRIC TYPE, SYSTEM CONNECTED.
 - SMOKE DETECTOR, PHOTOELECTRIC TYPE, SYSTEM CONNECTED. "ER" DENOTES ELEV RECALL
 - SYSTEM CONNECTED SMOKE DETECTOR, PHOTOELECTRIC TYPE, WITH SOUNDER BASE
 - CARBON MONOXIDE DETECTOR
 - DUCT SMOKE DETECTOR & TEST STATION
 - FIRE/SMOKE DAMPER, SUPPLIED AND INSTALLED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR TO PROVIDE ALL WIRING CONNECTIONS AND FIRE ALARM DUCT SMOKE DETECTORS, ADDRESSABLE MODULES AND PROGRAMMING.
 - KNOX BOX
 - SPRINKLER SYSTEM FLOW SWITCH } SUPPLIED BY SPRINKLER CONTRACTOR
 - SPRINKLER SYSTEM TAMPER SWITCH } WIRED BY EC, VERIFY LOCATIONS WITH SPRINKLER CONTRACTOR.
 - SELF CONTAINED EMERGENCY LIGHT W/2 HEADS DUAL-LITE (LED) MODEL LZ65H-03L, 65 WATTS FOR 90 MINUTES, COLOR BY ARCHITECT
 - UNIVERSAL MOUNTED, DOUBLE FACED EXIT LIGHT
PROVIDE DIRECTIONAL ARROWS AS INDICATED ON PLAN
 - UNIVERSAL MOUNTED, SINGLE FACED EXIT LIGHT
PROVIDE DIRECTIONAL ARROWS AS INDICATED ON PLAN

1 ELECTRICAL LIFE SAFETY PLAN
1/8" = 1'-0"

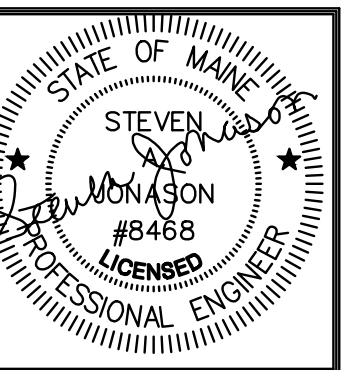

Prepared For:

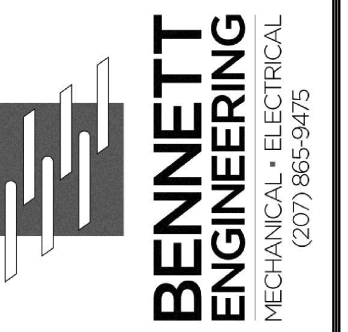

Consultant:



Architect:

Project: Elks Lodge

Portland, Maine

Revisions:

Date: 04/12/2017

Scale: 1/8" = 1'-0"

ELECTRICAL
LIFE SAFETY

ELS-1