

MEDICAL OFFICE BUILDING

CONGRESS ST. PORTLAND, ME

DRAWING LIST

AD-01 TYPICAL SHAFT WALL ASSEMBLY
 AD-03 BASEMENT CEILING CHANGES
 AD-04 WORK SURFACE-WORK ROOM 123
 AD-05 LOBBY LIGHTING
 SK-02 BASEMENT PLAN
 SK-03 BASEMENT DIMENSIONS
 SKETCHES
 SK-01 ELEVATOR MACHINE ROOM REVISION

GENERAL

LS1.1 LIFE SAFETY

CIVIL

C1.0 SUBDIVISION PLAT
 C1.1 SITE PLAN
 C1.2 EXISTING CONDITIONS AND DEMOLITION PLAN
 C1.3 UTILITIES PLAN
 C1.4 GRADING PLAN
 C1.5 EROSION CONTROL PLAN
 C2.1 DETAILS
 C2.2 DETAILS
 C2.3 DETAILS
 C2.4 DETAILS
 C2.5 DETAILS
 C2.6 DETAILS

STRUCTURAL

S1.0 GENERAL NOTES
 S1.1 FOUNDATION PLAN
 S1.2 FIRST FLOOR FRAMING PLAN
 S1.3 SECOND FLOOR FRAMING PLAN
 S1.4 ROOF FRAMING PLAN
 S2.0 SECTIONS
 S2.1 SECTIONS
 S2.2 SECTIONS

ARCHITECTURAL DRAWINGS

A1.01 BASEMENT & FIRST FLOOR PLANS
 A1.02 SECOND FLOOR & ROOF PLAN
 A2.01 BUILDING ELEVATIONS
 A2.02 BUILDING ELEVATIONS
 A3.01 BUILDING SECTIONS
 A3.11 ELEVATOR AND STAIR SECTIONS AND DETAILS
 A3.12 STAIR SECTIONS AND DETAILS
 A3.21 WALL SECTIONS
 A3.22 WALL SECTION
 A4.00 FLOOR, CEILING AND ROOF TYPES
 A4.02 WALL TYPES
 A5.00 DETAILS
 A5.01 DETAILS
 A8.01 DOOR SCHEDULE
 A8.02 WINDOW SCHEDULE
 A8.03 WINDOW DETAILS

DATE OF ISSUE

12/27/2016 ISSUED FOR BUILDING SHELL CONSTRUCTION




LOCATION MAP

NOT TO SCALE



ARCHETYPE
Architects

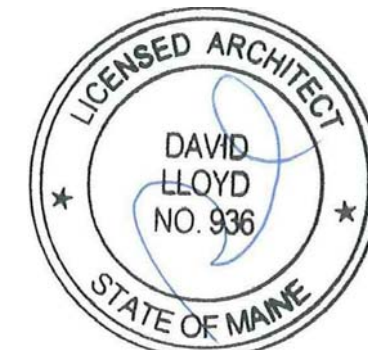

CODE SUMMARY

Applicable Codes

- MUBEC - Maine Uniform Building and Energy Code
- 2009 International Building Code - IBC (except chapters 11 and 30)
- 2009 IECC: International Energy Conservation Code
- NFPA 101 Life Safety - 2009

Accessibility Codes

- State of Maine Human Rights Act
- ADAAG Americans with Disabilities Act
- ICC ANSI 117.1 Accessible and Usable Buildings and Facilities

PROJECT SUMMARY:
Two-story office building with a basement.

Square Footages:
8,064 sq.ft.

CODE SUMMARY :

Chapter 3- Use and Occupancy Classification Mixed Use

304.1 Business Group B Ambulatory Healthcare Facility

Chapter 4 - Special Detailed Requirements Based on Use and Occupancy

422.5 Automatic sprinkler systems shall be provided for ambulatory health care facilities in accordance with Section 903.2.2

422.6 A fire alarm system shall be provided in accordance with Section 907.2.2.1

Chapter 5- General Building Heights and Areas

Table 503 Allowable Heights and Areas

Business Group B	3 stories (2 Proposed)
Type 5B (Sprinkled) -	9,000 SF allowed without modifications (8,064 Proposed)

Chapter 6- Types of Construction

Table 601 - Fire Resistance Ratings for Building Elements

Building Element	Type 5B
Primary Structural Frame	0 hour
Bearing Walls	0 hour
Exterior Walls	0 hour
Interior Walls	0 hour
Non-Bearing Walls and Partitions, Exterior	(See Table 602)
Non-Bearing Walls and Partitions, Interior	0 hour
Floor Construction and Secondary Members	0 hour
Roof Construction and Secondary Members	0 hour

708.4 Fire-resistance rating
Shaft enclosures shall have a fire-resistance rating of not less than 2 hours where connecting four stories or more, and not less than 1 hour where connecting less than four stories.

717 Concealed Spaces

717.2 In combustible construction fireblocking shall be installed to cut off concealed draft openings and form a barrier between floors, between a top story and roof or attic space. Fireblocking required at:

- Mineral wool allowed in double stud walls
 - Vertically at floors and ceilings
 - Horizontal spacing not exceeding 10 feet
- Connections between horizontal and vertical spaces (soffits, dropped ceilings, etc.)
- Stairways at top and bottom of run between stringers
- Piping, vents, etc.

717.2.5 Double Stud Walls Batts or blankets of mineral or glass fiber insulation shall be allowed as fire blocking in walls constructed using parallel rows of studs or staggered studs.

717.2.2 Concealed Wall Spaces Fire blocking shall be provided in concealed spaces of stud walls and partitions, including furred spaces, and parallel rows of studs or staggered studs as follows:

- Vertically at ceiling and floor levels
- Horizontally at intervals not exceeding 10'.

Chapter 8- Interior Finishes

Table 803.9 Interior Wall and Ceiling Finish Requirements

By Occupancy- Sprinklered

Group	Exit Enclosures	Corridors	Rooms and Enclosed Spaces
B	Class B	Class C	Class C

Chapter 9- Fire Protection Systems

903.3.1.1 NFPA 13 Sprinkler Systems
The building will be equipped throughout with an automatic sprinkler system in accordance with NFPA 13.

903.4 Sprinkler system supervision and alarms
Valves controlling the water supply for automatic sprinkler systems, pumps, tanks, water levels and temperatures, critical air pressures and waterflow switches on all sprinkler systems shall be electrically supervised by a listed fire alarm control unit.

905.3.1 Standpipes NOT required where the highest floor is less than 30 feet above the lowest level of fire department vehicle access.

906 Portable Fire Extinguishers. Required in Group A, B, M, R-2, and S occupancies; provided in accordance with NFPA 10

- Exception: In Group A and B occupancies extinguishers only required on each floor.

907 Fire Alarm and Detection Systems

907.2.2 Group B
A manual fire alarm system shall be installed in Group B occupancies where one of the following conditions exists:

- The combined Group B occupant load of all floors is 500 or more.
- The Group B occupant load is more than 100 persons above or below the lowest level of exit discharge.

Exception: Manual fire alarm boxes are not required where the building is equipped throughout with an automatic sprinkler system installed in accordance with Section 903.3.1.1 and the occupant notification appliances will activate throughout the notification zones upon sprinkler water flow.

907.2.2.1 Fire areas containing ambulatory health care facilities shall be provided with an electronically supervised automatic smoke detection system.
Exception: Buildings equipped throughout with an automatic sprinkler in accordance with Section 903.3.1.1, provided the occupant notification appliances will activate throughout the notification zones upon sprinkler water flow.

912.2 Location

With respect to hydrants, driveways, buildings and landscaping, fire department connections shall be so located that fire apparatus and hose connected to supply the system will not obstruct access to the buildings for other fire apparatus. The location of fire department connections shall be approved by the fire chief.

912.2.1 Visible location

Fire department connections shall be located on the street side of buildings, fully visible and recognizable from the street or nearest point of fire department vehicle access or as otherwise approved by the fire chief.

Chapter 10- Means of Egress

1007 Accessible Means of Egress (NOT REQ'D)

1007.2.1 Elevators Required. In buildings where a required accessible floor is four or more stories above a level of exit discharge, at least one accessible means of egress shall be an elevator. (Backup Generator Not Req'd - Level of Exit Discharge is Level 1).

1007.3 Stairways
Clear width 48" Not Required in buildings with automatic sprinkler system. Exception no. 2
Area of Refuge. Not Required in buildings with automatic sprinkler system. Exception no. 3

1007.4 Elevators Exception 2: Area of refuge not required if building equipped with automatic sprinkler system.

1007.8 Two-way communication system shall be provided at each elevator landing.

1007.10 Directional signage shall be provided at elevator landings.

1008 Doors, Gates and Turnstiles

1008.1.1 Size of Doors. Minimum Clear width = 32", maximum leaf width 48"

1009 Stairways

1009.1 Stairway width. Minimum required width of 44" is provided.

1009.12 Handrails required on each side of stair.

1009.13 Stairway to Roof- In buildings four or more stories in height, one stairway shall extend to the roof surface. In buildings without an occupied roof, access to the roof from the top story shall be permitted to be by an alternating tread device.

1013.1 Guard (rifle) are required at stairs more than 30" above the floor and within 36" horizontally to the edge of the open side.

Section 1014 Exit Access

1014.3 Common Path of Egress Travel. (PER MUBEC Refer to NFPA 101-2009 7.2.1.1.3) (refers to NFPA 38.2.5.3.1) Not to exceed 100ft in sprinklered building.

1015-Exit and Exit Access Doorways

1015.1 Two exits required from any space except as permitted by Table 1015.1

1016 Exit Access Travel Distance

Table 1016.1 Exit Access Travel Distance

Occupancy	Max. Distance	Sprinklered
B -Business	300'	

1018 Corridors

Table 1018.1 Corridor Fire Resistance Rating

Occupancy	Occupant Load	Fire Rating with Sprinkler System
B	Greater than 10	0 hour

1018.2 Corridor Width: Minimum 44" provided.

1018.4 Dead Ends: 50' maximum dead end corridor allowed per Exception No. 2 for Group B.

1022.7 Discharge Identification

A stairway in an exit enclosure shall not continue below its level of exit discharge unless an approved barrier is provided at the level of exit discharge to prevent persons from unintentionally continuing into levels below. Directional exit signs shall be provided as specified in Section 1011.

NFPA 101 - 2009

6.1.11.1 Business Occupancy

NFPA Table A5.2.1.2
Construction type V(000)

38 New Business Occupancy

38.2.5.3.1 Common path of travel shall not exceed 100 ft (30m) in a building protected throughout by an approved, supervised automatic automatic sprinkler system in accordance with 9.7.1.1(1)

38.2.5.2.1 In buildings protected throughout by an approved, supervised automatic sprinkler system in accordance with 9.7.1.1(1), dead-end corridors shall not exceed 50 ft (15 m).

38.2.6.3 Travel distance shall not exceed 300 ft (91 m) in business occupancies protected throughout by an approved, supervised automatic sprinkler system in accordance with Section 9.7.

38.2.9.1 Emergency lighting shall be provided in accordance with Section 7.9 in any building where any one of the following conditions exists:

- The building is three or more stories in height.
- The occupancy is subject to 50 or more occupants above or below the level of exit discharge.
- The occupancy is subject to 300 or more total occupants.

38.3.3.2.1 Interior wall and ceiling finish material complying with Section 10.2 shall be Class A or Class B in exits and in exit access corridors.

38.3.3.2.2 Interior wall and ceiling finishes shall be Class A, Class B, or Class C in areas other than those specified in 38.3.3.2.1.

38.3.4.1 General. A fire alarm system in accordance with Section 9.6 shall be provided in all business occupancies where any one of the following conditions exists:

- The building is three or more stories in height.
- The occupancy is subject to 50 or more occupants above or below the level of exit discharge.
- The occupancy is subject to 300 or more total occupants.

38.3.4.3 Occupant Notification. During all times that the building is occupied (see 7.2.1.1.3), the required fire alarm system, once initiated, shall perform one of the following functions:

- It shall activate a general alarm in accordance with 9.6.3.
- A positive alarm sequence in accordance with 9.6.3.4 shall be permitted.

38.3.4.4 Emergency Forces Notification. Emergency forces notification shall be provided and shall include notifying both of the following:

- Fire department in accordance with 9.6.4
- Approved local emergency organization, if provided

38.3.5 Extinguishment Requirements. Portable fire extinguishers shall be provided in every business occupancy in accordance with Section 9.9.

38.3.6.1 Where access to exits is provided by corridors, such corridors shall be separated from use areas by fire barriers in accordance with Section 8.3 having a minimum 1-hour fire resistance rating, unless one of the following conditions exists:

- (N/A)
- (N/A)
- Within buildings protected throughout by an approved, supervised automatic sprinkler system in accordance with 9.7.1.1(1)

CONTACTS

Client:
Northland Management Corp.
17 South Street, 3rd Floor
Portland, ME 04101

Architect:
Archetype Architects
48 Union Wharf
Portland, ME
04101
(207) 772 6022

Construction Manager:
Wright-Ryan Construction
10 Danforth Street
Portland, ME 04101

Structural Engineer:
Structural Integrity
77 Oak Street
Portland, ME 04101

Civil Engineer:
Pinkham & Greer
28 Vannah Ave
Portland, ME 04103