

SPLIT SYSTEM

TAG	MFG	INDOOR MODEL	COOLING BTU'S	HEATING BTU'S	TAG	OUTDOOR MODEL	VOLTS	PHASE	MCA	MAX FUSE	NOTES
DS-1	DAIKEN	FTXS24LVJU	25,400	31,400	CU-1	RXS24LVJU	208-230	1	17.5	20	

EXHAUST FANS

TAG	MANUFACTURER	MODEL #	CFM	VOLTS	PHASE	(HP)	NOTES
EF-1	GREENHECK	G-090-D	450	115	1	1/15	
EF-2	GREENHECK	G-123-B	825	115	1	1/6	

ROOFTOP UNITS

TAG	MFG	MODEL #	HTG (BTU)	CLG (BTU)	SUPPLY (CFM)	VOLT	PHASE	MCA	MAX FUSE	NOTES
RTU-1	TRANE	YSC072F3RMA	120,000	78,800	2,400	208-230	3	36.5	50.0	VARITRAC
RTU-2	TRANE	YSC048G3RMA	80,000	51,000	1,600	208-230	3	25.4	35.0	TRACKER
RTU-3	TRANE	YSC102F3RLA	120,000	107,300	3,400	208-230	3	43.3	50.0	TRACKER
RTU-4	TRANE	YSC120F3RLA	150,000	123,800	4,000	208-230	3	50.1	60.0	VARITRAC
RTU-5	TRANE	YSC102F3RLA	120,000	107,300	3,400	208-230	3	43.3	50.0	TRACKER
RTU-6	TRANE	YSC120F3RLA	150,000	123,800	4,000	208-230	3	50.1	60.0	VARITRAC
RTU-7	TRANE	YSC102F3RLA	120,000	107,300	3,400	208-230	3	43.3	50.0	VARITRAC

NOTES: ALL UNITS COME WITH MICROPROCESSOR CONTROLS, UNPOWERED CONVENIENCE OUTLET, CO2 WALL MOUNT FIELD SENSOR KIT

BOILER

TAG	MFG	MODEL #	INPUT BTU	OUTPUT BTU	VOLT	PHASE	MCA	NOTES
B-1	NTI	TFT110	108,000	99,000	120	1	12	FOR RADIANT/SNOWMELT

NOTES: EXTROL #60 EXPANSION TANK USED WITH BOILER.


PUMPS

TAG	MFG	MODEL #	GPM	VOLT	PHASE	NOTES
P-1	GRUNDFOS	UPS 15-58	17	115	1	
P-2	GRUNDFOS	UPS 26-99	33	115.0	1	
P-3	GRUNDFOS	UPS 26-99	33	115.0	1	


VAV'S

VAV #	MANUFACTURER	MODEL #	MIN CFM	MAX CFM	NOTES
1-1	TRANE	VCCF14	750	3000	1
1-2	TRANE	VCCF06	125	500	1
1-3	TRANE	VCCF06	125	500	1
1-4	TRANE	VCCF06	125	500	1
1-5	TRANE	VCCF10	350	1400	1
4-1	TRANE	VCCF12	500	2000	1
4-2	TRANE	VCCF06	125	500	1
4-3	TRANE	VCCF10	350	1400	1
4-4	TRANE	VCCF12	500	2000	1
4-5	TRANE	VCCF06	125	500	1
4-6	TRANE	VCCF14	750	3000	1
4-7	TRANE	VCCF06	125	500	1
6-1	TRANE	VCCF12	500	2000	1
6-2	TRANE	VCCF06	125	500	1
6-3	TRANE	VCCF06	125	500	1
6-4	TRANE	VCCF14	750	3000	1
6-5	TRANE	VCCF12	500	2000	1
7-1	TRANE	VCCF06	125	500	1
7-2	TRANE	VCCF06	125	500	1
7-3	TRANE	VCCF06	125	500	1
7-4	TRANE	VCCF06	125	500	1
7-5	TRANE	VCCF16	1000	4000	1
7-6	TRANE	VCCF10	350	1400	1
7-7	TRANE	VCEF06	125	500	1,2

NOTES: 1 FOIL FACED INSULATION, STD ACTUATOR, DDC SENSOR W/ OCCP AND SET PT (IN FIELD)
2 ELECTRIC REHEAT 2KW, DISCONNECT SWITCH, 208/1

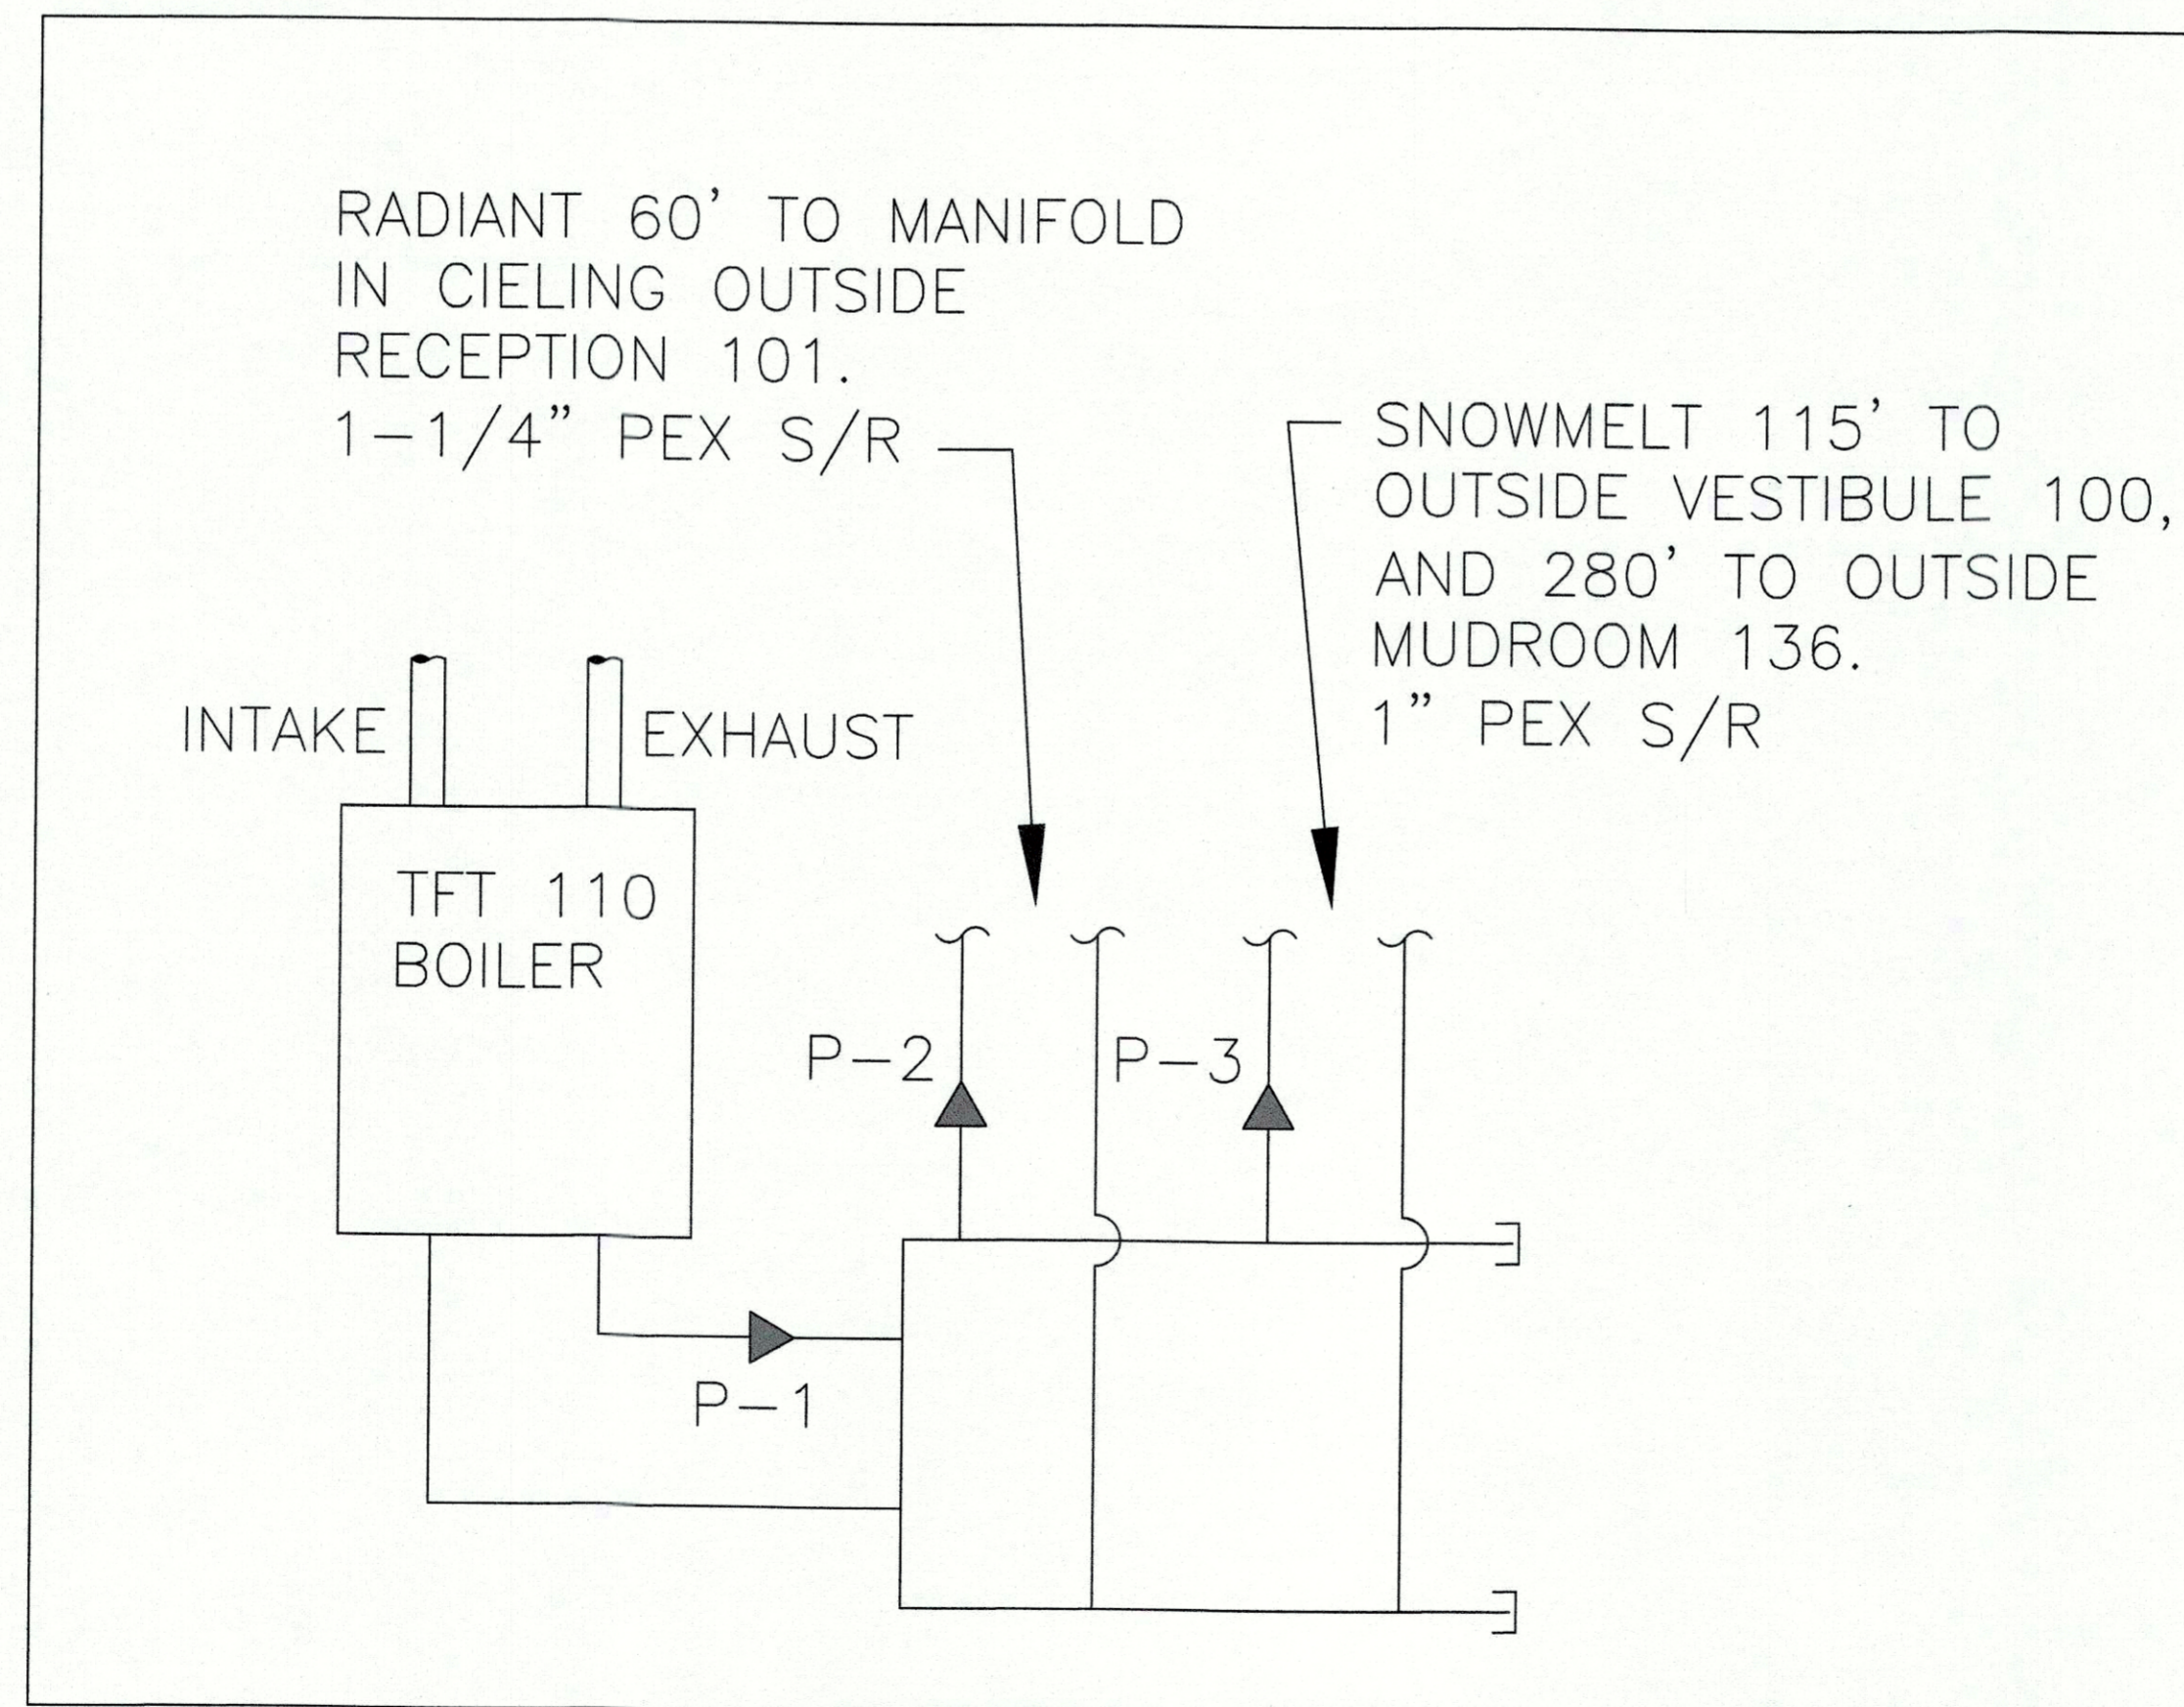

BOILER SCHEMATIC

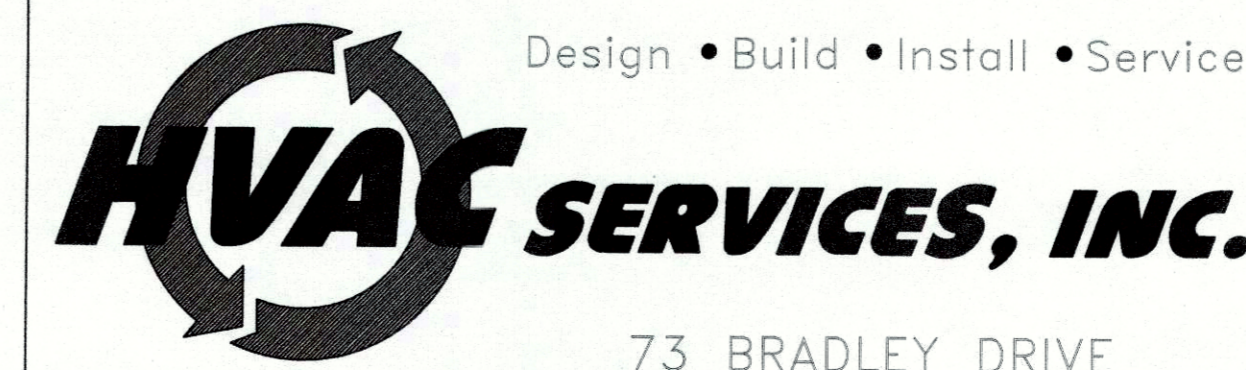

73 BRADLEY DRIVE
WESTBROOK, MAINE 04092
(207) 854-HVAC (4822)

REVISIONS

NO. NOTES

PROJECT: CLARK INSURANCE
1945 CONGRESS ST
PORTLAND, ME 04102

SHEET TITLE: EQUIPMENT SCHEDULES

SCALE: NTS
DRAWN BY: TJF
CHECKED BY:
SHEET SIZE: 36x24

DATE: 7-17-2017
SHEET No.

M-3