



- 2 ELECTRICAL SYMBOLS**  
NOT TO SCALE
- FIRE ALARM CONTROL PANEL
  - FIRE ALARM ANNUCIATOR PANEL
  - FIRE ALARM AUDIO/VISUAL, MOUNT 6'-8" AFF, NUMBER DENOTES CANDELA RATING. "MH" DENOTES MINHORN, "V" DENOTES VOICE EVACUATION. NO DESIGNATION EQUALS 15cd
  - FIRE ALARM PULL STATION, MOUNT 48" AFF
  - FIRE ALARM VISUAL STROBE ONLY, FLUSH MOUNT 6'-8" AFF, NUMBER DENOTES CANDELA RATINGS. "CL" DENOTES CEILING MOUNTED
  - SYSTEM CONNECTED SMOKE / CARBON MONOXIDE DETECTOR, PHOTOELECTRIC TYPE
  - SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR
  - SMOKE DETECTOR, PHOTOELECTRIC TYPE, SYSTEM CONNECTED.
  - SMOKE DETECTOR, PHOTOELECTRIC TYPE, SYSTEM CONNECTED. "ER" DENOTES ELEV RECALL
  - SYSTEM CONNECTED SMOKE DETECTOR, PHOTOELECTRIC TYPE, WITH SOUNDER BASE
  - CARBON MONOXIDE DETECTOR
  - DUCT SMOKE DETECTOR & TEST STATION
  - FIRE/SMOKE DAMPER, SUPPLIED AND INSTALLED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR TO PROVIDE ALL WIRING CONNECTIONS AND FIRE ALARM DUCT SMOKE DETECTORS, ADDRESSABLE MODULES AND PROGRAMMING.
  - KNOX BOX
  - SPRINKLER SYSTEM FLOW SWITCH } SUPPLIED BY SPRINKLER CONTRACTOR
  - SPRINKLER SYSTEM TAMPER SWITCH } WIRED BY EC, VERIFY LOCATIONS WITH SPRINKLER CONTRACTOR.
  - SELF CONTAINED EMERGENCY LIGHT W/2 HEADS DUAL-LITE (LED) MODEL LZ65H-03L, 65 WATTS FOR 90 MINUTES, COLOR BY ARCHITECT
  - UNIVERSAL MOUNTED, DOUBLE FACED EXIT LIGHT PROVIDE DIRECTIONAL ARROWS AS INDICATED ON PLAN
  - UNIVERSAL MOUNTED, SINGLE FACED EXIT LIGHT PROVIDE DIRECTIONAL ARROWS AS INDICATED ON PLAN

**1 ELECTRICAL LIFE SAFETY PLAN**  
1/8" = 1'-0"

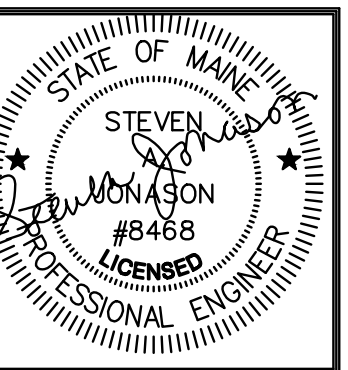

Prepared For:

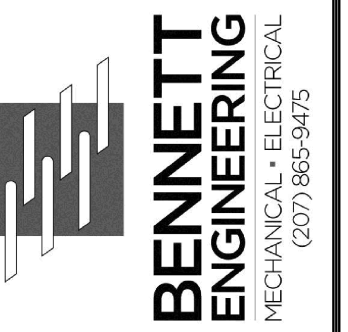

Consultant:



Architect:

Project: Elks Lodge

Portland, Maine

Revisions:

Date: 04/12/2017

Scale: 1/8" = 1'-0"

**ELECTRICAL LIFE SAFETY**

**ELS-1**