
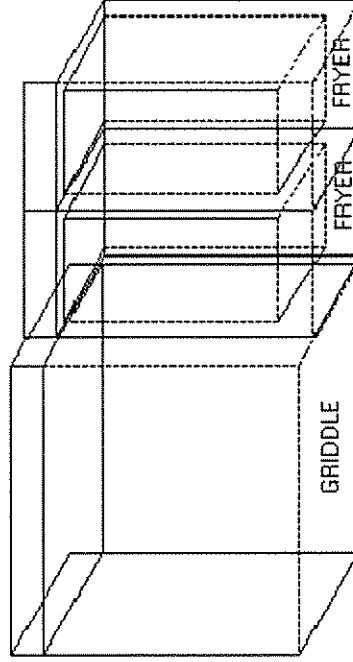



# Range Guard Wet Chemical Systems

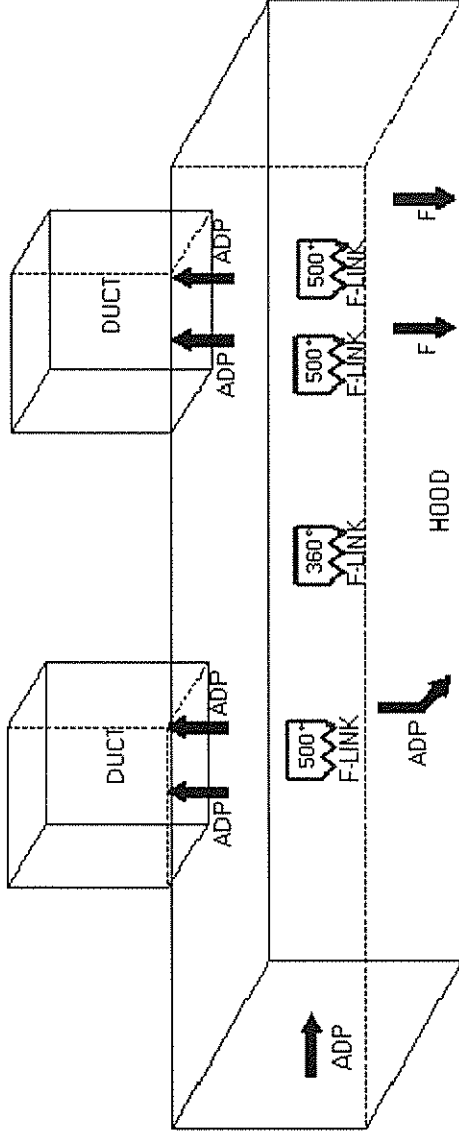

Total System Flow Points = 10

	Designed & Installed by: Firesafe Equipment Po Box 1355 Auburn, ME 04211 207-784-7525		For: PORTLAND ELKS LODGE		Lic #: Designer: Job #: Date: 8/22/2017	Stamp
	Total System Flow Points = 10					
	1 1/2" GasVal					
	Remote Pull					