

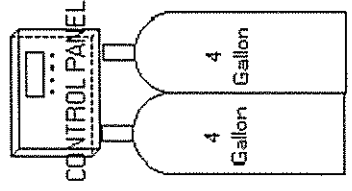


# Range Guard Wet Chemical Systems

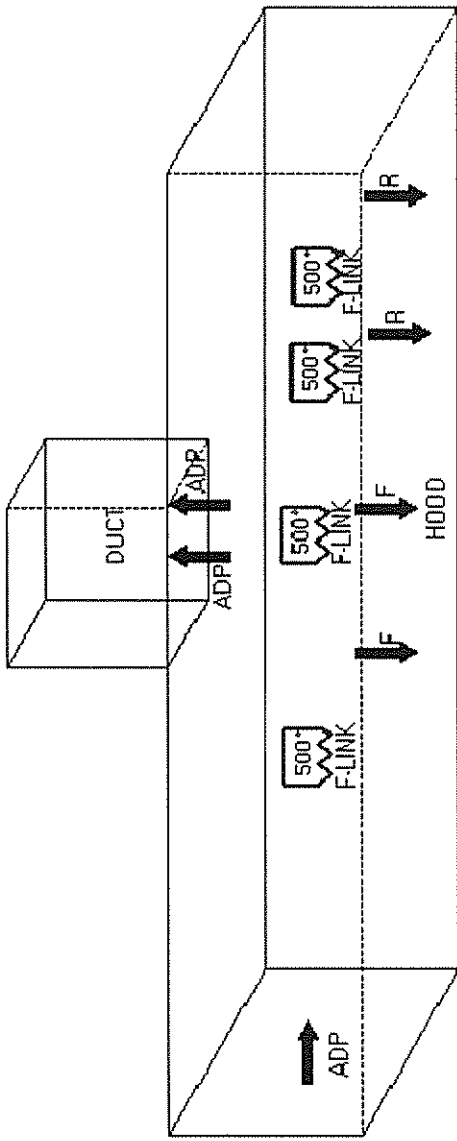


Remote Pull

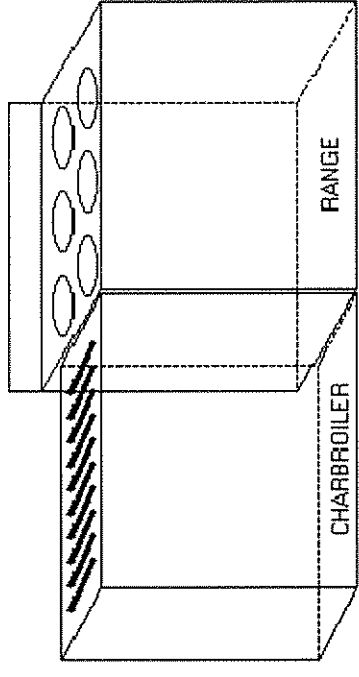

M  
1 1/2" GasVal

Total System Flow Points = 9

|   |   |  |                             |  |  |       |
|---|---|--|-----------------------------|--|--|-------|
|  | Designed & Installed by:<br>Firesafe Equipment<br>Po Box 1355<br>Auburn, ME 04211<br>207-784-7525 |  | For:<br>PORTLAND ELKS LODGE |  | Lic #:<br>Designer:<br>Job #:<br>Date: 8/22/2017 | Stamp |
|   |   |  |                             |  |  |       |
|   |   |  |                             |  |  |       |
|   |   |  |                             |  |  |       |